



# Energy Interoperation Version 1.0

## Committee Specification 03

02

~~[Committee Specification 01 with errata]~~ December 2013

~~18 February 2012~~

### Specification URIs

This version:

<http://docs.oasis-open.org/energyinterop/ei/v1.0/cs03/energyinterop-v1.0-cs03.pdf> (Authoritative)  
<http://docs.oasis-open.org/energyinterop/ei/v1.0/cs03/energyinterop-v1.0-cs03.html>  
<http://docs.oasis-open.org/energyinterop/ei/v1.0/cs03/energyinterop-v1.0-cs03.doc>

Previous version:

<http://docs.oasis-open.org/energyinterop/ei/v1.0/cs02/energyinterop-v1.0-cs02.pdf> (Authoritative)  
<http://docs.oasis-open.org/energyinterop/ei/v1.0/cs02/energyinterop-v1.0-cs02.html>  
<http://docs.oasis-open.org/energyinterop/ei/v1.0/cs02/energyinterop-v1.0-cs02.doc>

Latest version:

<http://docs.oasis-open.org/energyinterop/ei/v1.0/energyinterop-v1.0.pdf> (Authoritative)  
<http://docs.oasis-open.org/energyinterop/ei/v1.0/energyinterop-v1.0.html>  
<http://docs.oasis-open.org/energyinterop/ei/v1.0/energyinterop-v1.0.doc>

Technical Committee:

OASIS Energy Interoperation TC

Chairs:

David Holmberg ([david.holmberg@nist.gov](mailto:david.holmberg@nist.gov)), NIST  
William T. Cox ([wtcox@coxsoftwarearchitects.com](mailto:wtcoc@coxsoftwarearchitects.com)), Individual

Editors:

Toby Considine ([toby.considine@unc.edu](mailto:toby.considine@unc.edu)), University of North Carolina at Chapel Hill

Additional artifacts:

This prose specification is one component of a Work Product, ~~which that~~ also includes:

- XML schemas: <http://docs.oasis-open.org/energyinterop/ei/v1.0/cs03/xsd/>
  - [DocumentationSketches.xsd](#)
  - EIClasses.xsd
  - EiEnrollment.xsd
  - EiPayloads.xsd
  - iCalendar-streams-extensions.xsd
- ~~wsdl~~ WSDL files: <http://docs.oasis-open.org/energyinterop/ei/v1.0/cs03/wsd/>
  - EnergyInterop-Avail.wsdl
  - EnergyInterop-Delivery.wsdl
  - EnergyInterop-Enroll.wsdl
  - EnergyInterop-Event.wsdl
  - EnergyInterop-MarketContext.wsdl

- EnergyInterop-Opt.wsdl
- EnergyInterop-PartyRegistration.wsdl
- EnergyInterop-Quote.wsdl
- EnergyInterop-Report.wsdl
- EnergyInterop-Tender.wsdl
- EnergyInterop-Transaction.wsdl

#### Related work:

This specification is related to:

- *Energy Market Information Exchange (EMIX) Version 1.0*. Latest version. <http://docs.oasis-open.org/emix/emix/v1.0/emix-v1.0.html>.
- *WS-Calendar Version 1.0*. Latest version. <http://docs.oasis-open.org/ws-calendar/ws-calendar/v1.0/ws-calendar-1.0-spec.html>.
- NAESB Actors for [Demand Response \(DR\)](#)

#### Declared XML namespaces:

- <http://docs.oasis-open.org/ns/energyinterop/201110>
- <http://docs.oasis-open.org/ns/energyinterop/201110/enroll>
- <http://docs.oasis-open.org/ns/energyinterop/201110/payloads>
- <http://docs.oasis-open.org/ns/energyinterop/201110/wsdl>

#### Abstract:

~~This document incorporates minor editorial and typographic corrections.~~

Energy interoperation describes an information model and a communication model to enable collaborative and transactive use of energy, service definitions consistent with the OASIS SOA Reference Model [**SOA-RM**], and XML vocabularies for the interoperable and standard exchange of:

- Dynamic price signals
- Reliability signals
- Emergency signals
- Communication of market participation information such as bids
- Load predictability and generation information

This work facilitates enterprise interaction with energy markets, which:

- Allows effective response to emergency and reliability events
- Allows taking advantage of lower energy costs by deferring or accelerating usage
- Enables trading of curtailment and generation
- Supports symmetry of interaction between providers and consumers of energy
- Provides for aggregation of provision, curtailment, and use

The definition of a price and of reliability information depends on the market context in which it exists. It is not in scope for this TC to define specifications for markets or for pricing models, but the TC has coordinated with others to ensure that commonly used market and pricing models are supported.

While this specification uses Web Services to describe the services, no requirement or expectation of specific messaging implementation is assumed.

#### Status:

This document was last revised or approved by the OASIS Energy Interoperation TC on the above date. The level of approval is also listed above. Check the “Latest version” location noted above for possible later revisions of this document.

Technical Committee members should send comments on this specification to the Technical Committee’s email list. Others should send comments to the Technical Committee by using the “[Send A Comment](#)” button on the Technical Committee’s web page at <http://www.oasis-open.org/committees/energyinterop/>.

For information on whether any patents have been disclosed that may be essential to implementing this specification, and any offers of patent licensing terms, please refer to the

Intellectual Property Rights section of the Technical Committee web page (<http://www.oasis-open.org/committees/energyinterop/ipr.php>).

**Citation format:**

When referencing this specification the following citation format should be used:

**[ENERGYINTEROP-v1.0]**

*Energy Interoperation Version 1.0*. ~~18 February 2012~~ 02 December 2013. OASIS Committee Specification 0203. <http://docs.oasis-open.org/energyinterop/ei/v1.0/cs03/energyinterop-v1.0-cs03.html>.

---

## Notices

Copyright © OASIS Open 201~~2~~3. All Rights Reserved.

All capitalized terms in the following text have the meanings assigned to them in the OASIS Intellectual Property Rights Policy (the "OASIS IPR Policy"). The full [Policy](#) may be found at the OASIS website.

This document and translations of it may be copied and furnished to others, and derivative works that comment on or otherwise explain it or assist in its implementation may be prepared, copied, published, and distributed, in whole or in part, without restriction of any kind, provided that the above copyright notice and this section are included on all such copies and derivative works. However, this document itself may not be modified in any way, including by removing the copyright notice or references to OASIS, except as needed for the purpose of developing any document or deliverable produced by an OASIS Technical Committee (in which case the rules applicable to copyrights, as set forth in the OASIS IPR Policy, must be followed) or as required to translate it into languages other than English.

The limited permissions granted above are perpetual and will not be revoked by OASIS or its successors or assigns.

This document and the information contained herein is provided on an "AS IS" basis and OASIS DISCLAIMS ALL WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO ANY WARRANTY THAT THE USE OF THE INFORMATION HEREIN WILL NOT INFRINGE ANY OWNERSHIP RIGHTS OR ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.

OASIS requests that any OASIS Party or any other party that believes it has patent claims that would necessarily be infringed by implementations of this OASIS Committee Specification or OASIS Standard, to notify OASIS TC Administrator and provide an indication of its willingness to grant patent licenses to such patent claims in a manner consistent with the IPR Mode of the OASIS Technical Committee that produced this specification.

OASIS invites any party to contact the OASIS TC Administrator if it is aware of a claim of ownership of any patent claims that would necessarily be infringed by implementations of this specification by a patent holder that is not willing to provide a license to such patent claims in a manner consistent with the IPR Mode of the OASIS Technical Committee that produced this specification. OASIS may include such claims on its website, but disclaims any obligation to do so.

OASIS takes no position regarding the validity or scope of any intellectual property or other rights that might be claimed to pertain to the implementation or use of the technology described in this document or the extent to which any license under such rights might or might not be available; neither does it represent that it has made any effort to identify any such rights. Information on OASIS' procedures with respect to rights in any document or deliverable produced by an OASIS Technical Committee can be found on the OASIS website. Copies of claims of rights made available for publication and any assurances of licenses to be made available, or the result of an attempt made to obtain a general license or permission for the use of such proprietary rights by implementers or users of this OASIS Committee Specification or OASIS Standard, can be obtained from the OASIS TC Administrator. OASIS makes no representation that any information or list of intellectual property rights will at any time be complete, or that any claims in such list are, in fact, Essential Claims.

The name "OASIS" is a trademark of [OASIS](#), the owner and developer of this specification, and should be used only to refer to the organization and its official outputs. OASIS welcomes reference to, and implementation and use of, specifications, while reserving the right to enforce its marks against misleading uses. Please see <http://www.oasis-open.org/policies-guidelines/trademark> for above guidance.

---

# Table of Contents

1	Introduction.....	14
1.1	Terminology.....	15
1.2	Normative References.....	15
1.3	Non-Normative References.....	15
1.4	Contributions.....	17
1.5	Namespace.....	18
1.6	Naming Conventions.....	19
1.7	Editing Conventions.....	19
1.8	Architectural Background.....	19
2	Overview of Energy Interoperation.....	23
2.1	Scope of Energy Interoperation.....	23
2.2	Specific scope statements.....	23
2.3	Goals & Guidelines for Signals and Price and Product Communication.....	23
2.4	Scope of Energy Interoperation Communications.....	24
2.5	Collaborative Energy [Not Normative].....	24
2.6	Assumptions.....	26
2.6.1	Availability of Interval Metering.....	26
2.6.2	Use of EMIX.....	26
2.6.3	Use of WS-Calendar.....	26
2.6.4	Energy Services Interface.....	27
3	Energy Interoperation Architecture.....	28
3.1	Transactive Energy Interactions.....	28
3.1.1	Transaction Side.....	28
3.1.2	Transactive Interactions among Parties.....	28
3.1.3	Retail Service Interactions.....	29
3.1.4	Wholesale Power Interactions.....	29
3.1.5	Transport Interactions.....	29
3.2	Event Interactions for Demand and Generation Resources.....	30
3.2.1	VTN and VEN Party Roles.....	30
3.2.2	VTN/VEN Interactions.....	30
3.2.3	VTN/VEN Roles and Services.....	32
3.2.4	Demand Response Interactions.....	33
3.3	Roles, Resources and Interactions (Non-Normative).....	33
3.3.1	Choosing a Role.....	34
3.3.2	The relationship between Actors and Resources.....	34
4	Message Composition & Services.....	36
4.1	WS-Calendar in Energy Interoperation.....	36
4.1.1	Schedule Semantics from WS-Calendar (Non-Normative).....	36
4.1.2	Schedules and Inheritance.....	37
4.1.3	Availability and Schedules.....	38
4.1.4	Smoothing Response.....	39
4.2	EMIX in Energy Interoperation.....	39
4.2.1	Core Semantics from EMIX.....	40

4.2.2	Putting EMIX in Context .....	41
4.3	Streams: Adaptations of WS-Calendar for Energy Interoperation.....	42
4.3.1	Information Model for Streams .....	43
4.3.2	Conformance of Streams to WS-Calendar.....	43
4.3.3	Payload Optimization in Streams .....	44
4.3.4	Other elements in Stream Payloads .....	45
4.4	Applying EMIX and WS-Calendar to a Power Event.....	46
4.4.1	Streams in a DR Event.....	47
4.4.2	The Active Period Schedule .....	48
5	Semantics of Energy Interoperation .....	50
5.1	Dramatis Personae: Identifying the Actors .....	50
5.1.1	Actor IDs and Roles .....	51
5.2	Market Context .....	51
5.2.1	Simple Levels .....	52
5.2.2	Application Specific Extensions.....	52
5.2.3	Response Smoothing .....	53
5.3	Event-based Interactions .....	54
5.3.1	The Event Descriptor.....	54
5.3.2	The Active Period .....	55
5.3.3	The Event Signals .....	56
5.3.4	Baselines .....	58
5.3.5	Opt – Making Choices .....	58
5.4	Monitoring, Reporting, and Projection .....	59
5.4.1	The Report Specifier .....	60
5.4.2	Report Scheduler .....	62
5.4.3	UML Diagram of Report Request.....	65
5.5	Reports, Snaps, and Projections .....	65
5.5.1	Elements of the Report.....	66
5.5.2	Report Description.....	67
5.5.3	Report Payloads .....	68
5.5.4	UML Diagram of Report .....	71
5.6	Reponses and Error Reporting.....	71
5.6.1	Event Responses .....	72
5.6.2	References in Responses .....	73
5.7	Availability Behavior.....	73
6	Introduction to Services and Operations .....	74
6.1	Resources, Curtailment, and Generation .....	74
6.2	Structure of Energy Interoperation Services and Operations.....	74
6.3	Naming of Services and Operations .....	75
6.4	Push and Pull Patterns .....	75
6.5	WSDL Integration .....	76
6.6	Description of the Services and Operations .....	76
6.7	Responses .....	76
6.7.1	Terms Violated .....	77
6.7.2	Response Derivations .....	77

6.7.3	Compound Responses .....	78
6.7.4	Requests .....	79
7	Transactive Services .....	81
7.1	EiRegisterParty Service .....	81
7.1.1	Interaction Pattern for the EiRegisterParty Service .....	82
7.1.2	Information Model for the EiRegisterParty Service .....	82
7.1.3	Operation Payloads for the EiRegisterParty Service .....	83
7.2	Pre-Transaction Services .....	84
7.2.1	Interaction Pattern for the EiTender and EiQuote Services .....	85
7.2.2	Information Model for the EiTender and EiQuote Services .....	86
7.2.3	Operation Payloads for the EiTender Service .....	87
7.2.4	Operation Payloads for the EiQuote Service .....	88
7.3	Transaction Management Services .....	88
7.3.1	Interaction Patterns for the EiTransaction Service .....	89
7.3.2	Information Model for the EiTransaction Service .....	89
7.3.3	Operation Payloads for the EiTransaction Service .....	90
7.4	Post-Transaction Services .....	91
7.4.1	Energy Delivery Information .....	92
7.5	Comparison of Transactive Payloads .....	94
8	Enroll Service .....	95
8.1	Interaction Patterns for the EiEnroll Service .....	97
8.2	Information Model for the EiEnroll Service .....	98
8.3	Enrollee Types .....	99
8.4	Operation Payloads for the EiEnroll Service .....	100
9	Event Services .....	101
9.1	Information Model for the EiEvent Service .....	101
9.1.1	Structure of the Event .....	102
9.1.2	UML Model of an Event and its Signals .....	103
9.2	Special Semantics of the Event Request Operations .....	104
9.2.1	Event Ordering .....	104
9.2.2	Event Filter described .....	105
9.2.3	Using EiRequestEvent EiRequestEventPending together .....	105
9.3	Interaction Patterns for the EiEvent Service .....	107
9.4	Operation Payloads for the EiEvent Service .....	110
10	Report Service .....	111
10.1	Overview of Report Services .....	111
10.2	EiHistorian Service .....	113
10.2.1	Interaction Pattern for the EiHistorian Service .....	113
10.2.2	Operations Payloads for the EiHistorian Service .....	114
10.3	EiReport Service .....	115
10.3.1	Information Model for the EiReport Service .....	116
10.3.2	Interaction Pattern for the EiReport Service .....	120
10.3.3	Operation Payloads for the EiReport Service .....	121
10.4	EiProjectionService .....	122
10.4.1	Interaction Pattern for EiProjection Service .....	122

10.4.2	Operation Payloads for the EiProjection Service .....	122
10.5	Summary of Report Payloads.....	123
11	Event Support Services.....	124
11.1	Relationship of Availability and Opt Information .....	124
11.2	EiAvail Service .....	124
11.2.1	Interaction Patterns for the EiAvail Service.....	125
11.2.2	Information Model for the EiAvail Service .....	126
11.2.3	Operation Payloads for the EiAvail Service .....	127
11.3	EiOpt Service.....	128
11.3.1	Interaction Patterns for the EiOpt Service.....	128
11.3.2	Information Model for the EiOpt Service .....	128
11.3.3	Operation Payloads for the EiOpt Service .....	130
12	Market Information.....	131
12.1	The Market Context .....	131
12.2	Market Context Service .....	131
12.3	Information Model for the EiMarketContext Service .....	132
12.4	Operation Payloads for the EiMarket Context Service .....	133
13	Security and Composition [Non-Normative] .....	134
13.1	Security and Reliability Example .....	134
13.2	Composition.....	135
13.3	Energy Interoperation and Security .....	136
14	Profiles [Normative] .....	137
14.1	OpenADR [Normative].....	137
14.2	TeMIX [Normative].....	137
14.3	Price Distribution [Normative] .....	138
15	Conformance and Processing Rules for Energy Interoperation.....	139
15.1	Conformance for Energy Interoperation .....	139
15.1.1	General Conformance Requirements .....	139
15.1.2	Full Conformance to Energy Interoperation .....	139
15.1.3	Conformance to Energy Interoperation .....	139
15.1.4	Full Conformance with Alternate Interoperation to Energy Interoperation.....	140
15.1.5	Conformance with Alternate Interoperation to Energy Interoperation.....	140
15.1.6	Conformance to Named Profiles of Energy Interoperation .....	140
15.2	Conformance with the Semantic Models of EMIX and WS-Calendar .....	141
15.2.1	Recapitulation of Requirements from WS-Calendar and EMIX .....	141
15.3	TeMIX Conformance.....	142
15.4	Inheritance within Events.....	142
15.4.1	Sequence Optimization within Events.....	143
15.5	Version Conformance .....	143
Appendix A.	Background and Development history .....	144
Appendix B.	Glossary .....	146
Appendix C.	Extensibility in Energy Interoperation.....	147
C.1	Extensibility in Enumerated values.....	147
C.2	Extension of Structured Information Collective Items .....	147
Appendix D.	Mapping NAESB Definitions to Terminology of Energy Interoperation .....	148



Appendix E. Acknowledgements ..... 152  
Appendix F. Revision History ..... 154

---

# Tables, Figures & Examples

---

## Index to Figures

Figure 1-1: Conceptual model for smart grid from [NIST] showing communications requirements .....	14
Figure 1-2: One-way MEP .....	20
Figure 1-3: Callback MEP .....	21
Figure 1-4: PULL MEP .....	22
Figure 3-1: Parties Interacting Using Tenders for Transactions .....	29
Figure 3-2: Example DR Interaction One .....	30
Figure 3-3: Example DR Interaction Two .....	31
Figure 3-4: Example DR Interaction Three .....	31
Figure 3-5: Web of Example DR Interactions .....	31
Figure 3-6: Service Interactions between a VTN and a VEN .....	32
Figure 3-7: Demand Response Interaction Pattern Example .....	33
Figure 4-1: Basic Power Object from EMIX .....	37
Figure 4-2: WS-Calendar Partition, a simple sequence of 5 intervals .....	37
Figure 4-3: Applying Basic Power to a Sequence .....	38
Figure 4-4: Simplifying back to Power in a Single Interval.....	38
Figure 4-5: Stream as Gluon and Sequence .....	42
Figure 4-6: UML Class Diagram of abstract StreamBase class .....	43
Figure 4-7: Payload Base.....	45
Figure 4-8: Comparing Payloads for Signals, Baselines, Reports, and Delivery.....	46
Figure 4-9 Demand Response Event and associated Streams.....	47
Figure 5-1: EI Target .....	51
Figure 5-2: UML Class Diagram of Party ID and its derivatives .....	51
Figure 5-3: EI Market Context.....	52
Figure 5-4: Event Overview.....	54
Figure 5-5: Active Period Elements .....	56
Figure 5-6: Event Signal Overview .....	57
Figure 5-7: The Report Request .....	59
Figure 5-8: The Report Specifier.....	60
Figure 5-9: Report Scheduler.....	62
Figure 5-10: UML Diagram of Report Scheduler .....	64
Figure 5-11: UML Class Diagram of Report Request .....	65
Figure 5-12: The Report.....	66
Figure 5-13: The Report Description.....	67
Figure 5-14: the Report Payload.....	69
Figure 5-15: Illustrating Aggregate vs. Summary.....	70
Figure 5-16: UML Class Diagram of Reports.....	71
Figure 5-17: UML Diagram showing refID and its derived types .....	73

Figure 6-1: Generalized view of the high-level message structure .....	76
Figure 6-2: Example of generic error response for a service operation .....	77
Figure 6-3: UML for Response.....	79
Figure 7-1: Interaction Diagram for EiRegisterParty Service.....	82
Figure 7-2: EiParty UML Class Diagram.....	82
Figure 7-3: UML Class Diagram for EiRegisterParty Service Operation Payloads .....	83
Figure 7-4: Interaction Diagram for the EiTender Service .....	85
Figure 7-5: Interaction Diagram for the EiQuote Service.....	86
Figure 7-6: UML Class Diagram for the Operation Payloads for the EiTender Service .....	87
Figure 7-7: UML Class Diagram for the EiQuote Service Operation Payloads .....	88
Figure 7-8: Interaction Diagram for the EiTransaction Service.....	89
Figure 7-9: UML Class Diagram of EiTransaction Service Operation Payloads .....	90
Figure 7-10: Interaction Diagram for Delivery Service.....	92
Figure 7-11: UML of EiDelivery Type.....	93
Figure 7-12: UML Class Diagram of Delivery and Delivery Payload .....	93
Figure 7-13: UML Diagram comparing all Transactive Payloads .....	94
Figure 8-1: Interaction Diagram for the EiEnroll Service .....	97
Figure 8-2: UML Model for EiEnrollment Classes.....	98
Figure 8-3: UML Class Diagram showing Enrollee Types .....	99
Figure 8-4: UML Class Diagram for Enrollment Payloads .....	100
Figure 9-1: EiEvent summarized.....	102
Figure 9-2: UML Class Diagram for EiEventType and Related Classes (w/o Signals detail).....	103
Figure 9-3 UML Class Diagram Showing Details of the Signal Payloads or EiEventSignals.....	104
Figure 9-4: Qualified Event ID.....	105
Figure 9-5: UML Interaction Diagram for the EiEvent Service Operations .....	107
Figure 9-6: UML for example PULL pattern for EiEvent .....	108
Figure 9-7: Interaction Diagram for Pending Event operation .....	109
Figure 9-8: UML Class Diagram for EiEvent Service Operation Payloads.....	110
Figure 10-1: Interaction Pattern for Historian Operations (Report Service).....	113
Figure 10-2: UML Diagram of Historian Payloads .....	114
Figure 10-3: UML Class Diagram for the EiReport Class .....	119
Figure 10-4: UML Interaction Diagram for the EiReport Service (Report Service).....	120
Figure 10-5: UML Diagram of Report Payloads.....	121
Figure 10-6: Interaction Pattern for Projection Operations (Report Service).....	122
Figure 10-7: UML Diagram of Projection Payloads .....	122
Figure 10-8: UML Class Diagram for all EiReportService Operation Payloads.....	123
Figure 11-1: Interaction Pattern for the EiAvailability Service.....	125
Figure 11-2: UML Class Diagram for the EiAvail Type .....	126
Figure 11-3: UML Class Diagram for EiAvail Service Operation Payloads .....	127
Figure 11-4: Interaction Diagram for the EiOpt Service.....	128
Figure 11-5: UML Class Diagram for EiOpt Type .....	129
Figure 11-6: UML Class Diagram for EiOpt Service Operation Payloads .....	130

Figure 12-1: Sequence diagram for Market Context service .....	131
Figure 12-2: UML Class Diagram for Market Context.....	132
Figure 12-3: UML of Market Context Service payloads .....	133
Figure 13-1: Web of Example DR Interactions .....	134

---

## Index to Tables

Table 1-1: Namespaces Used in this Specification .....	18
Table 3-1: Interactions and Actors .....	31
Table 4-1: Core Semantics from WS-Calendar .....	36
Table 4-2: WS-Calendar Semantics: Inheritance.....	38
Table 4-3: EMIX Essential Semantics.....	40
Table 4-4: EMIX Market Context.....	41
Table 4-5: Semantics of the Active Period.....	48
Table 5-1: Energy Interoperation Identities .....	50
Table 5-2: Simple Levels.....	52
Table 5-3: Application Specific Extensions .....	53
Table 5-4: Smoothing Terms.....	53
Table 5-5: The Event Descriptor .....	54
Table 5-6: Signal Types .....	57
Table 5-7: Opt .....	58
Table 5-8: Elements of the Report Request.....	59
Table 5-9: Elements of the Report Specifier .....	60
Table 5-10: Report Specifier Payload .....	61
Table 5-11: Report Types .....	61
Table 5-12: Types of Report Scheduler .....	63
Table 5-13: Reports .....	66
Table 5-14: Elements of Reports .....	66
Table 5-15: Elements of the Report Description .....	68
Table 5-16: Report Payload Qualifiers.....	69
Table 5-17: Reading Types.....	69
Table 5-18: Responses .....	71
Table 5-19: Event Response.....	72
Table 5-20: Availability Behavior.....	73
Table 7-1: Register Services.....	81
Table 7-2: Pre-Transaction Tender Services .....	84
Table 7-3: Pre-Transaction Quote Services.....	84
Table 7-4: Transaction Management Service .....	89
Table 7-5: Energy Delivery.....	92
Table 8-1 Enrollee Descriptions .....	95
Table 8-2: EiEnroll Service Operations.....	96
Table 9-1: Event Services .....	101

Table 9-2: Event Filter described .....	105
Table 9-3: Event Requests summarized .....	106
Table 10-1: Report Service .....	111
Table 11-1: Avail Service .....	125
Table 11-2: Opt Service .....	128
Table 12-1: Market Context Service .....	131
Table 13-1: Interactions and Actors for Security and Reliability Example .....	135
Table 14-1: Services used in OpenADR Profile.....	137
Table 14-2: Services used in TeMIX Profile.....	137
Table 14-3: Services used in Price Distribution Profile .....	138

# 1 Introduction

Energy Interoperation describes an information and communication model to coordinate energy supply, transmission, distribution, and use, including power and ancillary services, between any two parties, such as energy suppliers and customers, markets and service providers, in any of the domains indicated in Figure 2.1 below. Energy Interoperation makes no assumptions about which entities will enter those markets, or as to what those market roles will be called in the future. Energy Interoperation supports each of the secure communications interfaces in Figure 1-1, but is not limited to those interfaces.

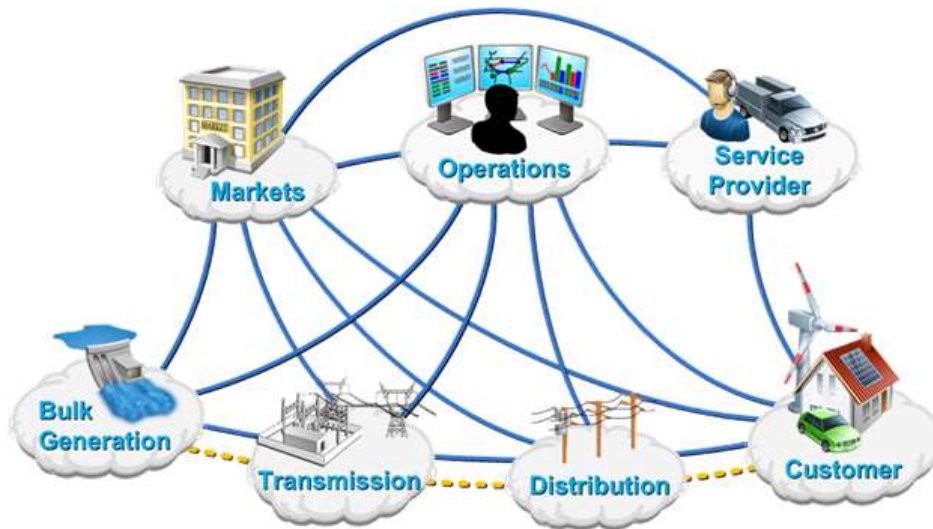


Figure 1-1: Conceptual model for smart grid from [NIST] showing communications requirements

Energy Interoperation defines messages to communicate price, reliability, and emergency conditions over communications interfaces. Energy Interoperation is agnostic as to the technology that a communications interface may use to carry these messages.

Energy Interoperation messages can concern real time interactions, forward projections, or historical reporting. Energy Interoperation is intended to support market-based balancing of energy supply and demand while increasing fluidity of transactions. Increased deployment of distributed and intermittent energy sources will require greater fluidity in both wholesale and retail markets. In retail markets, Energy Interoperation is meant to support greater consumer choice as to energy source.

Energy supplies are becoming more volatile due to the introduction of renewable energy sources. The introduction of distributed energy resources may create localized, volatile, surpluses and shortages. These changes will create more granular energy transactions, require more granularity in temporal price changes, and more granularity in service territory.

Balancing local energy resources brings more kinds of resources into the mix. Natural gas markets share many characteristics with electricity markets. Local thermal energy distribution systems can balance electricity markets while having their own surpluses and shortages. Nothing in Energy Interoperation restricts its use to electricity-based markets.

Energy consumers will need technologies to manage their local energy supply, including curtailment, storage, generation, and time-of-use load shaping and shifting. In particular, consumers will respond to Energy Interoperation messages for emergency and reliability events, or price messages to take advantage of lower energy costs by deferring or accelerating usage, and to trade curtailment, local generation and energy supply rights. Energy Interoperation does not specify which technologies consumers will use; rather it defines a technology agnostic interface to enable accelerated market development of such technologies.

33 | To balance supply and demand, energy suppliers must be able to schedule resources, manage  
34 aggregation, and communicate both the scarcity and surplus of energy supply over time. Suppliers will  
35 use Energy Interoperation to inform customers of emergency and reliability events, to trade curtailment  
36 and supply of energy, and to provide intermediation services including aggregation of provision,  
37 curtailment, and use.

38 Energy Interoperation relies on standard format for communication of time and interval [WS-Calendar]  
39 | and for ~~Energy Price~~energy price and ~~Product Definition~~product definition [EMIX]. This document  
40 assumes that there is a high degree of symmetry of interaction at any Energy Interoperation interface,  
41 i.e., that providers and customers may reverse roles during any period.

42 The OASIS Energy Interoperation Technical Committee is developing this specification in support of the  
43 National Institute of Standards and Technology (NIST) Framework and Roadmap for Smart Grid  
44 Interoperability Standards, Release 1.0 [Framework] in support of the US Department of Energy (DOE) as  
45 described in the Energy Independence and Security Act of 2007 [EISA2007].

46 Under the Framework and Roadmap, the North American Energy Standards Board (NAESB) surveyed  
47 the electricity industry and prepared a consensus statement of requirements and vocabulary. This work  
48 was submitted to the Energy Interoperation Committee in April 2010 and subsequently updated and  
49 delivered in January 2011.

50 All examples and all Appendices are non-normative.

## 51 1.1 Terminology

52 The key words “MUST”, “MUST NOT”, “REQUIRED”, “SHALL”, “SHALL NOT”, “SHOULD”, “SHOULD  
53 NOT”, “RECOMMENDED”, “MAY”, and “OPTIONAL” in this document are to be interpreted as described  
54 in [RFC2119]

## 55 1.2 Normative References

- 56 | [EMIX] **EMIX OASIS Committee Specification Draft 04, Energy Market Information**  
57 **Exchange (~~EMIX~~ Version 1.0, 11 January 2012, OASIS Committee**  
58 **Specification, September 2010, [http://docs.oasis-](http://docs.oasis-open.org/emix/emix/v1.0/csd04/emix-v1.0-csd04.html)**  
59 **[open.org/emix/emix/v1.0/csd04/emix-v1.0-csd04.html](http://docs.oasis-open.org/emix/emix/v1.0/csd04/emix-v1.0-csd04.html)**
- 60 | [RFC2119] **S. Bradner, Key words for use in RFCs to Indicate Requirement Levels,**  
61 **<http://www.ietf.org/rfc/rfc2119.txt>, IETF RFC 2119, March 1997.**
- 62 | [RFC2246] **T. Dierks, C. Allen Transport Layer Security (TLS) Protocol Version 1.0,**  
63 **<http://www.ietf.org/rfc/rfc2246.txt>, IETF RFC 2246, January 1999.**
- 64 | [SOA-RM] **SOA-RM OASIS Standard, OASIS Reference Model for Service Oriented**  
65 **Architecture 1.0, October 2006 <http://docs.oasis-open.org/soa-rm/v1.0/>**
- 66 | [Vavailability] **C. Daboo, B. Desruisseaux, Calendar Availability,**  
67 **<http://tools.ietf.org/html/draft-daboo-calendar-availability-02>, IETF Internet**  
68 **Draft, April 2011**
- 69 | [WS-Calendar] **WS-Calendar OASIS Committee Specification 1.0, WS-Calendar, July 2011,**  
70 **[http://docs.oasis-open.org/ws-calendar/ws-calendar-spec/v1.0/cs01/ws-](http://docs.oasis-open.org/ws-calendar/ws-calendar-spec/v1.0/cs01/ws-calendar-spec-v1.0-cs01.pdf)**  
71 **[calendar-spec-v1.0-cs01.pdf](http://docs.oasis-open.org/ws-calendar/ws-calendar-spec/v1.0/cs01/ws-calendar-spec-v1.0-cs01.pdf)**

## 72 1.3 Non-Normative References

- 73 | [BACnet/WS] **Addendum C to ANSI/ASHRAE Standard 135-2004, BACnet Web Services**  
74 **Interface.**
- 75 | [ebXML-MS] **OASIS Standard, Electronic Business XML (ebXML) Message Service**  
76 **Specification v3.0: Part 1, Core Features, October 2007. [http://docs.oasis-](http://docs.oasis-open.org/ebxml-msg/ebms/v3.0/core/os/ebms_core-3.0-spec-os.pdf)**  
77 **[open.org/ebxml-msg/ebms/v3.0/core/os/ebms\\_core-3.0-spec-os.pdf](http://docs.oasis-open.org/ebxml-msg/ebms/v3.0/core/os/ebms_core-3.0-spec-os.pdf)**
- 78 | [EISA2007] **Energy Independence and Security Act of 2007,**  
79 **<http://nist.gov/smartgrid/upload/EISA-Energy-bill-110-140-TITLE-XIII.pdf>**

80	[EPRI]	Concepts to Enable Advancement of Distributed Energy Resources, February 2010,
81		<a href="http://my.epri.com/portal/server.pt?Abstract_id=00000000001020432">http://my.epri.com/portal/server.pt?Abstract_id=00000000001020432</a>
82		
83	[Framework]	National Institute of Standards and Technology, <i>NIST Framework and Roadmap for Smart Grid Interoperability Standards, Release 1.0</i> , January 2010,
84		<a href="http://nist.gov/public_affairs/releases/upload/smartgrid_interoperability_final.pdf">http://nist.gov/public_affairs/releases/upload/smartgrid_interoperability_final.pdf</a>
85		
86		
87		
88	[Galvin]	Galvin Electricity Initiative, <i>Perfect Power</i> ,
89		<a href="http://www.galvinpower.org/perfect-power/what-is-perfect-power">http://www.galvinpower.org/perfect-power/what-is-perfect-power</a>
90	[ID-CLOUD]	OASIS Identity in the Cloud Technical Committee
91		<a href="http://www.oasis-open.org/committees/id-cloud">http://www.oasis-open.org/committees/id-cloud</a>
92	[IEC 61968]	Application integration at electric utilities - System interfaces for distribution management - Part 9: Interfaces for meter reading and control
93		
94	[IEC 61970-301]	Energy management system application program interface (EMS-API) - Part 301: Common information model (CIM) base
95		
96	[KMIP]	OASIS Standard, <i>Key Management Interoperability Protocol Specification Version 1.0</i> , October 2010
97		<a href="http://docs.oasis-open.org/kmip/spec/v1.0/kmip-spec-1.0.pdf">http://docs.oasis-open.org/kmip/spec/v1.0/kmip-spec-1.0.pdf</a>
98		
99	[OpenADR]	Mary Ann Piette, Girish Ghatikar, Sila Kiliccote, Ed Koch, Dan Hennage, Peter Palensky, and Charles McParland. 2009. Open Automated Demand Response Communications Specification (Version 1.0). California Energy Commission, PIER Program. CEC-500-2009-063.
100		
101		
102		
103	[NAESB-SG]	NAESB Smart Grid Subcommittee,
104		<a href="http://www.naesb.org/smart_grid_standards_strategies_development.asp">http://www.naesb.org/smart_grid_standards_strategies_development.asp</a>
105	[OASIS SCA]	OASIS Service Component Architecture Member Section
106		<a href="http://www.oasis-open.org/sca">http://www.oasis-open.org/sca</a>
107	[ <del>OASIS</del> -PMRM]	OASIS Privacy Management Reference Model (PMRM) Technical Committee, <a href="http://www.oasis-open.org/committees/pmrm">http://www.oasis-open.org/committees/pmrm</a>
108		
109	[SAML]	OASIS Standard, <i>Security Assertion Markup Language 2.0</i> , March 2005.
110		<a href="http://docs.oasis-open.org/security/saml/v2.0/saml-core-2.0-os.pdf">http://docs.oasis-open.org/security/saml/v2.0/saml-core-2.0-os.pdf</a>
111	[SOA-RA]	OASIS Public Review Draft 01, <i>Reference Architecture for Service Oriented Architecture Version 1.0</i> , April 2008
112		<a href="http://docs.oasis-open.org/soa-rm/soa-ra/v1.0/soa-ra-pr-01.pdf">http://docs.oasis-open.org/soa-rm/soa-ra/v1.0/soa-ra-pr-01.pdf</a>
113		
114	[SPML]	OASIS Standard, <i>Service Provisioning Markup Language (SPML) v2 - DSML v2 Profile</i> , April 2006. <a href="http://www.oasis-open.org/committees/download.php/17708/pstc-spml-2.0-os.zip">http://www.oasis-</a>
115		<a href="http://www.oasis-open.org/committees/download.php/17708/pstc-spml-2.0-os.zip">open.org/committees/download.php/17708/pstc-spml-2.0-os.zip</a> [TC57CIM]
116		IEC Technical Committee 57 Common Information Model (IEC 61968 and IEC 61970, various dates)
117		
118		
119	[ <del>Te</del> eMIX]	TeMIX <i>Transactive Energy Market Information Exchange [TeMIX] an approved Note of the EMIX TC</i> . Ed Cazalet et al. <a href="http://www.oasis-open.org/committees/download.php/37954/TeMIX-20100523.pdf">http://www.oasis-</a>
120		<a href="http://www.oasis-open.org/committees/download.php/37954/TeMIX-20100523.pdf">open.org/committees/download.php/37954/TeMIX-20100523.pdf</a>
121		
122	[UML]	<u>Object Management Group, <i>Unified Modeling Language (UML), V2.4.1, August 2011</i>. <a href="http://www.omg.org/spec/UML/2.4.1/">http://www.omg.org/spec/UML/2.4.1/</a></u>
123		
124	[Vavailability]	C. Daboo, B. Desruisseaux, <i>Calendar Availability</i> ,
125		<a href="http://tools.ietf.org/html/draft-daboo-calendar-availability-02">http://tools.ietf.org/html/draft-daboo-calendar-availability-02</a> , IETF Internet Draft, April 2011
126		
127	[WS-Addr]	Web Services Addressing (WS-Addressing) 1.0, W3C Recommendation,
128		<a href="http://www.w3.org/2005/08/addressing">http://www.w3.org/2005/08/addressing</a> .
129	[WSFED]	OASIS Standard, <i>Web Services Federation Language (WS-Federation) Version 1.2</i> , 01 May 2009 <a href="http://docs.oasis-open.org/wsfed/federation/v1.2/os/ws-federation-1.2-spec-os.doc">http://docs.oasis-</a>
130		<a href="http://docs.oasis-open.org/wsfed/federation/v1.2/os/ws-federation-1.2-spec-os.doc">open.org/wsfed/federation/v1.2/os/ws-federation-1.2-spec-os.doc</a>
131		



- 132 [WSI-Basic] R Chumbley, J Durand, G Pilz, T Rutt , *Basic Profile Version 2.0*,  
 133 <http://ws-i.org/profiles/BasicProfile-2.0-2010-11-09.html>,  
 134 The Web Services-Interoperability Organization, November 2010
- 135 [WSRM] OASIS Standard, *WS-Reliable Messaging 1.1*, November 2004.  
 136 [http://docs.oasis-open.org/wsrn/ws-reliability/v1.1/wsrn-ws\\_reliability-1.1-spec-os.pdf](http://docs.oasis-open.org/wsrn/ws-reliability/v1.1/wsrn-ws_reliability-1.1-spec-os.pdf)  
 137
- 138 [WS-SecureConversation] OASIS Standard, *WS-SecureConversation 1.3*, March 2007.  
 139 <http://docs.oasis-open.org/ws-sx/ws-secureconversation/200512/ws-secureconversation-1.3-os.pdf>  
 140
- 141 [WS-Security] OASIS Standard, *WS-Security 2004 1.1*, February 2006.  
 142 <http://www.oasis-open.org/committees/download.php/16790/wss-v1.1-spec-os-SOAPMessageSecurity.pdf>  
 143
- 144 [WS-SX] OASIS Web Services Secure Exchange (WS-SX) Technical Committee  
 145 <http://www.oasis-open.org/committees/ws-sx>
- 146 [XACML] OASIS Standard, *eXtensible Access Control Markup Language 2.0*,  
 147 February 2005. [http://docs.oasis-open.org/xacml/2.0/access\\_control-xacml-2.0-core-spec-os.pdf](http://docs.oasis-open.org/xacml/2.0/access_control-xacml-2.0-core-spec-os.pdf)  
 148

## 149 1.4 Contributions

150 The NIST Roadmap for Smart Grid Interoperability Standards described in the **[Framework]** requested  
 151 that many standards development organizations (SDOs) and trade associations work together closely in  
 152 unprecedented ways. An extraordinary number of groups came together and contributed effort, time,  
 153 requirements, and documents. Each of these groups further gathered together, repeatedly, to review the  
 154 work products of this committee and submit detailed comments. These groups contributed large numbers  
 155 of documents to the Technical Committee. These efforts intersected with this specification in ways almost  
 156 impossible to unravel, and the committee acknowledges the invaluable works below which are essential  
 157 to understanding the North American Grid and its operation today, as well as its potential futures.

### 158 **NAESB Smart Grid Standards Development Subcommittee [NAESB-SG]:**

159 The following documents are password protected. For information about obtaining access to  
 160 these documents, please visit [www.naesb.org](http://www.naesb.org) or contact the NAESB office at (713) 356 0060.

- 161 [NAESB EUI] NAESB REQ Energy Usage Information Model:  
 162 [http://www.naesb.org/member\\_login\\_check.asp?doc=req\\_rat102910\\_req\\_2010\\_ap\\_9d\\_rec.doc](http://www.naesb.org/member_login_check.asp?doc=req_rat102910_req_2010_ap_9d_rec.doc)  
 163
- 164 [NAESB EUI] NAESB WEQ Energy Usage Information Model:  
 165 [http://www.naesb.org/member\\_login\\_check.asp?doc=weq\\_rat102910\\_weq\\_2010\\_ap\\_6d\\_rec.doc](http://www.naesb.org/member_login_check.asp?doc=weq_rat102910_weq_2010_ap_6d_rec.doc)  
 166

167 The following documents are under development and subject to change.

- 168 [NAESB PAP 09] Phase Two Requirements Specification for Wholesale Standard DR Signals – for  
 169 NIST PAP09:  
 170 [http://www.naesb.org/member\\_login\\_check.asp?doc=fa\\_2010\\_weq\\_api\\_6\\_c\\_ii.doc](http://www.naesb.org/member_login_check.asp?doc=fa_2010_weq_api_6_c_ii.doc)  
 171
- 172 [NAESB PAP 09] Phase Two Requirements Specification for Retail Standard DR Signals – for  
 173 NIST PAP09:  
 174 [http://www.naesb.org/member\\_login\\_check.asp?doc=fa\\_2010\\_retail\\_api\\_9\\_c.doc](http://www.naesb.org/member_login_check.asp?doc=fa_2010_retail_api_9_c.doc)  
 175

176 *The NAESB Measurement and Verification of Demand Response (WEQ-015) and Measurement and*  
 177 *Verification of Energy Efficiency Products (WEQ-021) standards were adopted by the US Federal Energy*  
 178 *Regulatory Commission (FERC) on February 21, 2013 and have been incorporated by reference as*  
 179 *federal regulation. The complementary standards developed to support the retail markets (REQ.13 and*  
 180 *REQ.19, respectively) were adopted by NAESB and are available for consideration by state regulatory*  
 181 *agencies. The NAESB Demand Side Management and Energy Efficiency Subcommittee is currently*  
 182 *developing a certification program for energy efficiency and demand response measurement and*  
 183 *verification products that comply with the NAESB standards.*

- 184 **The ISO / RTO Council Smart Grid Standards Project:**
- 185 Information Model – HTML: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-InformationModel-HTML-Condensed\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-InformationModel-HTML-Condensed_Rev1_20101014.zip)
- 186
- 187
- 188 Information Model – EAP: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-InformationModel-EAP-Condensed\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-InformationModel-EAP-Condensed_Rev1_20101014.zip)
- 189
- 190
- 191 XML Schemas: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-XML\\_Schemas\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-XML_Schemas_Rev1_20101014.zip)
- 192
- 193 Eclipse CIMTool Project: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-CIMTool-Project-Workspace\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-CIMTool-Project-Workspace_Rev1_20101014.zip)
- 194
- 195
- 196 Interactions - Enrollment and Qualification: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML\\_Enrollment\\_And\\_Qualification\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML_Enrollment_And_Qualification_Rev1_20101014.zip)
- 197
- 198
- 199 Interactions - Scheduling and Award Notification: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML\\_Scheduling\\_And\\_Award\\_Notification\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML_Scheduling_And_Award_Notification_Rev1_20101014.zip)
- 200
- 201
- 202 Interactions - Deployment and Real Time Notifications: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML\\_Deployment\\_And\\_RealTime\\_Communications\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML_Deployment_And_RealTime_Communications_Rev1_20101014.zip)
- 203
- 204
- 205 Interactions - Measurement and Performance: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML\\_Measurement\\_And\\_Performance\\_Rev1\\_20101014.zip](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Interactions-HTML_Measurement_And_Performance_Rev1_20101014.zip)
- 206
- 207
- 208 Interactions Non-Functional Requirements: [http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Non-Functional\\_Requirements\\_Rev1\\_20100930.pdf](http://www.isorto.org/atf/cf/%7B5B4E85C6-7EAC-40A0-8DC3-003829518EBD%7D/IRC-DR-Non-Functional_Requirements_Rev1_20100930.pdf)
- 209
- 210

211 **UCAIug OpenSG OpenADR Task Force:**

- 212 OpenADR 1.0 System Requirements Specification v1.0
- 213 <http://osgug.ucaiug.org/sghsystems/OpenADR/Shared%20Documents/SRS/OpenSG%20OpenADR%201.0%20SRS%20v1.0.pdf>
- 214
- 215 OpenADR 1.0 Service Definition - Common Version :R0.91
- 216 <http://osgug.ucaiug.org/sghsystems/OpenADR/Shared%20Documents/Services/OpenSG%20OpenADR%20SD%20-%20Common%20r0.91.doc>
- 217
- 218 OpenADR 1.0 Service Definition – Web Services Implementation Profile Version: v0.91
- 219 <http://osgug.ucaiug.org/sghsystems/OpenADR/Shared%20Documents/Services/OpenSG%20OpenADR%20SD%20-%20WS%20r0.91.doc>
- 220

221 **1.5 Namespace**

222 The XML namespace [XML-ns] URI that MUST be used by implementations of this specification is:

223 <http://docs.oasis-open.org/ns/energyinterop>

224 Dereferencing the above URI will produce the Resource Directory Description Language [RDDL 2.0] document that describes this namespace.

226 Table 1 lists the XML namespaces that are used in this specification. The choice of any namespace prefix is arbitrary and not semantically significant.

228 *Table 1-1: Namespaces Used in this Specification*

Prefix	Namespace
xs	<a href="http://www.w3.org/2001/XMLSchema">http://www.w3.org/2001/XMLSchema</a>
gml	<a href="http://www.opengis.net/gml/3.2">http://www.opengis.net/gml/3.2</a>

xcal	urn:ietf:params:xml:ns:icalendar-2.0
strm	urn:ietf:params:xml:ns:icalendar-2.0:stream
emix	http://docs.oasis-open.org/ns/emix/2011/06
power	http://docs.oasis-open.org/ns/emix/2011/06/power
resource	http://docs.oasis-open.org/ns/emix/2011/06/power/resource
ei	http://docs.oasis-open.org/ns/energyinterop/201110
enrl	http://docs.oasis-open.org/ns/energyinterop/201110/enroll
pyld	http://docs.oasis-open.org/ns/energyinterop/201110/payloads
wsdl	http://docs.oasis-open.org/ns/energyinterop/201110/wsdl

229 The normative schemas for EMIX can be found linked from the namespace document that is located at  
230 the namespace URI specified above.

## 231 1.6 Naming Conventions

232 This specification follows some naming conventions for artifacts defined by the specification, as follows:

233 For the names of elements and the names of attributes within XSD files, the names follow the  
234 lowerCamelCase convention, with all names starting with a lower case letter. For example,

```
235 <element name="componentType" type="ei:ComponentType"/>
```

236 For the names of types within XSD files, the names follow the UpperCamelCase convention with all  
237 names starting with a lower case letter prefixed by "type-". For example,

```
238 <complexType name="ComponentServiceType">
```

239 For the names of intents, the names follow the lowerCamelCase convention, with all names starting with  
240 a lower case letter, EXCEPT for cases where the intent represents an established acronym, in which  
241 case the entire name is in upper case.

242 An example of an intent that is an acronym is the "SOAP" intent.

## 243 1.7 Editing Conventions

244 For readability, element names in tables appear as separate words. The actual names are  
245 lowerCamelCase, as specified above, and as they appear in the XML schemas.

246 All elements in the tables not marked as "optional" are mandatory.

247 Information in the "Specification" column of the tables is normative. Information appearing in the note  
248 column is explanatory and non-normative.

249 All sections explicitly noted as examples are informational and are not to be considered normative.

## 250 1.8 Architectural Background

251 Energy Interoperability defines a service-oriented approach to energy interactions. Accordingly, it  
252 assumes a certain amount of definitions of roles, names, and interaction patterns. This document relies  
253 heavily on roles and interactions as defined in the OASIS Standard *Reference Model for Service Oriented*  
254 *Architecture [SOA-RA]*.

255 Service orientation focuses on the desired results rather than the requested processes. Service  
256 orientation complements loose integration. Service orientation organizes distributed capabilities that may  
257 be in different ownership domains.


258 The SOA paradigm concerns itself with visibility, interaction, and effect. Visibility refers to the capacity for  
259 those with needs and those with capabilities to be able to see each other. Interaction is the activity of

260 using a capability. A service provides a decision point for any policies and transactions without delving  
261 into the process on either side of the interface

262 Services are concerned with the public actions of each interoperating system. Service interactions  
263 consider private actions, e.g., those on either side of the interface, to be inherently unknowable by other  
264 parties. A service is used without needing to know all the details of its implementation. Services are  
265 generally paid for results, not effort.

266 While loosely coupled, it is important to understand some typical message exchange patterns to  
267 understand how business processes are tied together through an SOA. [SOA-RA] Section 4.3.2.1  
268 describes how message exchange patterns (MEP) are leveraged for this purpose. While [SOA-RA]  
269 describes two types of MEPs, event notification and request response it also notes that, "This is by no  
270 means a complete list of all possible MEPs used for inter- or intra-enterprise messaging".

271 Three types of MEPs can inform the discussion on ~~energy-interop~~Energy Interoperation integration; a one  
272 way MEP, which differs somewhat from an event notification MEP in that no response is required or  
273 expected from the service provider, although the service consumer may receive appropriate http  
274 messages, e.g. 404 error.

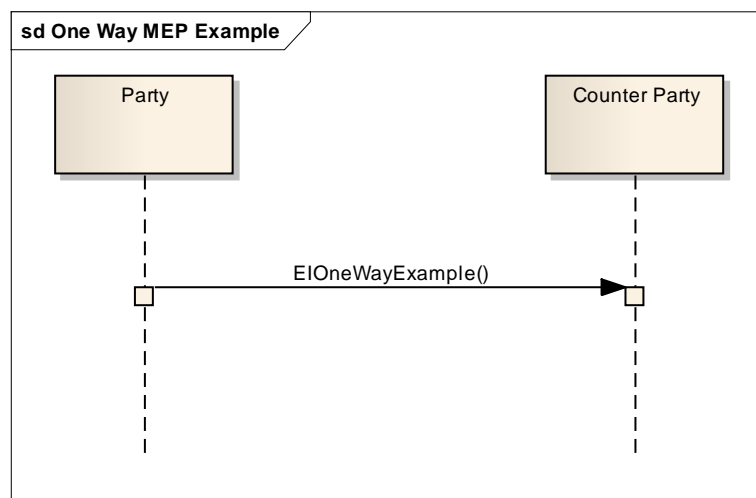


275

276 *Figure 1-2: One-way MEP where no return is expected*

277 Additionally a two-way MEP and a callback MEP are specific types of request/response MEPs described  
278 in [SOA-RA] that are used in Energy Interoperation. A two way MEP exchange pattern assumes that after  
279 a service is consumed an acknowledgement is sent. This acknowledgement is made up of the message  
280 header of the returning service, and may include a standardized acknowledgement payload, i.e., for  
281 capturing errors, (or no errors if the service was called successfully).

282 The callback MEP is similar to the request/response pattern described in [SOA-RA] except that it is more  
283 specific. In a callback MEP the service provider will send an acknowledgement upon receiving a request.  
284 However, once the service provider completes the corresponding business process, it will become a  
285 service consumer, by calling a service of the previous consumer, where it turn it will receive its own  
286 acknowledgement.

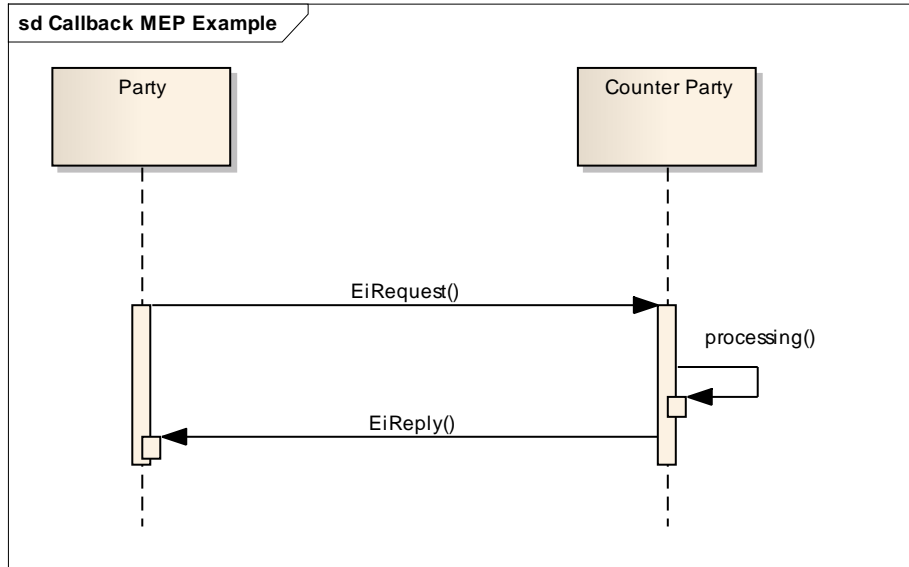


287

288 *Figure 1-3: Callback MEP where a service provider sends an acknowledgement to the service consumer, performs a*  
 289 *corresponding activity to act on the service request, then in turn makes a service request to the original initiating*  
 290 *service consumer and receiving an acknowledgement in return.*

291 *Note: Acknowledgements are normally shown as a dashed arrow return but have been omitted from the figures of*  
 292 *this specification for brevity. Appropriate returns should be assumed.*

293 **Most**While most figures that illustrate a service interaction assume a PUSH paradigm, ~~however~~ that is not  
 294 a requirement. A PULL paradigm may also be employed using ~~energy interop~~Energy Interoperation  
 295 services. However, the PULL pattern differs slightly. A request is made, responded to, and then once the  
 296 requestor has the information required, then it acts using a final operation as shown in the following  
 297 figure.

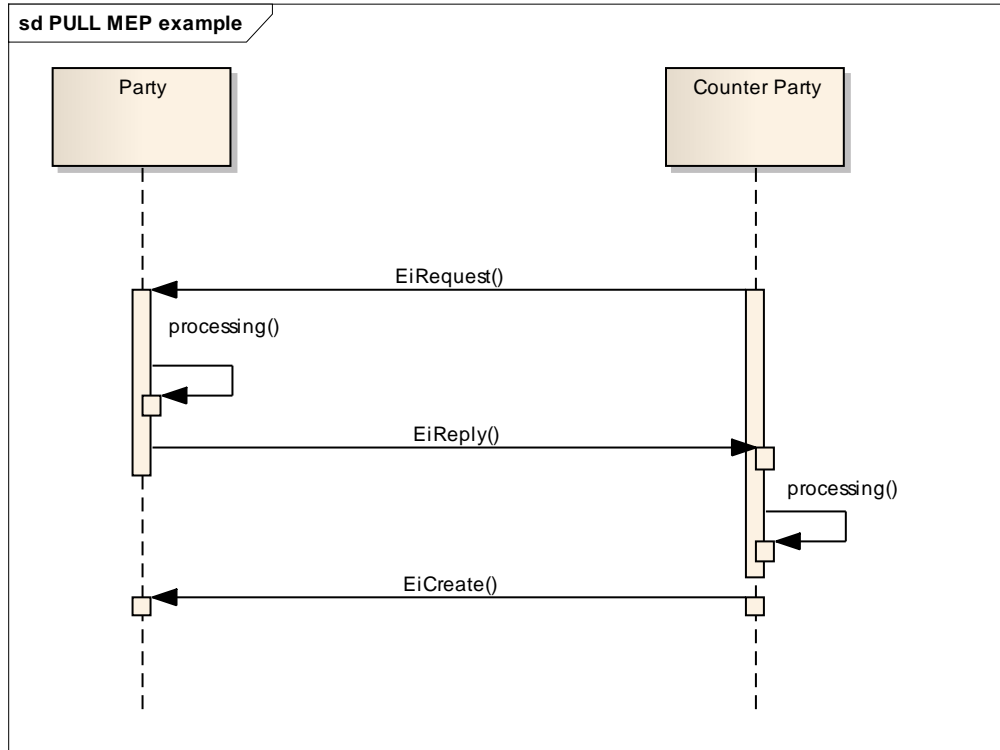

298

299 *Figure 1-4: PULL MEP where a request is made, responded to, processed and then acted upon. Nominally this could*  
 300 *be considered a combination of a callback MEP, followed by a two-way MEP*

301 Loose integration using the SOA style assumes careful definition of security requirements between  
 302 partners. Size of transactions, costs of failure to perform, confidentiality agreements, information  
 303 stewardship, and even changing regulatory requirements can require similar transactions be expressed  
 304 within quite different security contexts. It is a feature of the SOA approach that security is composed in to  
 305 meet the specific and evolving needs of different markets and transactions. Security implementation must  
 306 be free to evolve over time and to support different needs. Energy Interoperation allows for this  
 307 composition, without prescribing any particular security implementation.

---

## 308 2 Overview of Energy Interoperation

### 309 2.1 Scope of Energy Interoperation

310 Energy Interoperation (EI) supports the following:

- 311 • Transactive Energy
- 312 • Distribution of dynamic and contract prices
- 313 • Demand response approaches ranging from dispatch of load resources to price levels embedded
- 314 in an event.
- 315 • Measurement and confirmation of response.
- 316 • Projected price, demand, and energy

317 EI engages Distributed Energy Resources (DER) while making no assumptions as to their processes or  
318 technology.

319 While this specification supports agreements and transactional obligations, this specification offers  
320 flexibility of implementation to support specific programs, regional requirements, and goals of the various  
321 participants including the utility industry, aggregators, suppliers, and device manufacturers.

322 It is not the intent of the Energy Interoperation Technical Committee to imply that any particular  
323 agreements are endorsed, proposed, or required in order to implement this specification. Energy market  
324 operations are beyond the scope of this specification although the interactions that enable management  
325 of the actual delivery and acceptance are within scope. Energy Interoperation defines interfaces for use  
326 throughout the transport chain of electricity as well as supporting today's intermediation services and  
327 those that may arise tomorrow.

### 328 2.2 Specific scope statements

329 Interaction patterns and service definitions to support the following are in scope for Energy Interoperation:

- 330 • Market communications to support transactive energy. (see [T**Ee**MIX])
- 331 • Specific offerings by end nodes to alter energy use.
- 332 • Measurement and confirmation of actions taken, including but not limited to curtailment,  
333 generation, and storage, including load and usage information, historical, present, and projected.
- 334 • Notifications requesting performance on transactions offered or executed.
- 335 • Information models for price and product communication.
- 336 • Service definitions for Energy Interoperation

337 The following are out of scope for Energy Interoperation:

- 338 • Requirements specifying the type of agreement, or tariff used by a particular market.
- 339 • Validation and verification of performance, except for feedback on curtailment and generation.
- 340 • Communication (e.g. transport method) other than Web services to carry the messages from one  
341 point to another. The messages specified in Energy Interoperation can be transmitted via a  
342 variety of transports.

### 343 2.3 Goals & Guidelines for Signals and Price and Product 344 Communication

- 345 1. There are at least four market types, and signals and price and product standardization must  
346 support all four, while allowing for the key differences that exist and will continue to exist in them.  
347 The four market types are:
  - 348 • no open wholesale and no retail competition

- 349 • open wholesale market only
  - 350 • open retail competition only
  - 351 • open wholesale and open retail competition-
- 352 2. Wholesale market DR signals and price and product communication have different characteristics
  - 353 than retail market DR signals and price and product communication, although Energy
  - 354 Interoperation defines a commonality in format.
  - 355 3. It is likely that most end users, with some exceptions among Commercial and Industrial (C&I)
  - 356 customers, will not interact directly with wholesale markets.
  - 357 4. Retail pricing models are complex, due to the numerous tariff rate structures that exist in both
  - 358 regulated and un-regulated markets. Attempts to standardize DR control and pricing signals must
  - 359 not hinder regulatory changes or market innovations when it comes to future tariff or pricing
  - 360 models.
  - 361 5. New business entities such as Energy Service Providers (ESP), Demand Response Providers
  - 362 (DRP), DR Aggregators, and Energy Information Service Providers (EISP), will play an increasing
  - 363 role in DR implementation. Energy Interoperation supports these and new as yet unnamed
  - 364 intermediation services.
  - 365 6. DER may play an increasingly important role in DR, yet the development of tariff and/or pricing
  - 366 models that support DER's role in DR are still in early stages of development.
  - 367 7. The Customer's perspective and ability to react to DR control and price signals must be a key
  - 368 driver during the development of standards to support DR programs.

369 In addition, it is the policy of the Energy Interoperation Technical Committee that:

- 370 8. Where feasible, customer interfaces and the presentation of energy information to the customer
- 371 should be left in the hands of the market, systems, and product developers enabled by these
- 372 specifications.

373 The NAESB Smart Grid Committee **[NAESB-SG]** provided guidance on the Demand Response and the

374 electricity market customer interactions, as a required input under NIST Smart Grid Priority Action Plan 9

375 (PAP09). Energy Interoperation relied on this guidance. The service and class definitions relied on the

376 information developed to support the NAESB effort in the wholesale **[IRC]** and retail **[OpenSG]** markets.

## 377 2.4 Scope of Energy Interoperation Communications

378 While the bulk of examples describe the purchase of real power, emerging energy markets must

379 exchange economic information about other time-sensitive services.

380 For example, delivery of power is often constrained by delivery bottlenecks. The emergence of distributed

381 generation and Plugin Electric Vehicles (PEV) will exacerbate this problem. EMIX includes product

382 definitions for tradable congestion charges and transmission rights. Locational market prices in

383 distribution may come to mirror those already seen in transmission markets.

384 Other services address the direct effects of distribution congestion, including phase imbalances, voltage

385 violations, overloads, etc.

386 These markets introduce different market products, yet the roles and interactions remain the same.

387 Intelligent distribution elements, up to an intelligent transformer take roles in these interactions.

388 A description of the tariffs or market rules to support these interactions is outside the scope of this

389 specification. However, interaction patterns in this specification are defined to provide additional

390 information for markets in which tariffs or market rules are required.

## 391 2.5 Collaborative Energy [Not Normative]

392 Collaborative Energy, in this specification, refers to the transactions and management of energy using

393 collaborative approaches, including but not limited to markets, requests for decrease of net demand,

394 while addressing the business goals of the respective parties in arms-length interactions.



395 Transactive energy describes the established process of parties buying and selling energy based on  
396 tenders (buy or sell offers) that may lead to transactions among parties. In open wholesale forward  
397 energy markets, a generator may tender a quantity of energy at a price over a future delivery interval of  
398 time to a customer. Acceptance of a tender results in a binding transaction. In some cases, the  
399 transaction requires physical delivery of energy. In other cases, the transaction is settled for cash at a  
400 price determined by a prescribed price index. The use of Energy Interoperation to enable present and  
401 future wholesale and retail energy markets and retail tariffs, including dynamic and multi-part tariffs is  
402 described in [EMIX]. This section reviews the generic roles and interactions of parties involved in energy  
403 transactions.

404 In this specification, the information exchanged and the services needed to implement smart energy are  
405 defined.

406 Today's markets are not necessarily tomorrow's. Today's retail markets have grown up around conflicting  
407 market restrictions, tariffs that are contrary to the goals of Collaborative Energy, and historical practices  
408 that pre-date automated metering and e-commerce. Today's wholesale market applications, designed,  
409 built and deployed in the absence of standards, has resulted in little or no interchangeability among  
410 vendor products, complex integration techniques, and duplicated product development. The Technical  
411 Committee opted to avoid direct engagement with these problems. Energy Interoperation aims for future  
412 flexibility while it addresses the problems of today.

413 While the focus today is on on-demand load reduction, on-demand load increase is just as critical for  
414 Collaborative Energy interactions. Any large component of intermittent energy sources will create  
415 temporary surpluses as well as surfeits. Interactions between different smart grids and between smart  
416 grids and end nodes must maximize load shifting to reflect changing surpluses or shortages of electricity.  
417 Responsibilities and benefits must accrue together to the participants most willing and able to adapt.

418 The Committee, working with the [EMIX] Technical Committee developed a component model of an  
419 idealized market for electricity transactions. This model assumes timely automated interval metering and  
420 an e-commerce infrastructure. T~~E~~eMIX describes electricity in this normal market context. This model was  
421 explained in the [T~~E~~eMIX] paper, an approved work product of the EMIX committee. Using the  
422 components in this model, the authors were then able to go back and simulate the market operations of  
423 today.

424 Energy Interoperation supports four essential market activities:

- 425 1. There is an **indication of interest** (trying to find tenders to buy or sell) when a Party is seeking  
426 partner Parties for a demand response transaction or for an energy source or sale.
- 427 2. There is a **tender** (offer or bid) to buy or sell a service, e.g. production of energy or curtailment of  
428 use.
- 429 3. There is a **transaction** to purchase or supply, generally from the acceptance of a tender.
- 430 4. For some transactions, such as Demand Response, there is an **execution** for delivery of the  
431 subject of a transaction at the agreed-upon price, time, and place.

432 Version 1.0 of Energy Interoperation does not define the critical fifth market activity, **measurement and**  
433 **verification** (M&V). A NAESB task force (Demand Side Management and Energy Efficiency Working  
434 Groups) is continuing work to define the business requirements for M&V.

435 Other business models may combine services in novel ways. An aggregator can publish an indication of  
436 interest to buy curtailment at a given price. A business willing to respond would offer an agreement to  
437 shed load for a specific price. The aggregator may accept some or all of these offers. The performance in  
438 this case could be called at the same time as the tender acceptance or later.

439 Communication of price in transactions is at the core of the Energy Interoperation services. Five types of  
440 prices are identified in this specification:

- 441 1. **Priced Offer**: a forward offer to buy or sell a quantity of an energy product for a specified future  
442 interval of time, the acceptance of which by a counterparty results in a binding agreement. This  
443 includes tariff priced offers where the quantity may be limited only by the service connection and  
444 DR prices.

- 445 2. Ex-Post Price: A price assigned to energy purchased or sold that is calculated or assigned after  
446 delivery. Price may be set based on market indices, centralized market clearing, tariff calculation  
447 or any other process.
- 448 3. Priced Indication of Interest: the same as a Priced Offer except that no binding agreement is  
449 immediately intended.
- 450 4. Historical Price: A current price, past transaction price, past offered price, and statistics about  
451 historical price such as high and low prices, averages and volatility.
- 452 5. Price Forecast: A forecast by a party of future prices that are not a Priced Indication of Interest or  
453 Priced Offer. The quality of a price forecast will depend on the source and future market  
454 conditions

455 A grid price service is able to answer the following sorts of questions:

- 456 1. What is the price of Electricity now?  
457 2. What will it be in 5 minutes?  
458 3. What price will electricity have for each hour of the day tomorrow? What is the confidence level  
459 about these predictions?  
460 4. What will it be at other times in the future?  
461 5. What was the highest or lowest price for electricity in the last day? Month? Year?  
462 6. What was the high price for the day the last time it was this hot?

463 Each answer carries with it varying degrees of certainty. The prices may be fixed by contracts or tariffs  
464 that change infrequently if at all. The prices may be fixed tariffs, "unless a DR event is called." The prices  
465 may even represent wild guesses about open markets. With a standardized price service, technology  
466 providers can develop solutions to help grid operators and grid customers manage their energy use  
467 portfolios.

468 This specification also encompasses Emergency or "Grid Reliability" events. Grid Reliability events  
469 require mandatory participation in today's markets. These events are described as standing pre-executed  
470 option agreements. A grid operator need merely call for performance as in any other event.

## 471 **2.6 Assumptions**

### 472 **2.6.1 Availability of Interval Metering**

473 Energy Interoperation for many actions presumes a capability of interval metering where the interval  
474 might be smaller than the billing cycle. Intervals are typically one hour or less. Interval metering may be  
475 required for settlement or operations for measurement and verification of curtailment, distributed energy  
476 resources, and for other Energy Interoperation interactions.

### 477 **2.6.2 Use of EMIX**

478 This specification uses the OASIS Energy Market Information Exchange [EMIX] to communicate product  
479 definitions, quantities, and prices. EMIX provides a succinct way to indicate how prices, quantities, or both  
480 vary over time.

### 481 **2.6.3 Use of WS-Calendar**

482 This specification uses the OASIS [WS-Calendar] specification to communicate schedules and intervals.  
483 WS-Calendar is the standard under the NIST Smart Grid Roadmap for all such communication.

484 WS-Calendar expresses a general approach to communications of sequences and schedules, and their  
485 gradual complete instantiation during the transactive process. Despite its name, WS-Calendar does not  
486 require that communications use web services.

#### 487 **2.6.4 Energy Services Interface**

488 The Energy Services Interface (ESI) is the external face of the energy-consuming node. The ESI may be  
489 directly on an energy management system in the end node, or it may be mediated by other business  
490 systems. The ESI is the point of communication whereby the entities (e.g. utilities, ISOs) that produce and  
491 distribute electricity interact with the entities (e.g. facilities and aggregators) that manage the consumption  
492 of electricity. An ESI may be in front of one system or several, one building or several, or even in front of  
493 a microgrid.

494 This work assumes that there is no direct interaction across the ESI.

---

## 495 3 Energy Interoperation Architecture

496 The following sections provide an overview of the interaction structure, and define the roles and actors in  
497 electricity markets. Later sections will define the interactions more carefully as services. The section first  
498 addresses Transactive Energy Interactions and then addresses Event Interactions for Demand and  
499 Generation Resources.

500 The Energy Interoperation (EI) architecture describes interactions between pairs of actors, and, in a  
501 deployment, relationships are established among actors. Actors may perform in ~~a~~ chains of pairs of  
502 actors.

### 503 3.1 Transactive Energy Interactions

504 Transactive Energy refers to the communication of prospective and completed transactions of energy  
505 whether market-based, bilateral or, contract-, agreement-, or tariff-based, and whether of energy or  
506 options on energy. The terminology used by Transactive Energy is most evident today in the buying and  
507 selling of wholesale energy in bilateral and exchange transactions. This section reviews and interactions  
508 of Parties involved in energy transactions.

509 The actor for all Transactive EI interactions is a Party. A Party can be an end-use customer, a generator,  
510 a retail service provider, a demand response provider, a marketer, a distribution system operator, a  
511 transmission system operator, a system operator such as an ISO or RTO, a microgrid operator, or any  
512 party engaging in transactions for energy or the transport of energy.

513 Parties may participate in interactions concurrently as well as over time. In theory, any Party can transact  
514 with any other Party subject to applicable regulatory restrictions. In practice, markets will establish  
515 interactions between Parties based on regulation, convenience, economics, credit, network structure,  
516 locations, and other factors.

#### 517 3.1.1 Transaction Side

518 A Party can take one of two Sides in a given Transaction:

- 519 • Buy, or
- 520 • Sell

521 At any moment, a Party has a position resulting from any previous Transactions. A Party selling power  
522 relative to its current position takes the **BuySell** Side of the Transaction. A Party buying power relative to  
523 its current position takes the **SellBuy** Side of the Transaction.


524 A generator typically takes the Sell Side of a Transaction, but can also take the Buy Side of a  
525 Transaction. A generator may take the Buy Side of a **BuyerTransaction** in order to reduce generation  
526 because of a change in generator or market conditions.

527 An end-use customer typically takes the Buy Side of a Transaction, but if tendered an attractive price may  
528 curtail usage and thereby take the Sell Side of a Transaction.

529 A distributed generator also can take the Side of Buyer or Seller in a Transaction. For example, if a  
530 distributed generator sells 2 MW for an hour forward of a given interval, it may decide to buy back all or a  
531 portion of the 2 MW for that hour if the price is low enough. A distributed storage device may take the Buy  
532 side of a Transaction to store energy and the Sell Side of **Buyer in** a Transaction at a different time to  
533 release energy from storage.

#### 534 3.1.2 Transactive Interactions among Parties

535 Parties may interact using Tenders for Transactions as illustrated in Figure 3-1.

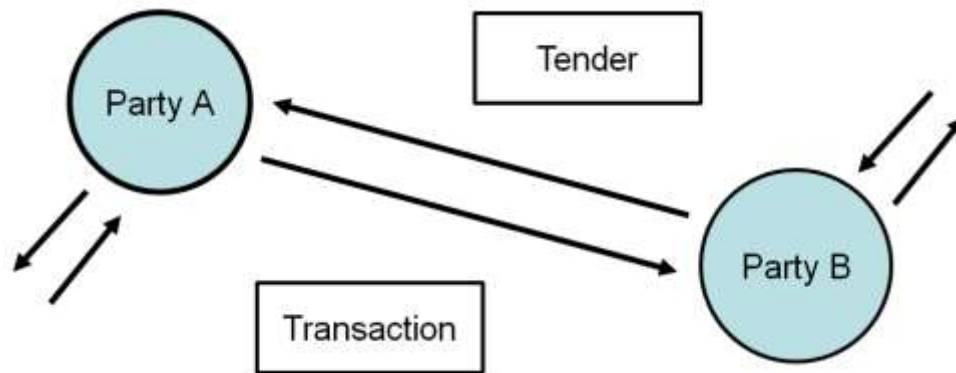

536  
537 *Figure 3-1: Parties Interacting Using Tenders for Transactions*

538 Suppose Party B takes the Buy Side in initiating a Tender to a CounterParty, Party A. Party A has the  
539 Sell Side of that Tender. If the Tender is accepted by Party A, Party A takes the Sell Side and Party B  
540 takes the Buy Side of the Transaction.

541 Any Party can initiate a Tender to any CounterParty and take on either the Buy or Sell Side. The  
542 CounterParty can accept or reject Tenders from Parties and itself initiate Tenders as Party to any  
543 CounterParty to the extent allowed by market rules and regulations.

544 Two parties can also engage in an option Transaction. An option is a promise granted by a Party (Option  
545 Writer) to a CounterParty (Option Holder) usually for a premium payment. The Option Holder is granted a  
546 right to invoke specific Transactions for energy that the Option Writer promises to deliver. Demand  
547 response, ancillary services, and price cap Transactions are forms of options. Any Party may take the  
548 Buy Side or Sell Side of a Tender for an option Transaction acting either as the Holder or Writer of  
549 the option.

### 550 **3.1.3 Retail Service Interactions**

551 Retail Customers interact with either tariffed cost-of-service retail providers or competitive retail providers  
552 with various service plans. Either way the price of the service must be clearly communicated to the  
553 customer. With the introduction of interval metering and dynamic pricing, clear communication of price  
554 and the purchasing decisions by customers is essential.

555 EI provides services to communicate both the tendered prices by retailers to customers and the purchase  
556 transactions by customers. Customers with distributed energy resources (DER) or storage may often be a  
557 seller to retailer or other parties. Transactions may also include call options on customers by a retailer to  
558 reduce deliveries and call options by customers on a retailer to provide price insurance.

### 559 **3.1.4 Wholesale Power Interactions**

560 Retail Energy Providers, Aggregators, Power Marketers, Brokers, Exchanges, System Operators and  
561 Generators all interact in the wholesale market for deliveries on the high voltage transmission grid.  
562 Transactions include forward transactions for delivery, near-real time transaction and cash settled futures  
563 transactions for hedging risks.

564 EI mirrors the tender and transaction interaction patterns of open forward wholesale power markets. Near  
565 real-time wholesale markets for resources provided by independent system operators are also provided  
566 for in EI design ~~with work ongoing~~.

### 567 **3.1.5 Transport Interactions**

568 Transmission and Distribution services transport energy from one location to another. Transport is the  
569 common term used by EI and EMIX to refer to both Transmission and Distribution. Prices for Transport  
570 are dynamic and need careful communication. EI models tenders and transactions for Transport products  
571 using the same interactions as for Energy products.

572 EI makes no assumptions about how prices for Transport are determined.

## 573 3.2 Event Interactions for Demand and Generation Resources

574 In partial contrast to the transactive model described above, another common interaction model is based  
575 on event-based dispatch of resources by Parties. Resources include both generation resources and  
576 curtailment resources. Curtailment resources provide reductions in delivery to a customer from a baseline  
577 amount; such resources are typically treated as generation resources, usually in the context of events  
578 where shortages may occur. Curtailment resources are also called demand response (DR) resources. For  
579 DR resources the determination of the baseline is outside the scope of EI.

### 580 3.2.1 VTN and VEN Party Roles

581 Similar to the Party interactions of transactive energy, event interactions also have an interoperation  
582 model between two or more Actors. One designated Actor (for that given interaction) is called the **Virtual  
583 Top Node (VTN)** and the remaining one or more actors are called **Virtual End Node(s), or VEN(s)**<sup>1</sup>.

584 Parties may participate in many interactions concurrently as well as over time. For example, a particular  
585 Actor may participate in multiple Demand Response programs, receive price communication from multiple  
586 sources, and may in turn distribute signals to additional sets of Parties.

587 The VTN / VEN Interactions combine and compose multiple sets of pairwise interactions to implement  
588 more complex structures. By using simple pairwise interactions, the computational and business  
589 complexity for each set of Parties is limited, but the complexity of the overall interaction is not limited.


590 The VTN and VEN Roles are useful beyond event-based interactions because they provide stereotyping  
591 of a wide range of behaviors and interactions in energy markets.

### 592 3.2.2 VTN/VEN Interactions

593 In this section the terminology for roles in VTN/VEN Energy Interoperation interaction patterns is clarified.  
594 The description and approach is consistent with the Service-Oriented Architecture Reference Model  
595 **[SOA-RM]**. The role of a Party as a VTN or VEN only has meaning within the context of a particular  
596 service interaction.

597 At this level of description the presence of application level acknowledgement of invocations is ignored,  
598 as reliable and confirmed delivery would typically be implemented by composition with **[WS-RM]**, **[WS-  
599 Reliability]**, **[WS-SecureConversation]** or a similar mechanism. For similar reasons, an actual  
600 deployment would compose the necessary security, e.g., **[WS-Security]**, **[SAML]**, **[XACML]**, or **[WS-  
601 SecureConversation]**. See Section 13 for a discussion of compositional security.

602 At this level the typical push or pull patterns for interactions are also ignored but are covered in later  
603 sections.

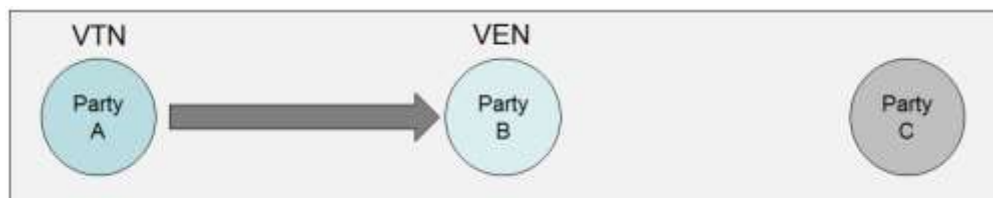


604  
605 *Figure 3-2: Example DR Interaction One*

606 In Figure 3-2, Party A is the VTN with respect to Party B, which acts as the VEN in this interaction. Party  
607 C is not a party to this interaction.

608 Subsequently, as shown Figure 3-3, Party B may act as the VTN for an interaction with Party C, which is  
609 acting as the VEN for interaction two. Party A is not a party to this interaction.


---

<sup>1</sup> We are indebted to EPRI for the Virtual End Node term [EPRI]

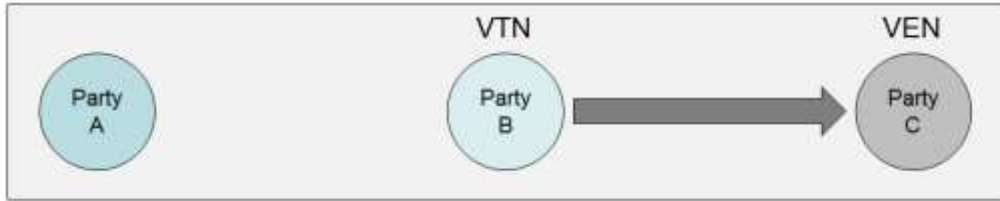


610  
611 *Figure 3-3: Example DR Interaction Two*

612 Moreover, the directionality and the roles of the interaction can change as shown in Figure 3-4.  
613 Again, Party A is not a party to this interaction, but now Party C is the VTN and Party B is the VEN.

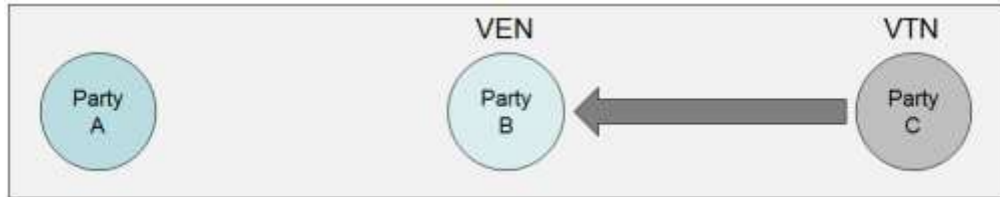

614  
615 *Figure 3-4: Example DR Interaction Three*

616 There is no hierarchy implied by these examples. The examples are used to show how the pairwise  
617 interaction patterns and the respective roles that entities play can be composed in ways that are limited  
618 only by business needs and feasibility, and not by the architecture. From these simple interactions, one  
619 can construct more complex interactions such as those shown in Figure 3-5.

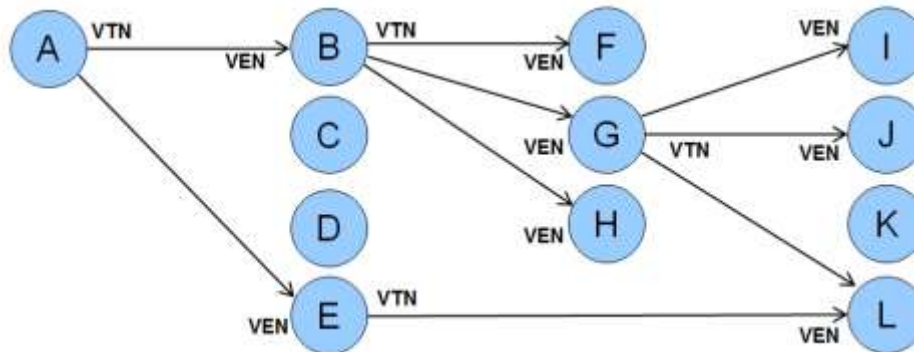

620  
621 *Figure 3-5: Web of Example DR Interactions*

622 In this figure, certain Parties (B, E, and G) act as both VTN and VEN. This directed graph with arrows  
623 from VTN to its VENs could model a Reliability DR Event initiated by the Independent System Operator<sup>2</sup>  
624 A who would invoke an operation on its second level VTNs B-E, which could be a group of aggregators.  
625 The second level VTN B, in turn invokes the same service on its VENs FGH, who may represent their  
626 customers or Transactive resources. Those customers might be industrial parks with multiple facilities,  
627 real estate developments with multiple tenants, or a company headquarters with facilities in many  
628 different geographical areas, who would invoke the same operation on their VENs.

629 Each interaction can have its own security and reliability composed as needed—the requirements vary for  
630 specific interactions.

631 The following table has sample functional names for selected nodes. (*Note: wrt means “with respect to”*)

632 *Table 3-1: Interactions and Actors*

<sup>2</sup> Using North American Terminology.


Label	Structure Role	Possible Actor Names
<b>A</b>	VTN	System Operator, DR Event Initiator, Microgrid controller, landlord
<b>B</b>	VEN (wrt A), VTN (wrt F, G, H)	Aggregator, microgrid element, tenant, floor, building, factory
<b>G</b>	VEN (wrt B), VTN (wrt I, J, L)	Microgrid controller, building, floor, office suite, process controller, machine
<b>L</b>	VEN (wrt G and wrt E)	Microgrid element, floor, HVAC unit, machine

633 **3.2.3 VTN/VEN Roles and Services**

634 Two structured roles have been defined for each interaction, the Virtual Top Node (VTN) and the Virtual  
635 End Node (VEN). A **VTN** has one or more associated **VENs**.<sup>3</sup>

636 Considering service interactions for Energy Interoperation, each **VTN** may invoke services implemented  
637 by one or more of its associated **VENs**, and each **VEN** may invoke services implemented by its  
638 associated **VTN**.

639 In later sections abstract services that address common transactions are detailed; Demand Response,  
640 price distribution, and other use cases.

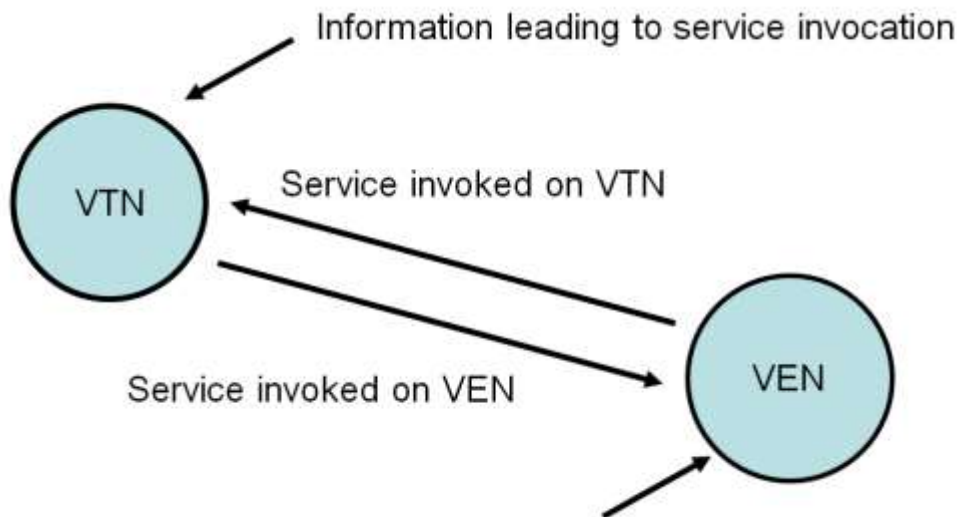

641 **Information leading to service invocation**

642 *Figure 3-6: Service Interactions between a VTN and a VEN*

643 The interacting pairs can be connected into a more complex structure as shown in Figure 3-5.

644 The relationship of one or more **VENs** to a **VTN** mirrors common configurations where a VTN (e.g. an  
645 aggregator) has many VENs (say its resources under contract) and each VEN works with one VTN for a  
646 particular interaction.<sup>4</sup>

<sup>3</sup> The case of a VTN with zero VENs may be theoretically interesting but has little practical value, hence in a later section VENs having cardinality 1..n are described

<sup>4</sup> The model allows e.g. Demand Resources to participate in more than one interaction, that is, in more than one Demand Response program or offer or with more than one aggregator.



647 Second, as we have seen, each **VEN** can implement the **VTN** interface for another interaction.  
 648 Third, the pattern is recursive as shown above in Figure 3-3 and allows for more complex structures.<sup>5</sup>  
 649 Finally, the Parties of the directed interaction graph can be of varying types or classes. In a Reliability DR  
 650 Event, a System Operator as a VTN may initiate the event with the service invoked on its next level  
 651 (highest) VENS, and so forth. But the same picture can be used to describe many other kinds of  
 652 interaction, e.g. interactions to, from, or within a microgrid **[Galvin]**, price and product definition  
 653 distribution, or distribution and aggregation of projected load and usage.  
 654 In some cases the structure graph may permit cycles, in others not.


### 655 3.2.4 Demand Response Interactions

656 In this section the interaction patterns of the services for demand response respectively invoked by an  
 657 **VTN** on one or all of its associated **VENs** and vice versa, are described. Figure 3-6: above shows the  
 658 generic interaction pattern; Figure 3-7 below is specific to Demand Response Events.

659 By applying the recursive definitions of VTN and VEN specific services will be defined in the following  
 660 sections (See Figure 3-7)

661 The VTN invokes operations on its VENs such as Initiate DR Event and Cancel DR Event, while the VEN  
 662 invokes operations on its VTN such as Create Tender and Create Feedback.

663 Note not all DR works this way. A customer may be sent a curtailment tender by the DR provider with a  
 664 price and then can decide to respond. If the customer has agreed to a capacity payment then there may  
 665 be a loss of payments if he does not respond.

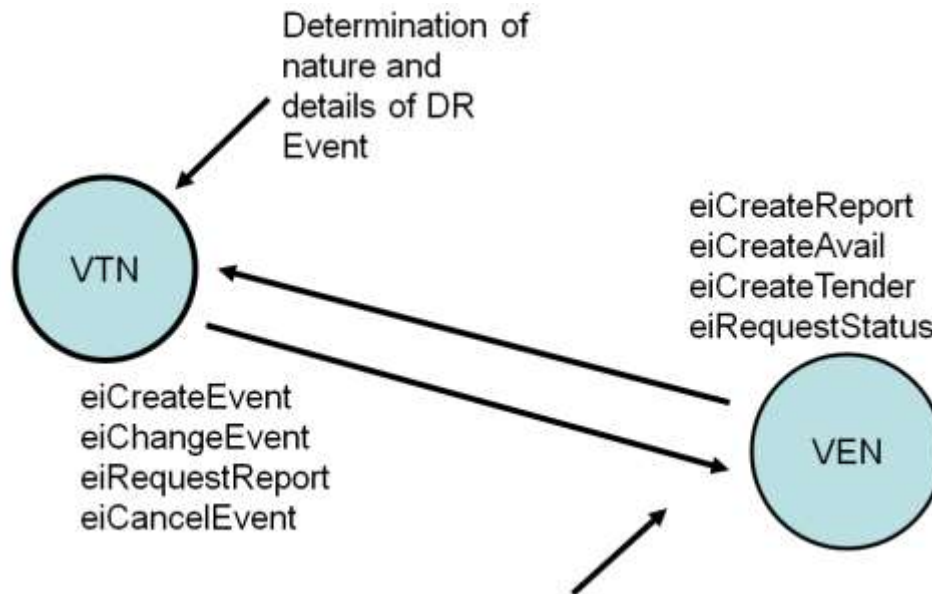

666  
 667 *Figure 3-7: Demand Response Interaction Pattern Example*

### 668 3.3 Roles, Resources and Interactions (Non-Normative)

669 There are many deployments possible, including many not described here. The Committee has striven to  
 670 make Energy Interoperation agnostic about business processes or business relationships.

<sup>5</sup> For example, **[OpenADR1.0]** has four actors (the Utility, Demand Response Application Server, the Participant, and the Client (of the Participant)). The Energy Interoperation architecture maps clearly to the DRAS-Participant interface, and models the Participant-Client interface as an additional VTN-VEN relationship.

### 671 3.3.1 Choosing a Role

672 | An Actor finds, discovers, or is configured to use a particular Registrar. By using the EIR `ERegisterParty`  
673 | service, that `applicationActor` obtains a PartyID. With that PartyID, the `applicationActor` can implement  
674 | and interact using the Party Role in the Transactive Services.

675 | One interaction a Party may participate in is Enrollment. An application may, when it has a PartyID and is  
676 | identified, Enroll. There are a number of Enrollee Types, reflecting different business roles and  
677 | enrollments, which are out of scope for this specification—only the names are defined. An exception is  
678 | the Resource which extends the EMIX Resource Description Type.

679 | The information required for Enrollment varies across Enroll Administrators. For example in North  
680 | American wholesale markets, each ISO may potentially require different information or documentation  
681 | than another. Since that information is out of scope, a deployment or profile would specify what  
682 | information is required, and convey that information in an extension of the Enrollee types.

683 | Once Enrolled, a Party may have other capabilities, the definition and description of which is also out of  
684 | scope. The service operations supported are listed in Section 8 “*Enroll Service*”.

685 | The operations for Party Registration and Enrollment are designed, as are all other operations and data  
686 | types, to be both extensible and evolvable over time to add new or extended functionality to future  
687 | versions of Energy Interoperation, or by extension of information definitions in specific profiles.

### 688 3.3.2 The relationship between Actors and Resources

689 | There is no definitive way to classify an Actor, or a set of capabilities, as an Actor or a Resource. A VEN  
690 | that is also a VTN may bundle the VENS it interacts with to offer as Resources. In another business  
691 | model, that VEN may interact with its internal partners through transactive services. Different business  
692 | structures will drive different technical deployments.

693 | First, an Actor, representing application code, may assume the Virtual End Node (VEN) role. The same  
694 | application code may also support the Virtual Top Node (VTN) role. This is how the graph of VTNs and  
695 | VENs in Figure 3-5 is constructed. In that figure, Actor G implements the role of VEN with respect to Actor  
696 | B, and the role of VTN with respect to Actors I, J, and L.

697 | A Party interacts in transactive environments; the distinction is that a market may have many  
698 | relationships. While it might seem attractive to make the Actor that interacts with a market take on the  
699 | VEN role (with the market taking on the VTN role), this is too restrictive. An Actor `offer, viewoffers, views,`  
700 | and `transacts` regardless of the VEN/VTN relationships that it maintains--and so the transactive interfaces  
701 | use Party and CounterParty.

702 | In a deployment one must make decisions about how the roles are selected, discovered, or assigned; this  
703 | is out of scope of this specification.

704 | In contrast, a Resource is treated as a thing, rather than an Actor. A resource does not participate in  
705 | relationships such as the Actor/application interfaces in the figure. It could be tempting to require that a  
706 | Resource is related to (or possibly “managed by”) exactly one Actor, a VEN in the Energy Interoperation  
707 | architecture. It could seem clearest to assert a one-to-one relation between this VEN and the Resource.  
708 | This would allow requests, reports, and other interactions to and from a single VEN which is uniquely  
709 | related to that Resource.

710 | But other business cases would be simpler with potentially many Resources managed by a single VEN.  
711 | In a transactive environment, that VEN may offer capabilities of its individual or groups of Resources to a  
712 | market (as a Party), and without requiring the defined structure of collaborating VENs and VTNs.

713 | For example, a distributed application conforming to this specification MIGHT deploy in one of the  
714 | following ways:

- 715 | (a) assign a single Actor presenting the VEN role to each floor of a building, and a VTN related to  
716 | | them. For external interactions, that VTN for the building would present the VEN interface to  
717 | | receive and interact with the Energy Interoperation Services, and could present the Party role to  
718 | | tender, buy, and sell in a market,
- 719 | (b) assign a single Actor presenting the VEN role to the building controller, and use other services to  
720 | | manage or convey information to the floor controllers

721 (c) assign a single Actor presenting the VEN role at the building controller, have that same Actor  
722 present the VTN role to the individual floor controllers. The floor controllers present the VEN role  
723 to the building controller, while presenting the VTN role to its devices, each of which presents the  
724 VEN role to the floor controller.

725 Were this specification to require exactly one Resource to one VEN, such multiplicity of deployment  
726 would not be possible.

## 727 4 Message Composition & Services

728 Energy Interoperation relies on two other standards, Energy Market Information eXchange ([EMIX]) and  
729 [WS-Calendar] to express intents.

- 730 • EMIX describes price and product for electricity markets.
- 731 • WS-Calendar communicates schedules and sequences of operations.
- 732 • Energy Interoperation uses the vocabulary and information models defined by those  
733 specifications to describe many of the services that it provides.

### 734 4.1 WS-Calendar in Energy Interoperation

735 [WS-Calendar] defines how to use the semantics of the enterprise calendar communications within  
736 service communications. Energy Interoperation is conformant with the [WS-Calendar] specification for  
737 communicating duration and time to define a Schedule. [WS-Calendar] itself extends the well-known  
738 semantics of [RFC5545]. The communication of a commonly understood Schedule is essential to Energy  
739 Interoperation.

740 Energy Interoperation also relies on [EMIX], which defines schedules and types conforming to WS-  
741 Calendar. Energy Interoperation is conformant with the [WS-Calendar] specification for communicating  
742 duration and time to define a Schedule.

#### 743 4.1.1 Schedule Semantics from WS-Calendar (Non-Normative)

744 Without an understanding of certain terms defined in [WS-Calendar], the reader may have difficulty  
745 achieving complete understanding of their use in this standard. The table below provides summary  
746 descriptions of certain key terms from that specification. This specification does not redefine these terms;  
747 they are listed here solely as a convenience to the reader.

748 Table 4-1: Core Semantics from WS-Calendar

WS-Calendar Term	Description
<b>Component</b>	In [iCalendar], the primary information structure is a Component, also referred to as a “vcomponent.” A Component is refined by Parameters and can itself contain Components. Several RFCs have extended iCalendar by defining new Components using the common semantics defined in that specification. In the list below, Interval, Gluon, and Availability are Components. Duration, Link, and Relationship are Parameters. A Sequence is set of Components, primarily Intervals and Gluons, but is not itself a Type.
<b>Duration</b>	Duration is the length of time for an event scheduled using iCalendar or any of its derivatives. The [XCAL] eDuration is a data type using the string representation defined in the iCalendar ([RFC5545]) Duration.
<b>Interval</b>	The Interval is a single discrete segment, an element of a Sequence, and expressed with a Duration. The Interval is derived from the common calendar Components. An Interval is part of a Sequence.
<b>Sequence</b>	A set of Intervals with defined temporal relationships. Sequences may have gaps between Intervals, or even simultaneous activities. A Sequence is re-locatable, i.e., it does not have a specific date and time. A Sequence may consist of a single Interval, and can be scheduled by scheduling that single Interval in that Sequence.

WS-Calendar Term	Description
<b>Gluon</b>	A Gluon influences the serialization of Intervals in a Sequence, through inheritance and through schedule setting. The Gluon is similar to the Interval, but has no service or schedule effects until applied to an Interval or Sequence.
<b>Artifact</b>	The placeholder in an Component that holds that thing that occurs during an Interval. <b>[EMIX]</b> Product Descriptions populate Schedules as Artifacts inside Intervals. In Streams, this specification refers to the Payload conveyed by an Interval.
<b>Link</b>	A reference to an internal object within the same calendar, or an external object in a remote system. The Link is used by one <b>[WS-Calendar]</b> Component to reference another.
<b>Relationship</b>	Links between Components.
<b>Availability</b>	Availability in this specification refers to the Vavailability Component, itself a collection of recurring Availability parameters each of which expresses set of Availability Windows. In this specification, these Windows may indicate when an Interval or Sequence can be Scheduled, or when a partner can be notified, or even when it cannot be Scheduled.

749 Normative descriptions of the terms in the table above are in **[WS-Calendar]**.

## 750 4.1.2 Schedules and Inheritance

751 Nearly every response, every event, and every interaction in Energy Interoperation (with the exception of  
752 all single interval TeMIX profile interactions) can have payloads with values that vary over time, i.e., it  
753 is described using a sequence of intervals. Many communications, particularly in today's retail market,  
754 involve information about or a request for power delivered over a single interval of time. Simplicity and  
755 parsimony of expression must coexist with complexity and syntactical richness.

756 The simplest power description in **[EMIX]** is Transactive power. The simplest demand response is to  
757 reduce power. The power object in EMIX can include specification of voltage, and Hertz and quality and  
758 other features. There are market interactions where each **all** of those **are** necessary. Reduced to its  
759 simplest, though, the EMIX Power information consists of Power Units and Power Quantity: as in

Units:	KW	Quantity	10
--------	----	----------	----

760  
761 *Figure 4-1: Basic Power Object from EMIX*

762 At its simplest, though, WS-Calendar expresses repeating intervals of the same duration, one after the  
763 other, and something that changes over the course of the schedule

Start:	8:00	Duration:	1Hour		
		Duration:	1Hour		
		Duration:	1Hour		
		Duration:	1Hour		
		Duration:	1Hour		

764  
765 *Figure 4-2: WS-Calendar Partition, a simple sequence of 5 intervals*

766 The WS-Calendar specification defines how to spread an object like the first over the schedule. The  
767 information that is true for every interval is expressed once only. The information that changes during  
768 each interval, is expressed as part of each interval.\*

Units	KW	Start:	8:00	Duration:	1Hour	Quantity	10
				Duration:	1Hour	Quantity	10
				Duration:	1Hour	Quantity	15
				Duration:	1Hour	Quantity	25
				Duration:	1Hour	Quantity	10*

769

770 *Figure 4-3: Applying Basic Power to a Sequence*

771 Many communications communicate requirements for a single interval. When expressing market  
 772 information about a single interval, the market object (Power) and the single interval collapse to a simple  
 773 model:

Units	KW	Start:	8:00	Duration:	1Hour	Quantity	10
-------	----	--------	------	-----------	-------	----------	----

774

775 *Figure 4-4: Simplifying back to Power in a Single Interval*

776 WS-Calendar calls this pattern Inheritance and specifies a number of rules that govern Inheritance. Table  
 777 4-2 summarizes those terms defined in WS-Calendar to describe Inheritance that are used in this  
 778 specification as well. This specification does not redefine these terms; they are listed here solely as a  
 779 convenience to the reader.

780 *Table 4-2: WS-Calendar Semantics: Inheritance*

Term	Definition
<b>Lineage</b>	The ordered set of Parents that results in a given inheritance or execution context for a Sequence.
<b>Inherit</b>	A Child Inherits attributes (Inheritance) from its Parent.
<b>Inheritance</b>	A pattern by which information in Sequence is completed or modified by information from a Gluon. Information specified in one informational object is considered present in another that is itself lacking expression of that information.
<b>Bequeath</b>	A Parent Bequeaths attributes (Inheritance) to its Children.

781 This specification extends the use of Inheritance as defined in WS-Calendar. Most interactions specify a  
 782 schedule, whether for price Quote or for Demand Response event. These schedules are expressed in  
 783 Streams (see Section 4.3). Each Interval in the Schedule contains an information payload. Each of these  
 784 payloads is completed through inheriting information from the Stream as if from a Gluon. The Stream  
 785 itself inherits information from the context of the interaction, especially from the Market Context, as if from  
 786 [a](#) Gluon.

787 A Market Context Bequeaths essential information to a Stream, which in turn its information to each  
 788 Interval in the Stream. This specification uses this pattern of expression throughout.

### 789 4.1.3 Availability and Schedules

790 The WS-Calendar component Availability is used throughout Energy Interoperation. Availability expresses  
 791 recurring patterns of schedule within a bounded period of time. This specification uses Availability in  
 792 market definitions and in a number of inter-party commitments and communications. Availability is used to  
 793 define windows for Demand Response, to define when during a given day a Party may receive requests,  
 794 and for expressing the desire of a Party to place or remove services from markets.

795 While the expression of Availability is defined in WS-Calendar, the Committee recommends the  
 796 informative discussion of Availability found in **[Vavailability]**.

#### 797 4.1.4 Smoothing Response

798 Precision of communication and response causes special problems for large collections of entities and  
799 systems, as well as for switching of high electrical demand as in substations or with large electric motors.  
800 When devices interact at high speeds to change demand, they can create sharp spikes up or down in  
801 demand. These spikes can affect other nodes on a grid, cause a grid to crash, or even destroy  
802 equipment.

803 WS-Calendar defines Tolerance as an optional Property of Intervals that expresses allowable  
804 imprecision. Tolerance may have up to 5 parameters: Start Before Tolerance, Start After Tolerance, End  
805 Before Tolerance, End After Tolerance, and Precision.

806 For example, Start Before Tolerance may have a value of ten minutes. In the same Interval, Start After  
807 Tolerance may have a value of five minutes. Let us further specify that the Interval starts at 3:00 PM with  
808 a Duration of two hours. WS-Calendar then has expressed that the recipient begin its response at 3:00  
809 and continue for two hours, but that a response that begins any time between 2:50 pm and 3:05 pm is  
810 acceptable.

811 For convenience, this specification refers to the Tolerance Interval as either the sum of the starting  
812 tolerances (Start Before Tolerance and Start After Tolerance) or the sum of the ending tolerances (End  
813 Before Tolerance and End After Tolerance).

814 Because Sequences are constructed of linked intervals expressed as Durations, Tolerance applied only  
815 to the Designated Interval in a Sequence can change the interpretation of the entire Sequence. If the  
816 Designated Interval begins five minutes late and lasts one hour, then the second Interval, which is  
817 anchored by the first, will also begin five minutes late, and so on.

818 The Smart Grid is a system of systems, and each system provides its respective class of application.  
819 Some systems are aggregates of hundreds or thousands of similar systems. Other Systems contain many  
820 internal systems with their own dependencies and interactions. Still others may consist of a single large  
821 system. Each of these represents a different application.

- 822 • Applications managing small loads may be required to randomize their start time within the  
823 Tolerance Interval. Conformance requirements for a deployment must specify how this  
824 randomization is demonstrated or evaluated for a particular application.
- 825 • Applications internally managing collections of smaller loads may be required to spread the starts  
826 and stops of each internal system to produce a load that moves in steps over the Tolerance  
827 Interval. Different systems may do this differently. Integrated systems will sequence their internal  
828 loads to manage internal cross-dependencies. Less integrated systems may randomize the starts  
829 of their internal systems. Conformance for these applications may include a minimum spread of  
830 steps or a maximum quantum change of load.
- 831 • Applications that front single large loads may be required to gradually ramp between the initial  
832 state and the requested response across the Tolerance Interval.

833 Conformance to these deployment scenarios is outside the scope of this specification.

#### 834 4.2 EMIX in Energy Interoperation

835 Energy Interoperation uses EMIX to express the semantics of Power and Energy Markets.

836 In **[EMIX]** Product Descriptions define Energy and Power. Product Descriptions are applied to Sequences  
837 to create Schedules. Schedules conform to the inheritance pattern defined in **[WS-Calendar]** to reduce  
838 repetition of these descriptive elements. **[EMIX]** Products include an entire Schedule along with  
839 transactive information. **[EMIX]** Options use Availability to describe market information for the right to  
840 acquire Energy during certain periods at specified Rates. TeMIX defines communications for transactions  
841 of energy delivered at specified rates over specific intervals.

842 Each of the elements above is associated with a Market Context. A Market Context may be associated  
843 with Standard Terms which may define an overriding set of information for products therein. An **[EMIX]**  
844 Schedule can inherit information from the Standard Terms in a Market just as a WS-Calendar Sequence  
845 inherits from a Gluon.

846 Every Energy Interoperation interaction MAY convey an EMIX Type. Often they convey simplified  
 847 derivations of [EMIX] types that use conformance and inheritance to reduce to a bare minimum, while still  
 848 using EMIX semantics.

849 Energy Interoperation defines Parties which enroll with Counter-Parties. These Parties may then  
 850 participate directly in energy transactions, using the Semantics from TeEMIX. Others enroll as Resources  
 851 with certain capabilities. Some of these Resources may share detailed capability and response  
 852 information with their counter-party using the EMIX Resource semantics.

## 853 4.2.1 Core Semantics from EMIX

854 The terms in Table 4-3 are normatively defined in [EMIX]. Summary descriptions are provided here for  
 855 the convenience of the reader only.

856 Table 4-3: EMIX Essential Semantics

EMIX Term	Description
<b>Item Base</b>	Abstract base type for units for EMIX Products. Item Base does not include Quantity or Price, because a single Product may have multiple quantities or prices associated with each Interval.
<b>Schedule</b>	EMIX Products are delivered for a Duration, at a particular time. EMIX relies on the Interval and the Gluon as defined in [WS-Calendar].
<b>Product Description</b>	The Product Description is the payload inside each Interval of the Schedule. The Product Description conveys the characteristics of the Power or Resource or Transport Product. Each Interval may hold an incomplete Product Description, one that can be completed using the rules of Inheritance described in WS-Calendar.
<b>EMIX Base</b>	The EMIX Base conveys a Schedule populated with Product Descriptions and is intended to express additional market information sufficient to define Products.
<b>Price Base</b>	The PriceBase conveys a Price, a Relative Price, or a Price Multiplier.
<b>EMIX Interface</b>	Abstract base class for the interfaces for EMIX Product delivery, measurement, and/or pricing. The PNode and the Service Area are examples of the EMIX Interface.
<b>Market Context</b>	A URI uniquely identifying a source for market terms, market rules, market prices, etc.
<b>EMIX Product</b>	A Product Description applied to a Schedule. Using the Gluon / Sequence pattern of inheritance, there may be a nearly complete Product Description in the element that acts as a Gluon, and only elements that change in each interval.
<b>EMIX Option</b>	A Type of Product in which for a defined price, a party agrees to make Product available during a schedule (Availability) to be delivered at the counterparty's request, in accord with agreed upon terms and at an agreed upon price.
<b>Transactive State</b>	An indicator included in EMIX Base derived types to aid in processing. The enumerated Transactive States are: Indication Of Interest, Tender, Transaction, Exercise, Delivery, Transport Commitment, and Publication.
<b>Terms</b>	Terms are used in EMIX to describe when and how a product is available. Minimum Notification Duration, Maximum Run Duration, and Minimum Remuneration per Event are all Terms.



EMIX Term	Description
<b>Service Area</b>	The Service Area is the only Interface defined for all derived schemas. The Service Area expresses locations or geographic regions relevant to price communication. For example, a change in price for a power product could apply to all customers in an urban area.
<b>Power</b>	The EMIX Power schema defines products related to the exchange of Electrical Power using the EMIX semantics.
<b>Resource</b>	The EMIX Resource schema defines the capabilities that a node has to deliver Power products.
<b>Ancillary Service</b>	Ancillary Services are typically products provided by a Resource contracted to stand by for a request to deliver changes in power to balance the grid on short notice.

857 The terms in Table 4-3 are defined normatively in EMIX and nothing in this specification changes or  
858 overrides those definitions.

## 859 4.2.2 Putting EMIX in Context

860 EMIX specifies that information that does not change can be summarized using standard Terms  
861 associated with a Market Context.

862 *Table 4-4: EMIX Market Context*

Expectations and Contexts	Description
<b>Market Context</b>	Defines the product, performance expectations and rules for interactions. All Events, Signals, and Transactions occur within a market context. A Market Context acts as a Gluon for all sequences described in the EI Types. Market Contexts are described using the semantics of EMIX Standard Terms.
<b>Availability</b>	Describes when a Resource is available to respond relative to a particular VTN and Market Context
<b>Market Expectations</b>	Market Expectations are associated with a Market Context and consist of a number of Rule Sets.
<b>Standard Terms</b>	Standard Terms apply to all transactions in a Market Context. When they are conveyed as Standard Terms, they do not need to be repeated in individual interactions. A product references a Market Context and all Standard Terms associated with that Market Context.
<b>Granularity</b>	Granularity is the units of time used in operating a market, i.e., a market with a granularity of one hour transacts power in one hour increments. A One hour market is for one-hour purchases of Power with each interval in a one hour modulo offset from the beginning of the business schedule.
<b>Non-Standard Terms Handling</b>	Non-Standard terms handling defines what Parties should do with any Term not listed in the Market Rule Sets.
<b>Market Rule-Set</b>	A collection of Terms and how they are processed within this market. A Rule Set includes a Purpose to guide its interpretation.

Expectations and Contexts	Description
<b>Rule Set Purpose</b>	Defines the purpose of a Rule Set, i.e., to define minimum performance, maximum performance, etc.

863 The terms in Table 4-4 are defined normatively in EMIX and nothing in this specification changes or  
864 overrides those definitions.


### 865 4.3 Streams: Adaptations of WS-Calendar for Energy Interoperation

866 Streams use WS-Calendar Sequences to convey a time sequence of prices, usage, demand, response,  
867 or anything else that varies over time. Streams are used both for projections of the future and for reports  
868 about the past; event signals and reports are each instances of Streams.

869 WS-Calendar specifies that Sequences that describe a Service be expressed as Duration within each  
870 Interval, Temporal Relations between those intervals, and a single Start or End time for the Sequence.  
871 WS-Calendar specifies that each Interval have a unique identifier (UID). WS-Calendar further specifies  
872 that each Interval include a Temporal Relation, either direct or transitive, with all other Intervals in a  
873 Sequence. A Temporal Relation consists of the Relationship, the UID of the related Interval, and the  
874 optional Gap between Intervals.

875 **[WS-Calendar]** defines a Partition as a Sequence of consecutive Intervals.

876 | All Streams follow the Gluon-Sequence pattern from WS-Calendar, i.e., the Stream acts **as** a Gluon that  
877 optionally contains a degenerate Sequence. Information valid for the entire stream is indicated in the  
878 Gluon, i.e., external to the Intervals of the Sequence. Only information that changes over time is  
879 contained within each interval. This changing information is referred to herein as the Payload.

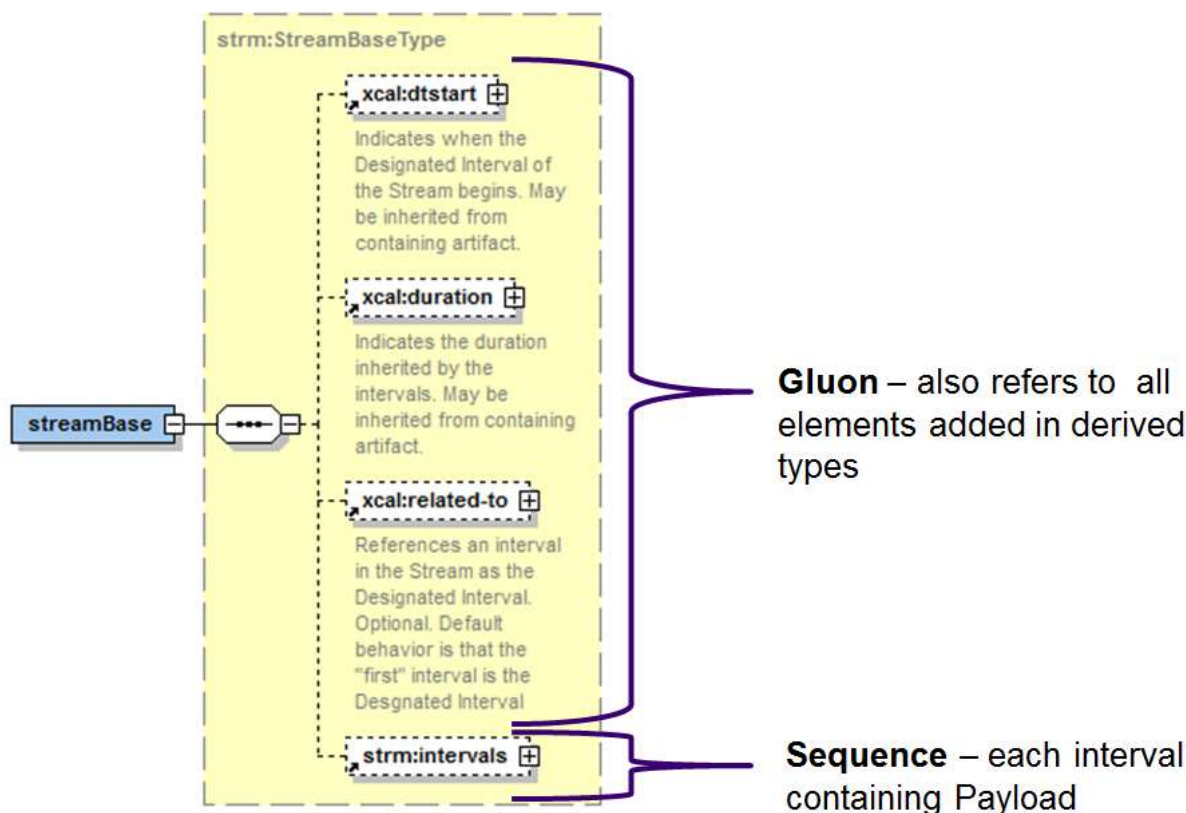


880  
881 *Figure 4-5: Stream as Gluon and Sequence*

882 For example, an Event establishes in a context specified by Enrollment and each Signal arises within a  
 883 Market Context and within that Event Base. The information contained in the Event Base MAY inherit  
 884 information in the Market Context as an Interval or Gluon inherits information from a Gluon. WS-Calendar  
 885 calls this the *lineage* of the information.

886 That Market Context may include Standard Terms, Product Description, Time Zone Identifier (TZID), and  
 887 Simple Level Definition. The Market Context enters the Lineage (as described in WS-Calendar) of the  
 888 Schedule as if the Market Context were contained in a Gluon. Product Description, TZID, Program  
 889 Definition, Terms, et al. can be inherited in this manner. Again, following the WS-Calendar inheritance  
 890 pattern, each Interval in the Sequence inherits from the Lineage described above.

891 **4.3.1 UML Diagram of Stream**

892 **4.3.1 Information Model for Streams**

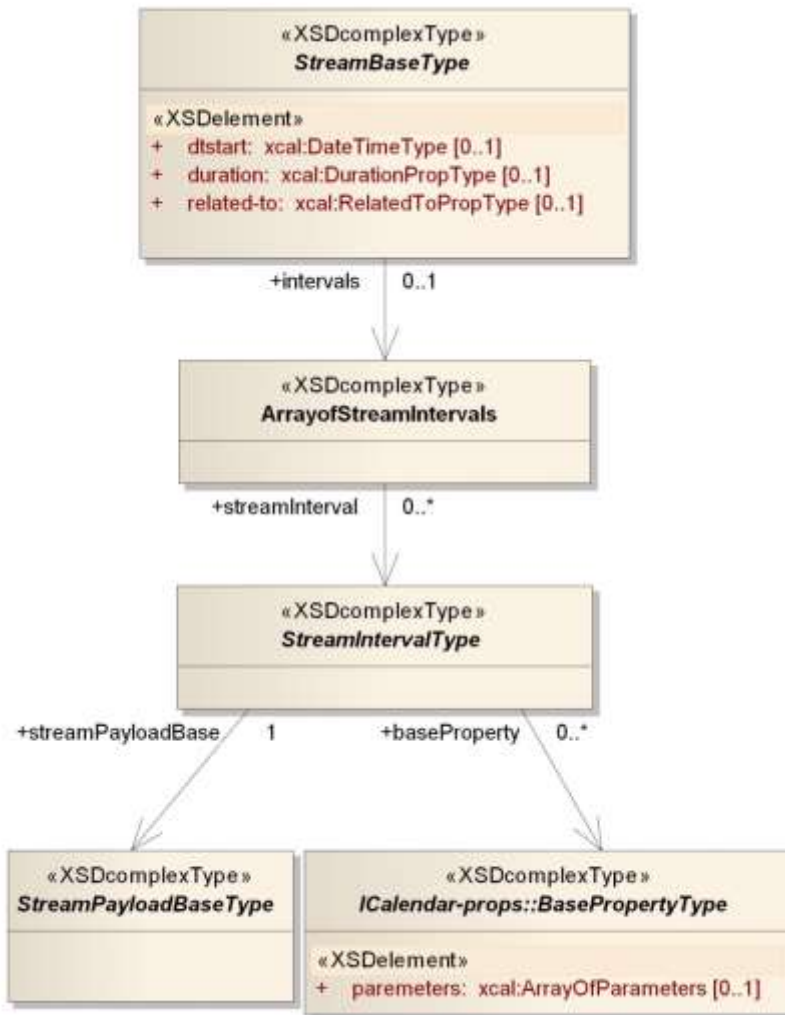

893  
 894 *Figure 4-6: UML Class Diagram of abstract StreamBase class*

895 **4.3.2 Conformance of Streams to WS-Calendar**

896 If it is necessary to process a Stream through standard Calendar communications, the Stream's GUID is  
 897 the key and the Stream is processed as if a Gluon. All Sequence information MAY remain internal to that

898 Gluon. If it is necessary to instantiate Interval in the Sequence as a WS-Calendar Interval, the GUID for  
899 each is derived by appending the Sequence ID to the Stream's GUID.

#### 900 **4.3.2.1 Stream expression of Intervals expressed as Durations**

901 While conformant communications can include anything expressible in **[WS-Calendar]**, this specification  
902 further defines standard profiles of Sequences and Intervals for use in Streams.

903 Streams describe Partitions. Within a Stream expressed using Durations, a virtual UID for each Interval  
904 MAY be constructed by concatenating the Stream Identifier, which may include the identity of the source  
905 or recipient, and a sequence number. Within a Stream, this UID can be expressed within each interval by  
906 the sequence number alone.

907 If the Designated Interval in a Sequence within a Stream omits a Temporal Relationship, then all Intervals  
908 in the Sequence MAY NOT include a Temporal Relation. Such intervals are sorted by increasing  
909 sequence number (expressed in the UID), and each Interval is treated as if it contained an implied  
910 FinishToStart relation to the next Interval with a Gap of zero Duration.

911 Partitions expressed in this way consist of Intervals containing only a Sequence Number, the Duration of  
912 the Interval (if not inherited), and the Market Signal Payload. The effect of this is that Stream Intervals are  
913 ordered as a Partition in order of increasing UID.

914 WS-Calendar inheritance defines a Lineage whereby Intervals inherit information from Gluons. In Energy  
915 Interoperation, Streams are contained within larger messages. A Stream MAY inherit information from its  
916 containing message as if from a Gluon. A Stream-derived Type ~~may~~**MAY** contain information external to  
917 the Sequence. This external information inherits acts as if it were a Gluon, ~~inheriting; it both MAY inherit~~  
918 from the containing message, and Bequeathing information to the ~~designated interval~~Designated Interval  
919 in the SequenceStream.

920 The first (in time and in sequence number) Interval in the Sequence in a Stream is the Designated  
921 Interval unless another Interval is explicitly so designated in the Stream Event. Signals, Reports, and  
922 many other messages use this pattern of expression. For example, the Active Period of an Event  
923 Bequeaths its start date and time to an Event Signal which Bequeaths that to the Designated Interval in  
924 the sequence. These terms are defined below.

#### 925 **4.3.2.2 Observational Data expressed as Streams**

926 Observed information may be best communicated as raw data without interpretation. A single set of  
927 Observations may be re-purposed or re-processed for multiple uses. For example, a measurement  
928 recorded at 3:15 may be a point in both a 5 minute series and a 15 minute series. Observational data  
929 may have known errors that can be lost in processing. Low-end sensor systems may not update instantly.  
930 For example, a reading taken at 4:30 may be known to actually have been recorded at 4:27. Streams  
931 expressing a series of observations MAY use the date and times rather than the duration as their primary  
932 temporal element.

933 When the boundaries of Intervals in a Stream are expressed with Date and Time, then all Intervals in that  
934 Sequence SHALL be expressed with a Date and Time and that boundary selected SHALL be the Same,  
935 i.e., all Intervals MAY be expressed with a Begin Date and Time OR with an End Date and Time. For  
936 observations, use the End Date and Time.

937 Within a Stream expressed using Dates and Times, a virtual UID for each Interval MAY be constructed by  
938 concatenating the Signal Identifier, the PartyID (which may be the VEN ID), and the Date and Time.  
939 Within an Observational Stream, this UID can be expressed within each interval by the End Date and  
940 Time alone. Intervals in a Sequence expressed this way are treated as if each contains an implied  
941 FinishToStart relation to the next Interval with a Gap of zero duration. The Duration of each Interval can  
942 be computed by using the Date(s) and Time(s) of adjacent Intervals.

#### 943 **4.3.3 Payload Optimization in Streams**


944 As defined in WS-Calendar and in EMIX, each Interval in a Sequence potentially contains any artifact that  
945 inherits/extends the EMIX Product Description Type as a payload. As used in Streams, the EMIX Artifact  
946 is expressed once or inherited from the Market Context. Each Interval in a Stream expresses only the

947 common subset of facts that varies within the context of the Stream. For efficient communication and  
948 processing, Streams use these explicit processing rules:

949 1. Unless each interval includes a full EMIX payload, each Interval in a Stream expresses only the  
950 defined subset of the payload that varies over time.

951 2. Each Interval in a Stream uses the same payload subset as all other intervals in that stream.

952 All streams in this specification share a common Payload base. This commonality is derived from the  
953 commonality of a request for performance (Signal), a report of performance (Report and Delivery),  
954 projections of performance (Projection), and a baseline of performance (Baseline).

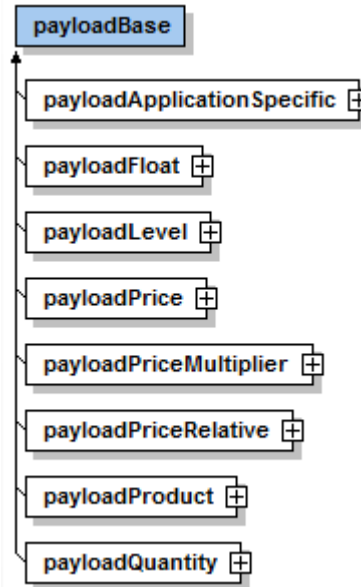

955  
956 *Figure 4-7: Payload Base*


#### 957 **4.3.4 Other elements in Stream Payloads**

958 It may be necessary to qualify information about intervals in the future. The element Interval Qualification  
959 extends the WS-Calendar Property. [All Intervals have a collection of Properties]. Energy Interoperation  
960 uses Qualifications to indicate the originator's indications as to how the sender should rely on the  
961 information in the Payload.

962 Qualifications MAY be used in Quotes, in Load and Response projections, and in Observations. They  
963 MAY NOT be used in other transactive states.

964 It may be necessary to qualify measurements delivered in a report. Devices have known accuracies.  
965 Several Measurements MAY be added together to create a single quantity. To support these  
966 uncertainties different payloads are defined for different services.


967 | Each use of streams in Energy Interoperation, Signals, Baselines, Reports, and Delivery, is discussed  
968 below. All four payloads are shown together in Figure 4-8: Comparing Payloads for Signals, Baselines,  
969 Reports, and Delivery.

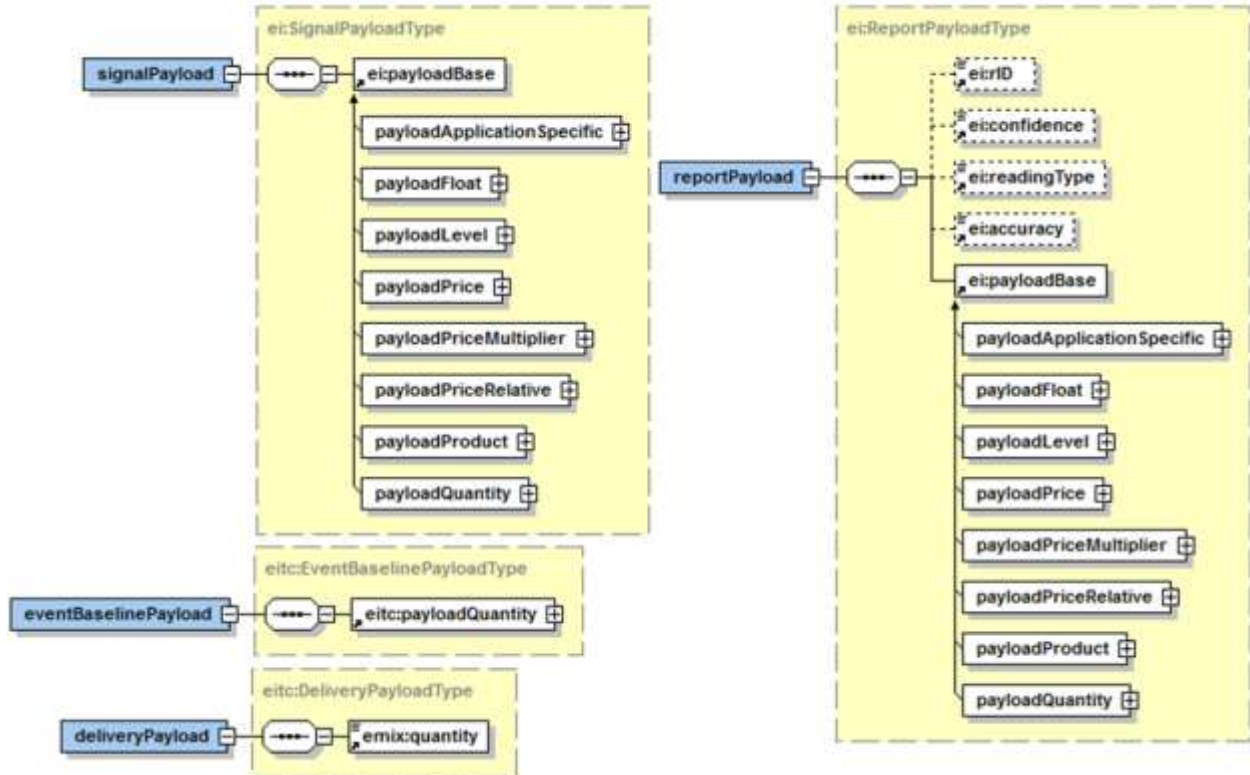

970  
 971 *Figure 4-8: Comparing Payloads for Signals, Baselines, Reports, and Delivery*

972 **4.4 Applying EMIX and WS-Calendar to a Power Event**

973 Consider the event in Figure 4-9. This event illustrates the potential complexity of marshaling a load  
 974 response from a VEN, perhaps a commercial building.

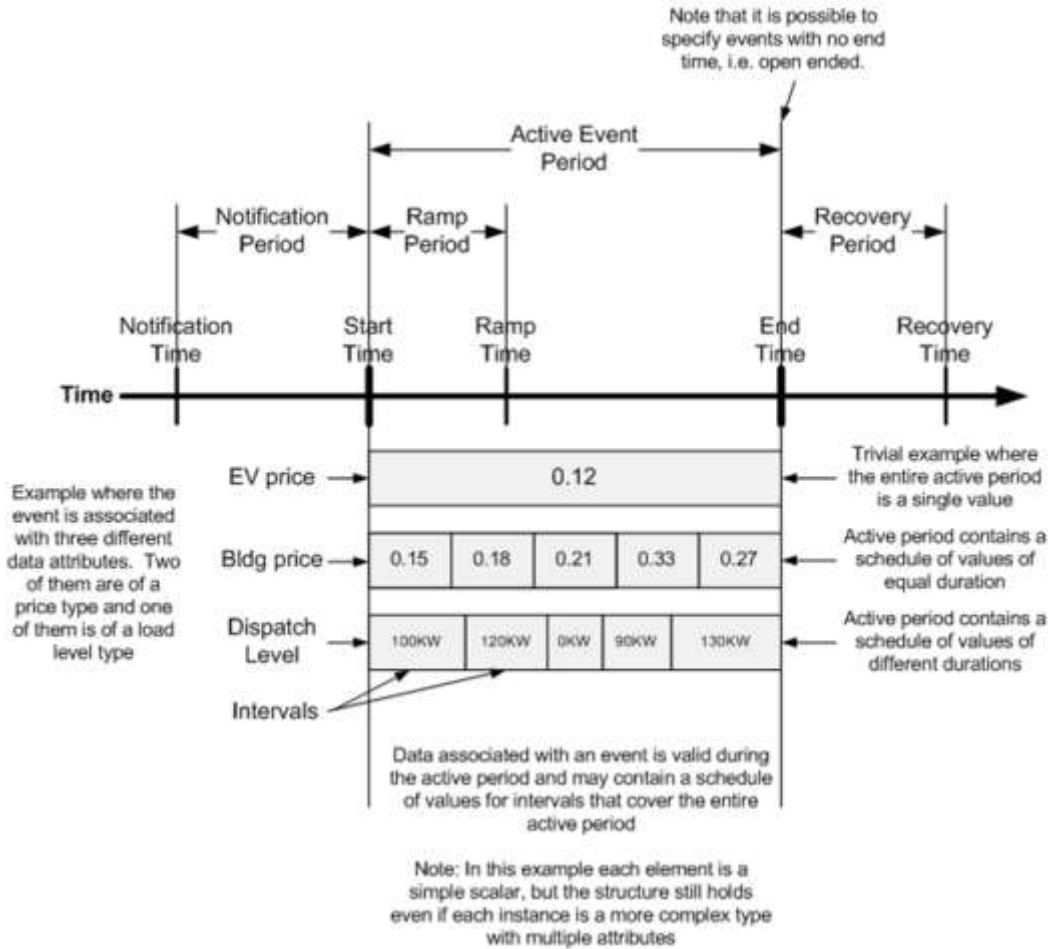

975

976 *Figure 4-9 Demand Response Event and associated Streams*

977 Note first that there are two schedules of prices. The price of electricity for the building “bldg price” is  
 978 rising to more than double its original price of \$0.15 during the interval. The price for Electric Vehicles  
 979 (EV) is fixed at the lower-than-market rate of \$0.12, perhaps because public policy is set to encourage  
 980 their use. Each of those price curves has an EMIX description.

981 In the language of EMIX and WS-Calendar, this Event contains two Resources and three Schedules. The  
 982 Resources are the Electric Vehicle and the Building. The Vehicle receives one schedule of Prices. The  
 983 Building receives two schedules, one dispatch based, and one price based. Both resources are located  
 984 within the VEN, and any decisions about how to respond to the event are made within the VEN which is  
 985 the sole point of communication for the VTN.

986 The duration that encompasses the event is known as the Active Period for the event. Before and after  
 987 the event, there is a notification period and a recovery period, respectively. These are fixed durations  
 988 communicated from the VEN to the VTN, which then must respect them in transactions it awards the  
 989 VEN.

#### 990 **4.4.1 Streams in a DR Event**

991 The three schedules above are conveyed using Signals which are expressed as Streams as defined  
 992 above.

993 The dispatch level, i.e., the load reduction made by the building, varies over time. This may be tied to  
 994 building capabilities, or to maintaining essential services for the occupants. It is not important to the VTN  
 995 why it is constrained, only that it is.

996 Note that the reductions in Figure 4-9 do not line up with the price intervals on the bar above. In this  
 997 example, the dispatch level is applied to its own WS-Calendar sequence. There is no requirement that  
 998 intervals in separate streams in an event align.

999 An Event may be associated with Observational Streams to report back to the requester information  
 1000 measured or derived during the event.

1001 **4.4.2 The Active Period Schedule**

1002 The Active Period is a special schedule for the overall description of an Event. The Active Period may  
 1003 have commercial and regulatory meaning, such as a rule requiring that an Event not be longer than two  
 1004 hours. While an Event as described below may have many schedules as expressed in Streams, it has  
 1005 one Active Period.

1006 The Active period of an event typically includes intervals in which the receiving system prepares for the  
 1007 event, begins its response, maintains its response, and recovers from the response. The schedules for  
 1008 these activities MAY be expressed using EMIX artifacts. For Power communications these can be  
 1009 expressed using artifacts based on EMIX Resources. The schedule for an Event MAY be expressed as  
 1010 can any other Sequence.

1011 More commonly, the Active Period is expressed through a single Interval. The properties of WS-Calendar  
 1012 are extended in this specification to include durations to indicate the notification, ram, and recovery  
 1013 periods. These are interpreted as if they are a normal sequence, constructed as indicated in Table 4-5.

1014 *Table 4-5: Semantics of the Active Period*

Active Period elements	Description
<b>Active Period</b>	The nominal period of the Event. Expressed as a Vcalendar containing the Active Interval and supporting schedule information.
<b>Active Interval</b>	Interval within the Active Period whose Start Time and Duration define the period. The Active Interval may be the Designated Interval in the Sequence in the Active Period or it may be a specialized Interval as described above.
<b>Notification Period</b>	Nominally, the period expressed as a Duration between notification of the event and the commencement of the Active Interval. In distributed scenarios, a VEN may receive notification before or after this moment. Constrained devices may increase energy use during the Notification Period so as to be able to reduce energy use during the Active Interval.
<b>Ramp Up Period</b>	Period at the beginning of the Active Interval expressed as a Duration, during which a VEN moves from its former state to its requested state. If negative, then the Ramp Up occurs within the bounds of the Active Interval, i.e., it starts at the same moment as the Active Interval. If there is no Ramp Up Period, then all other rules are processed as if there were a Ramp Up Period of zero length.
<b>Recovery Period</b>	Period at the end of the Active Interval expressed as a Duration during which the effect of the response may be reversed while the system returns to its base state. For example, a system that reduces energy use during an Event by raising the air temperature may use additional energy during the recovery period while cooling the air to the normal setting. If negative, then the Recovery Period occurs within the bounds of the Active Interval, i.e., it ends at the same moment as does the Active Interval.
<b>Tolerance</b>	A collection of parameters that indicate whether there is a range of acceptable starting and ending times for the Active Period. Tolerance is used to smooth the response so that thousands of systems do not change state at the same moment.





1016

## 5 Semantics of Energy Interoperation

1017 As stated in in Section 4, much of the core vocabulary for this specification comes from [EMIX] and [WS-  
1018 Calendar]. This section introduces the remaining vocabulary for Energy Interoperation and then defines  
1019 the use of that vocabulary in the higher level types.

1020 The services of Energy Interoperation are built around exchanges of and references to these standard  
1021 information artifacts.

1022 Table 5-1: Energy Interoperation Identities

Identity Types	Description
<b>Party</b>	As described in Section 3, all interactions are between two Parties. A Party consists of a Party Id, a Party Name, and a Party Role. The Party ID is a sub-type of the UID.
<b>Resource</b>	Identifies a discrete set of capabilities that a Party may offer to a counterparty. Resources may represent specific equipment, collections of market interactions, or a detailed promise to perform. Resources are associated with a VEN during Enrollment.
<b>Market</b>	When used in this specification, a Market is a set of agreed upon assumptions and business practices. Tariffs and utility programs are examples of Markets. Each negotiation and transaction occurs within the named context of a Market.
<b>Market Context</b>	A collection of machine readable Market rules and assumptions. A Market Context is uniquely identified by a URI as defined by the EMIX Market Context. This URI can be used to retrieve the Context.
<b>UID</b>	Unique Identifier for every party, role, message, event, etc.


1023 The elements above are used throughout the messages of this specification.

### 1024 5.1 Dramatis Personae: Identifying the Actors

1025 As described in Section 3, each interaction is an interaction between two parties.

Low Level Identity Types	Description
<b>VEN</b>	As described in section 3 above, A Virtual End Node is a Party acting in a specific role in a market managed by a VTN.
<b>VTN</b>	As described in section 3 above, A Virtual Top Node is a Party acting in a specific role that sends events market information to a VEN.
<b>Group</b>	Resources and VENs may be the target of an Event. How group membership is identified or recognized is out of scope.
<b>Target</b>	A set of elements that collectively name which Parties should participate in an event. A Target can include Service Areas, named Groups, VENs, and Resources and other standard identifiers. The Target can be used by VEN's that are also VTN's and must relay event information downstream to other VENs.

1026

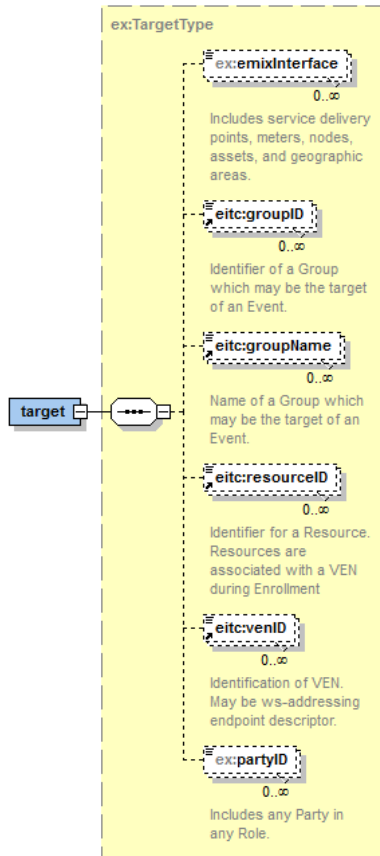

1027  
1028 *Figure 5-1: EI Target*

1029 **5.1.1 Actor IDs and Roles**


1030 There is a certain fungibility of the Actor IDs in the service payloads. A Party may participate in many  
1031 interactions, yet it is necessary to distinguish each Party by the role it is playing in the current interaction.  
1032 Accordingly, there are named derivatives of the Actor ID for use in each situation.



1033  
1034 *Figure 5-2: UML Class Diagram of Party ID and its derivatives*

1035 **5.2 Market Context**

1036 As defined in [EMIX], a Market Context is a URI, and it can be used to reference Standard Terms. This  
1037 specification describes the expanded set of context information that is part of the EI Market Context.

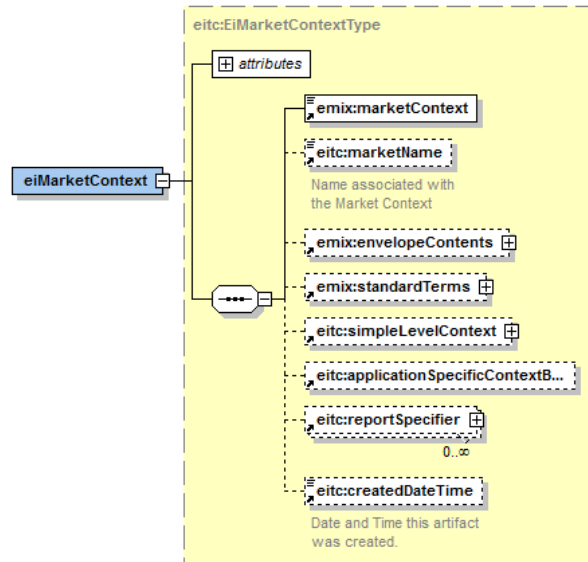

1038  
1039 *Figure 5-3: EI Market Context*

1040 The Elements of the EI Market Context are, for the most part, defined in [EMIX]. The Market Name  
1041 conveys a human-readable text, perhaps for display in a user interface. As in EMIX, the Envelope  
1042 contains warrants and certificates. For example, if a Market is purported to convey Green Power, however  
1043 defined, that information would be conveyed in the Envelope. Two elements, Simple Levels and  
1044 Application Specific Extensions bear discussion here.

### 1045 **5.2.1 Simple Levels**

1046 The Simple Level Context is an agreement-based interaction abstracted away from expressions of value  
1047 or actual amounts. Simple Levels define levels of energy scarcity and abundance, at an agreed upon  
1048 granularity. A VEN can discover Specific Levels within a Market Context.

1049 *Table 5-2: Simple Levels*

Level Information	Description
<b>Simple Level Context</b>	Simple Levels are a set of simple indicators about scarcity and value, in which an ordered set of values indicate energy scarcity is above normal, normal, or below normal. Presumably, at higher levels, the VEN will use less.
<b>Upper Limit</b>	The upper level for this Context. If the Upper Limit is 5, the levels are 1-5, where 5 indicates the greatest scarcity.
<b>Normal Value</b>	The "normal" level indicating normal energy availability. Levels below normal indicate surplus, levels above normal indicate increasing scarcity. If the Upper Limit is 7, the levels are 1-7, and the Normal Value might be 3.
<b>Level</b>	Payload used in Signals to convey Simple Level to a VEN

1050 For example, a simple program may have the levels Normal, High, and Critical. The Simple Level Context  
1051 would indicate three levels with a normal value of one.

1052 How a VEN associates particular activities and responses to the Simple Levels is out of scope for this  
1053 specification.

### 1054 **5.2.2 Application Specific Extensions**

1055 A VTN may wish to communicate with, and a VEN may wish to allow communication with a specific  
1056 Application operating within the VEN. Operating such an Application MAY be part of a specific Market

1057 Context. This specification provides explicit support for these Application Specific Extensions by means of  
 1058 4 abstract types.

1059 *Table 5-3: Application Specific Extensions*

Extensions	Description
<b>Application Specific Extension Base</b>	An abstract Base Type for all other Application Specific Extensions. Application Extensions are used to provide hints to or interactions with Applications running on the other side of an interaction. They are not defined in Energy Interoperation, although there are specific conformance rules that must be followed.
<b>Application Specific Context Base</b>	An abstract class to exchange invariant or setup information with an Application running on the other side of an interaction. The Context Base is exchanged as part of a Market Context.
<b>Application Specific Signal Base</b>	An abstract class to exchange current information and varying information with an Application running on the other side of an interaction. The Signal Base is exchanged by means of an Event Signal.
<b>Application Specific Report Base</b>	An abstract class to exchange Reports with an Application running on the other side of an interaction. The Report Base is exchanged by means of an Event Report <del>for</del> by the Report Service.

1060 The primary concern of the conformance rules for Application Specific Extensions is that they avoid  
 1061 redefinition of the semantics of Energy Interoperation. Prices SHALL be communicated as defines in  
 1062 EMIX Price Base. Schedules SHALL be communicated using the semantics of WS-Calendar. Products  
 1063 and things to be measured SHALL be expressed using the EMIX Item Base.

1064 Parties wishing to exchange Application Specific Extensions SHALL extend the Signal Types and Report  
 1065 Types to indicate they are using their specific Payloads.

### 1066 **5.2.3 Response Smoothing**

1067 Precision of communication and response causes new problems for collections of entities and systems.  
 1068 With WS-Calendar and Energy Interoperation, thousands of systems and devices could respond at the  
 1069 same moment, causing grid instabilities or even equipment damage.

1070 To avoid these problems, Energy Interoperation uses WS-Calendar Tolerances (Start Before, Start After,  
 1071 End Before, and End After) to specify a Duration in which response smoothing MAY be requested.

1072 To further refine the expectation surrounding Smoothing, this specification defines a new Term, i.e., an  
 1073 extension of the EMIX Base Term, to convey expectations for smoothing the aggregate response.  
 1074 Because it is a Term, is can be communicated as part of a Market Context, or as part of an individual  
 1075 Event.

1076 The Smoothing Term provides actionable information; of course the degree of adherence to what is an  
 1077 application or deployment performance characteristic is out of scope for this specification. See also  
 1078 Section 4.1.4.


1079 *Table 5-4: Smoothing Terms*

Response Smoothing	Description
<b>Smoothing</b>	Response Smoothing defines a Term that indicates that the recipient is to ensure that the response is not in a single step.  Response Smoothing is applied to the tolerance interval[s] indicated by the Start Before, Start After, End Before, and End After tolerances. The enumerated values of Smoothing are below.

Response Smoothing	Description
<b>Ramp</b>	A smooth or uniform step ramp is indicated between the initial and end values in the respective Tolerance Interval
<b>Uniform</b>	A uniform distribution is indicated over the entire respective Tolerance Interval.
<b>None</b>	No specific smoothing is indicated. Applications need not react in a stepwise manner, so some degree of smoothing MAY occur in response to this request. If the Smoothing Term is absent, the behavior requested is the same as None.

1080 **5.3 Event-based Interactions**

1081 Events are stylized business interactions that are used in formal demand response environments. As  
 1082 described in Section 3, Events are used in communications between a VTN and a VEN. An Event  
 1083 consists of the time periods, deadlines, and transitions during which Demand Resources perform. The  
 1084 VTN specifies the duration and applicability of an Event. Some deadlines, time periods, and transitions  
 1085 may not be ~~not~~ applicable to all products or services.

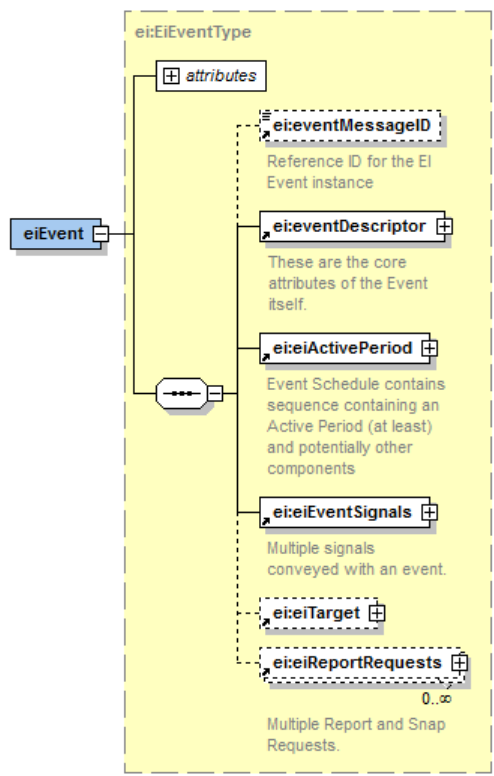

1086  
 1087 *Figure 5-4: Event Overview*

1088 **5.3.1 The Event Descriptor**

1089 The Event descriptor contains metadata about the event itself.

1090 *Table 5-5: The Event Descriptor*

Event Descriptor Elements	Description
<b>Event Descriptor</b>	A collection of meta-data about an Event
<b>Event ID</b>	Identifier assigned to the Event Descriptor

Event Descriptor Elements	Description
<b>Modification Number</b>	If present, indicates that the event has been modified. Incremented each time the event is modified.
<b>Modification Date and Time</b>	The date and time a modification takes effect.
<b>Modification Reason</b>	Reason describing why the event is being modified. The values for reason are not specified or restricted.
<b>Priority</b>	Optional indication of the priority of an event. A given VEN or Resource may be eligible for more than one event at the same time.
<b>Market Context</b>	The overall market or program rules that govern this event.
<b>Created Date Time</b>	Indicates when this artifact was created.
<b>Event Status</b>	Indicates the current status of an event as of the descriptor generation. Enumerated values are: <ul style="list-style-type: none"> <li>• Far: Event is in the far future. The exact definition of how far in the future this refers is dependent upon the market context, but typically means the next day.</li> <li>• Near: Event is in the near future. The exact definition of how near in the future the pending event is active is dependent on the market context.</li> <li>• Active: Event has been initiated and is currently active.</li> <li>• Completed: Event has completed.</li> <li>• Cancelled: Event has been canceled.</li> </ul> <p>These values are similar but not identical to those used by the Event Filter as described in Section 9.2 “<i>Special Semantics of the Event Request Operations</i>”. The value is present in Energy Interoperation to support backward compatibility with OpenADR 1.0.</p>
<b>Operating Day</b>	Indicates the nominal date for the event. Important for some market contexts.
<b>Test Event</b>	If present, can indicate that this event is a test event rather than an actual event.
<b>Comment</b>	Free-form information provided by the VTN

### 1091 5.3.2 The Active Period


1092 [See Section 4.4 for terminology describing the periods of an event.](#)

1093 The Active Period is a Sequence that describes the overall schedule for an Event. The Active period is a  
1094 Vcalendar type that contain a Sequence and MAY have its own properties. The Sequence of an Active  
1095 Period generally falls into a common Interval pattern of Notification, Ramp-up, Active, and Recovery. The  
1096 Designated Interval of the Sequence is also referred to as the Active Interval.

1097 This stereotypic pattern can be collapsed with the Intervals for Notification, Ramp-up, and Recovery  
1098 expressed as Properties of the Active Interval. Notwithstanding this common pattern, the Active Period  
1099 can contain any valid Sequence, as long as the meaning conveyed is understood by both parties.

1100 A single Event may be broadcast to many VENs with similar performance characteristics. If the VENs all  
1101 perform in unison, it can create spikes (or sudden drops) in energy use that can be harmful to the  
1102 distribution system. It is necessary for a VEN to be able to ameliorate this issue by requesting response  
1103 smoothing as described in Section 4.1.4.

1104 A smoothing request is indicated through the WS-Calendar Tolerance Property. This property is applied  
 1105 to the overall Active Period so its meaning is the same whether the simplified common pattern or a full  
 1106 Sequence is conveyed.

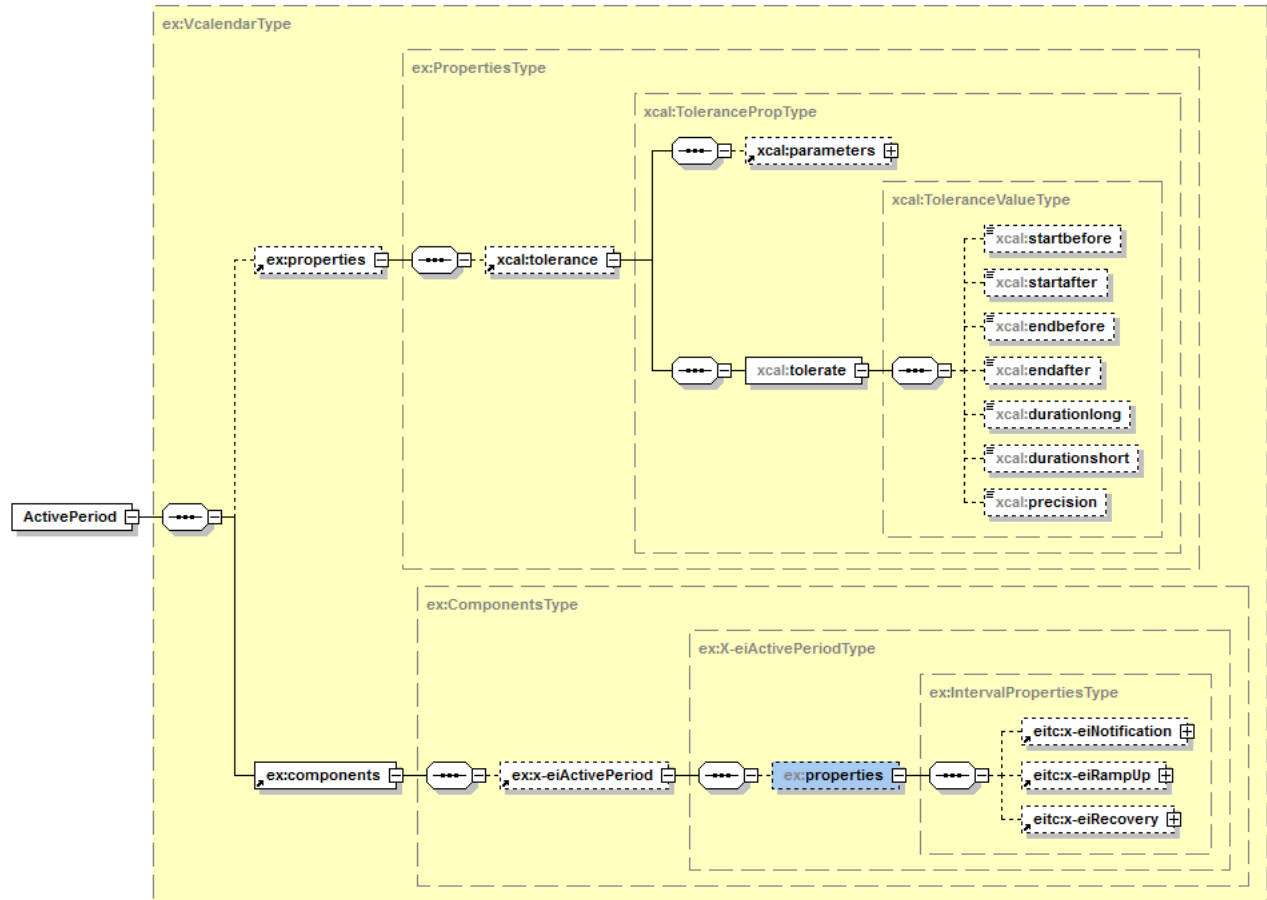


1107  
 1108 *Figure 5-5: Active Period Elements*

1109 **5.3.3 The Event Signals**

1110 Event Signals convey the detailed information about the schedule for an event. Signals are conveyed  
 1111 using Streams as described in Section 4.3. When an Event conveys multiple signals, they may be aimed  
 1112 at different target resources in different Market Contexts, or they may use different semantics, i.e., one  
 1113 use Price and another use Simple Level semantics. All Event Signals have a common form.



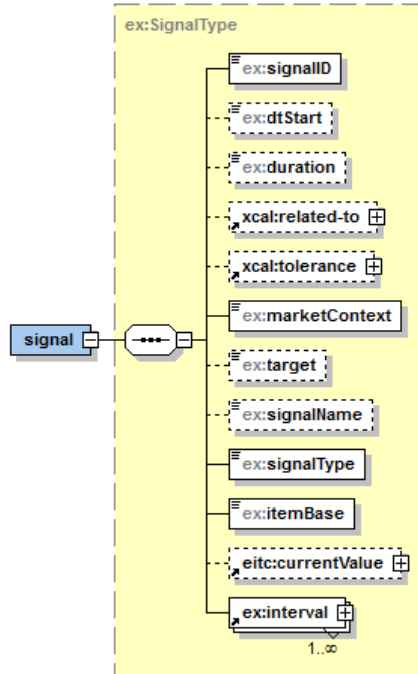

1114

1115 *Figure 5-6: Event Signal Overview*

1116 As do all Streams, each Event Signal has a starting time, and a Tolerance (for smoothing); if absent,  
 1117 these are inherited from the Active Interval as if the Active Interval were a Gluon. The Time Zone is  
 1118 inherited from the Market Context. Each Event Signal includes a Related-To parameter to name the  
 1119 Designated Interval; if there is none, the first Interval is the Designated Interval. The Designated Interval  
 1120 has specific meaning for Sequence scheduling as defined in WS-Calendar.

1121 **5.3.3.1 Details of the Signal**

1122 Each signal includes a Market Context and optionally a Target. The Market Context and Target are used  
 1123 by the VEN to select which Signal, if any, to respond to. The Signal Name provides the VEN with a  
 1124 human-friendly description of the Signal, perhaps for display in a user interface. An EMIX Item Base  
 1125 enumerates what is being measured, and perhaps paid for, by the Signal. A Signal Type defines what  
 1126 Payload must be used throughout the signal; all Payloads in a signal MUST be of the same type. Each  
 1127 Interval contains a Payload, as specified by the Signal Type. An optional element, Current Value caches  
 1128 the current value (as of the signal creation) of the Payload.

1129 *Table 5-6: Signal Types*

Signal Types	Description
<b>Delta</b>	The Payload in each Interval indicates a request to change the amount [used] by the amount in the signal as denominated by the Item Base.
<b>Multiplier</b>	The Payload in each Interval indicates a request to change the amount [used] to an amount computed by the amount in the signal times the Baseline as denominated by the Item Base.
<b>Level</b>	The Payload in each Interval indicates the Level during each Interval. See Section 5.2.1 for a description of Simple Levels.

Signal Types	Description
<b>Price</b>	The Payload in each Interval indicates <del>indicate</del> a price per unit as denominated by the Item Base. Price is conveyed as an EMIX Price, either a Price, a Price Multiplier, or a Price Relative. Each Payload in a Stream must contain the same type of Price. The Currency for each Price is inherited from the Market Context. In EMIX, both Price Multipliers and Prices Relatives include a Market Context; in a Payload in Signal, these are inherited from the Signal's Market Context.
<b>Product</b>	Signal indicates the Product for each interval. Payload Type is an EMIX Product Description.
<b>Set-point</b>	The Payload in each Interval indicates a requested amount [to use] as denominated by the Item Base. The amount may be more or less than the amount in the Baseline.

1130 Parties may choose to exchange application specific payloads in signals as well. Prior to doing so, they  
1131 MUST extend the Application Specific Signal Base and agree upon the Signal Type they will use. The  
1132 Signal Type MUST conform to the EI Extension pattern. See Appendix C for a discussion of conforming  
1133 extension.

### 1134 5.3.4 Baselines

1135 Baselines are streams that can incorporate signals and share many of the same elements. As some  
1136 signals indicate the performance requested is relative to that in another interval, Baselines indicate the  
1137 performance in that Interval.

1138 The Baseline is a signal that expresses the amount ~~point~~ as denominated by the Item Base that is the  
1139 starting ~~point~~ for the signal types above. The computational basis for the Baseline is not in scope for this  
1140 specification. The Baseline is compared to the actual metered consumption during the Event to determine  
1141 the value of the Response. Depending on the type of product or service, Baseline calculations may be  
1142 performed in real time or after the fact.

1143 Another form of the Baseline merely indicates the comparable period that is used for comparison. This  
1144 enables the sender to indicate when the Baseline is drawn from without indicating the values for that  
1145 Baseline period, which may not yet be known.

### 1146 5.3.5 Opt – Making Choices

1147 When a VEN enrolls in an event-oriented Market Context, it makes itself Available to respond to events  
1148 on a given schedule. The Availability schedule may be simple (all day, all the time) or complex (weekday  
1149 afternoons, on weekends with a long notice, and not on Thursday mornings during biweekly payroll). No  
1150 matter how simple or complex the Availability, the VEN may choose to change it for a limited period. This  
1151 decision is communicated with an Opt (as in “Opt In” and “Opt Out”).

1152 The primary information payload for an Opt is a collection of Vavailability artifacts. An optional element  
1153 inside each Availability artifact determines whether the particular repeating schedule within indicates  
1154 availability or unavailability.

1155 Business rules require that someone Opting declare their reason, using one of the specific enumerated  
1156 reasons or an extension as allowed by the local Market.

1157 *Table 5-7: Opt*

Opt Element	Description
<b>Opt</b>	Opts are used by the VEN to temporarily modify availability in the pre-existing agreement. For example, a VEN may Opt In to events during the evening, or Opt Out from events during the World Series.


Opt Element	Description
<b>Opt ID</b>	A reference ID for a particular Opt notification. This identifier may be used by other entities to refer to this instance of an Opt.
<b>Opt</b>	<del>Opts are used by the VEN to temporarily modify availability in the pre-existing agreement. For example, a VEN may Opt In to events during the evening, or Opt Out from events during the World Series.</del>
<b>Opt Type</b>	Either Opt-In or Opt-Out. This element determines the processing of the Vavailability. If Opt In, then any available time is added to the pre-existing schedule. If Opt-Out, then for the period bracketed by the Availability, the schedule replaces the pre-existing schedule.
<b>Opt Reason</b>	Reason for the Opt. Enumerated reasons include: Economic, Emergency, Must Run, Not Participating, Outage Run Status, Override Status, Participating

- 1158 The Opt Type controls specific differences in how an Opt is processed against the pre-existing  
1159 availability.
- 1160 Opt-In: After processing, the new schedule and availability is added to the existing availability for  
1161 the period bounded by the Opt Availabilities.
- 1162 Opt-Out: After processing, the new schedule and availability replace the existing availability for the  
1163 period bounded by the Opt Availabilities.
- 1164 In either case, when the bounding period is over, Availability reverts to the previous schedule.

## 1165 5.4 Monitoring, Reporting, and Projection

1166 A Party may request that another Party measure something and report back. The thing measured may  
1167 include Power, Voltage, Peak, or any other attribute associated with the products exchanged. These  
1168 measurements may or may not be in relation to an Event. An EiReport is the record of a measurement or  
1169 series of measurements made by one Party and delivered to another.

1170 A Party requests that another Party prepare a Report by means of a Report Request. Report Requests  
1171 can be delivered using the Report service, or can accompany an Event. The Historian and Projection  
1172 services also make use of the Report Request.

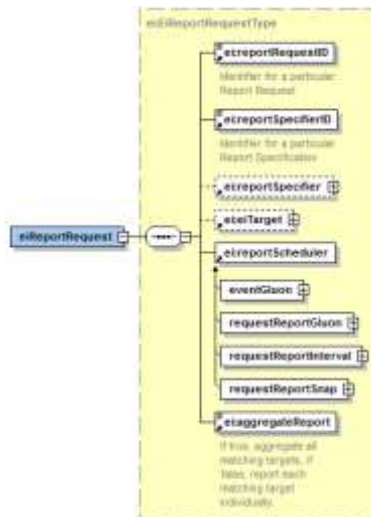


1173  
1174 *Figure 5-7: The Report Request*

1175  
1176 *Table 5-8: Elements of the Report Request*

Report Specifier	Description
<b>Report Request ID</b>	Identifies this request
<b>Report Specifier ID</b>	References the Report Specifier for this Request. The Specifier may be known from a previous request, or may be a standard Specifier within this Market Context.
<b>Report Specifier</b>	Request MAY optionally include the Report Specifier <del>lest it is not otherwise known to the Party receiving the Request as described below.</del>
<b>Target</b>	Standard group of Parties, Resources, Groups, et al. that the Report concerns.
<b>Report Scheduler</b>	Indication of when the report is to be run, for how long, etc.
<b>Aggregate Report</b>	As the Target of a Report Request may indicate multiple Parties or Resources, this Boolean indicates whether a single report or one for each entity matching the Target is requested,

1177 **5.4.1 The Report Specifier**

1178 A Party specifies what reports it wants by means of a Report Specifier. Report Specifiers may be  
 1179 delivered in the Report Request or be known from the Market Context.

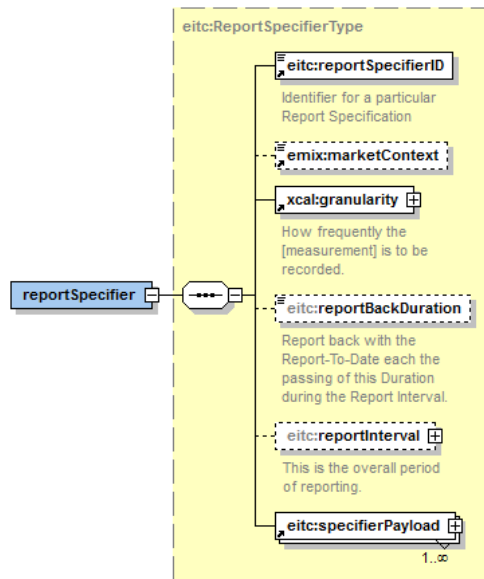

1180  
 1181 *Figure 5-8: The Report Specifier*

1182 A single Report Specifier may generate quite different Reports based upon which service it is delivered by  
 1183 and how it is scheduled. The elements of a Report Specifier are as follows:

1184 *Table 5-9: Elements of the Report Specifier*

Report Specifier	Description
<b>Specifier ID</b>	Identifies this Report Specifier
<b>Market Context</b>	The Optional Market Context MAY provide information about the Product that is being reported, or about where this Specifier came from.
<b>Granularity</b>	Duration defining temporal detail, i.e., “read the meter every 5 minutes”

Report Specifier	Description
<b>Report-Back Duration</b>	Report Back to requestor, with the report-to-date at each passing of this Duration during the Report Interval. If Optional, no Report-Back is expected.
<b>Report Interval</b>	Interval indicating the total span of the report. Parallel to Active Interval. May be influenced by a Gluon in the Report Scheduler. If the Interval contains a Start Date and no Duration, then the Report is to begin at the Start date and continue indefinitely.
<b>Specifier Payload</b>	The Specifier Payload indicates exactly what is to be in the report.

1185 **5.4.1.1 The Report Specifier Payload**

1186 The Specifier Payload indicates exactly what is in the Report. It consists of an **[EMIX]** ItemBase and a  
1187 Report Type.

1188 *Table 5-10: Report Specifier Payload*

Report Specifier	Description
<b>rID</b>	Identifies this Payload. If only one Payload is requested, the rID should be omitted; if multiple Payloads are requested in the same Report, each should have an rID.
<b>Item Base</b>	The Item Base is the core of an EMIX Product Description. Examples of an Item Base denominated value include Real Power, Real Energy, Voltage, et al.
<b>Report Type</b>	Defines what is being measured and reported. Measurements are in units of Item Base unless the Report Type indicates otherwise.

1189 The Report Type specifies what is measured and, sometimes, how it is measured.

1190 **5.4.1.2 The Report Types**

1191 Report Types are an enumeration that indicates how the Item Base is to be measured. These  
1192 enumerations parallel the Signal Types used in Events.


1193 *Table 5-11: Report Types*

Report Types	Description
<b>Reading</b>	Report indicates a Reading, as from a meter. Readings are moments in time--changes over time can be computed from the difference between successive readings. Payload Type is Float.
<b>Usage</b>	Report indicates an amount of units (denominated in Item Base or in the EMIX Product) over a period. Payload Type is Quantity. A typical Item Base is Real Energy.
<b>Demand</b>	Report indicates an amount of units (denominated in Item Base or in the EMIX Product). Payload Type is Quantity. A typical Item Base is Real Power.
<b>Set Point</b>	Report indicates the amount (denominated in Item Base or in the EMIX Product) currently set. May be a confirmation/return of the set point control value sent from the VTN. Payload Type is Quantity. A typical ItemBase is Real Power.
<b>Delta Usage</b>	Change in Usage as compared to the Baseline

Report Types	Description
<b>Delta Set point</b>	Changes in Set point from previous schedule
<b>Delta Demand</b>	Change in Demand as compared to the Baseline
<b>Baseline</b>	Can be Demand or Usage, as indicated by ItemBase. Indicates what <del>measurement</del> <u>the amount</u> would be if not for the Event or Regulation. Report is of the format Baseline.
<b>Deviation</b>	Difference between some instruction and actual state.
<b>Average Usage</b>	Average usage over the duration indicated by the Granularity
<b>Average Demand</b>	Average usage over the duration indicated by the Granularity
<b>Operating State</b>	Generalized state of a resource such as on/off, occupancy of building, etc. No ItemBase is relevant. Requires an Application Specific Payload Extension.
<b>Up Regulation Capacity Available</b>	Up Regulation capacity available for dispatch, expressed in EMIX Real Power. Payload is always expressed as positive Quantity.
<b>Down Regulation Capacity Available</b>	Down Regulation capacity available for dispatch, expressed in EMIX Real Power. Payload is always expressed as positive Quantity.
<b>Regulation Set point</b>	Regulation set point as instructed as part of regulation services
<b>Current Storage</b>	Item Base is expressed as Real Energy and Payload is expressed as a Quantity.
<b>Target Storage</b>	Item Base is expressed as Real Energy and Payload is expressed as a Quantity.
<b>Available Storage Capacity</b>	Capacity available for further energy storage, presumably to get to Target Storage.
<b>Price</b>	Report Prices per ItemBase at each interval
<b>Level</b>	Report Simple Level at each interval. ItemBase is not meaningful.

1194 Report Type is implemented as an enumerated string with extensibility. Parties wishing to extend the  
1195 enumeration MUST defined the report payload requirements.

## 1196 5.4.2 Report Scheduler

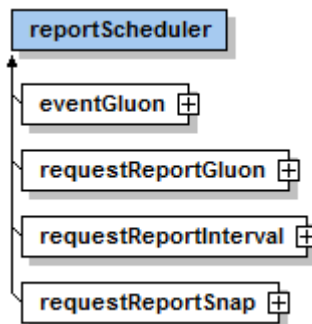

1197  
1198 *Figure 5-9: Report Scheduler*


1199 The report scheduler is an abstract type that specifies how often and for how long a report will be  
1200 prepared. The Report Scheduler adds flexibility and consistency by enabling a single Report Specifier to

1201 be used in multiple scenarios. One option for Report Scheduler enables a Report Request to be  
 1202 associated with an Event.

1203 *Table 5-12: Types of Report Scheduler*

Report Scheduler	Description
<b>Event Gluon</b>	<p>Associates a Report Request with a particular event. This type consists of a Gluon and a reference to the Event ID.</p> <p>The Gluon sets the Report Interval relative to the Active Interval of the Event. For example:</p> <p><b>SS -T20M.</b> The Report interval starts 20 minutes before (-T20M) the Active Interval starts (Start to Start).</p> <p><b>FF T1H.</b> The Report interval Finishes 1 hour after (T1H) the Active Interval Finishes (Finish to Finish).</p> <p>If absent, the Report Interval is the same as the Active Interval, i.e., the Report runs during Active Interval.</p> <p>The Event ID indicates the Event this report is related to. If absent, the Report Request must be delivered as part of an EiEvent</p>
<b>Request Report Gluon</b>	<p>Used if the Report Specifier includes a Report Interval to influence the expression of that Interval. Information in the Gluon is inherited by the Report Interval in conformance with WS-Calendar.</p>
<b>Request Report Interval</b>	<p>The Interval in Scheduler is the Report Interval for the Report. If the Specifier included an Interval, it is replaced by the one in the Schedule.</p>
<b>Request Report Snap</b>	<p>Indicates that the readings indicated by the Specifier are to be made once at the Status Date and Time and then returned to the Requester. If the Status Date and Time are omitted, then the Snap is to be made at the time of receipt.</p>


1204 **5.4.2.1 UML Diagram of Report Scheduler**

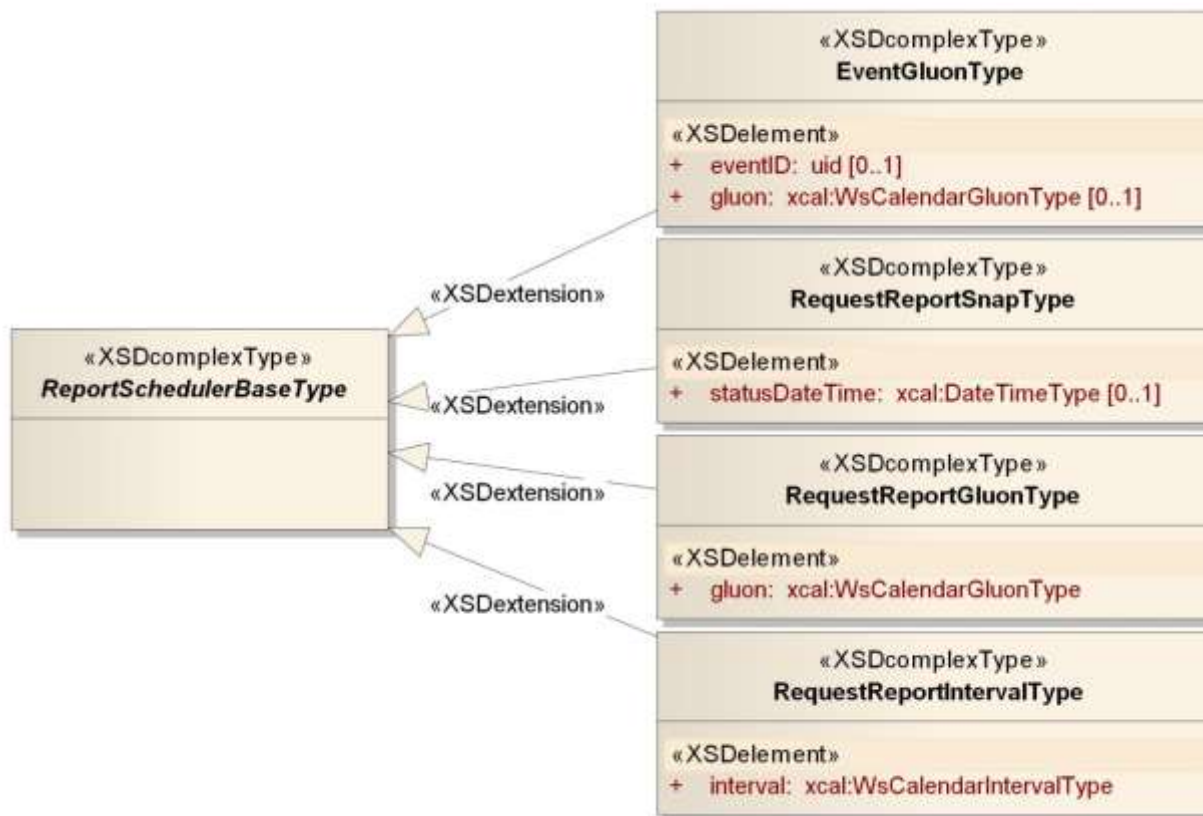

1205  
1206 *Figure 5-10: UML Diagram of Report Scheduler*



1207 **5.4.3 UML Diagram of Report Request**

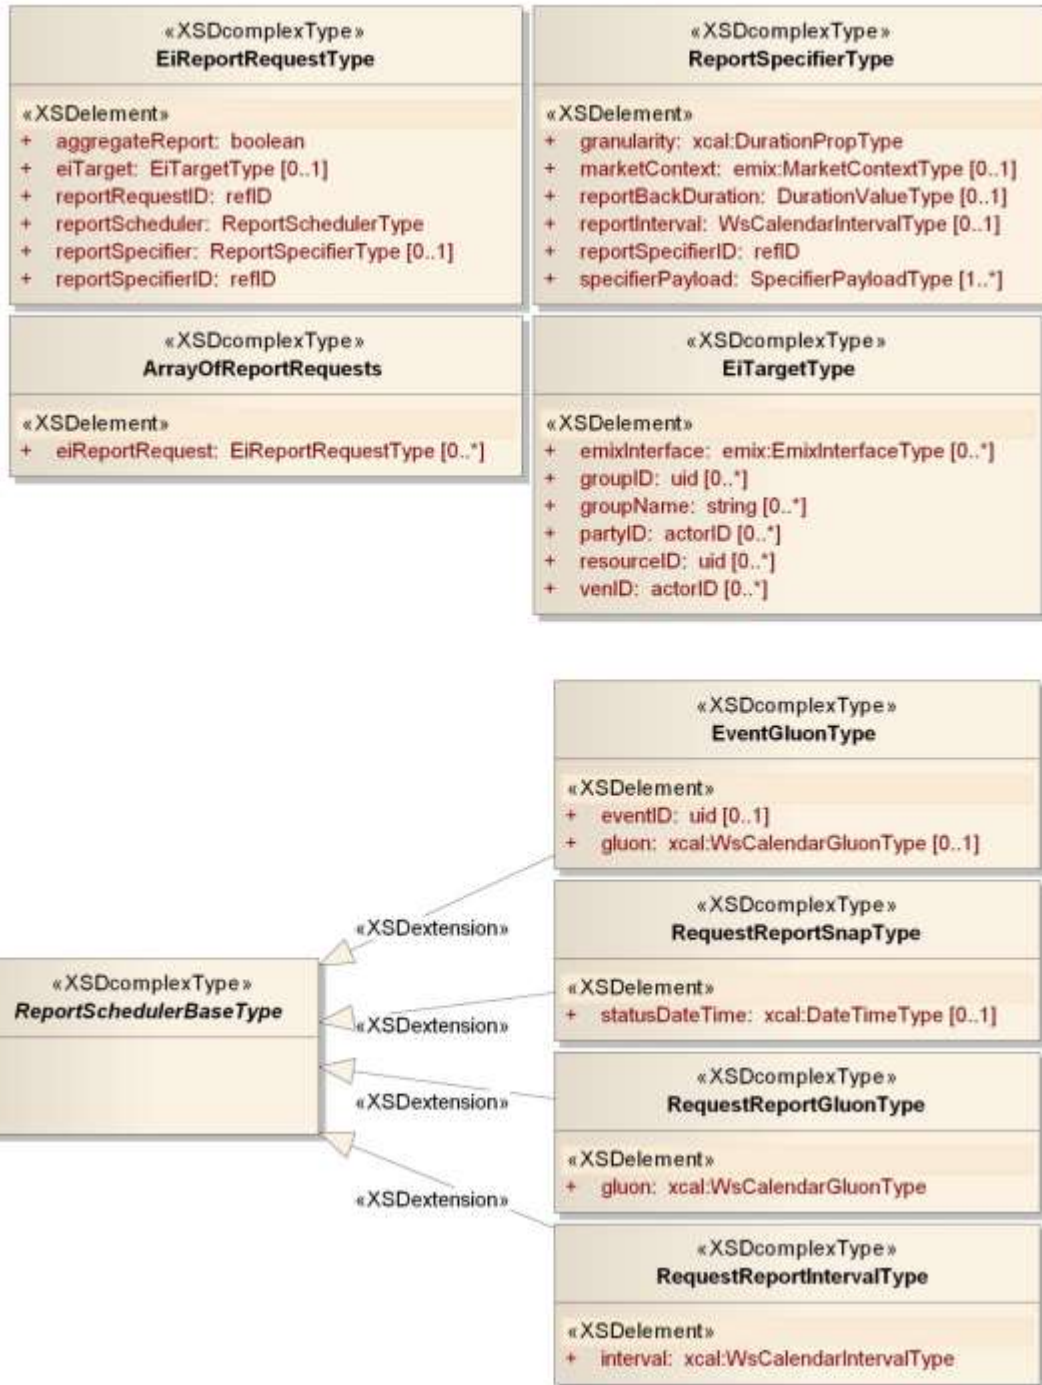

1208  
1209 *Figure 5-11: UML Class Diagram of Report Request*


1210 **5.5 Reports, Snaps, and Projections**

1211 Reports are simple Streams with some metadata identifying the report and a collection of Intervals  
 1212 containing the Payloads for each [measurement]. Reports can be of the past, the present, or the future. A  
 1213 Report appears as a series of [measurements] in the past. A Snap is a Report made as of a single  
 1214 moment. A Projection is in the same form as a report, but it includes projections of what will be in the  
 1215 future, including a confidence level in the payload.

1216 Table 5-13: Reports

Report Metadata	Description
<b>Report ID</b>	Unique identifier for this Report. The Report ID persists over multiple Report-Backs.
<b>Report Request ID</b>	Identifies the Request that resulted in this Report.
<b>Report Specifier ID</b>	Identifies the Report Specifier that resulted in this Report.

1217 The above information is sufficient to uniquely identify each Report, why it was made, and to what  
 1218 specifications. The full form of a report is as follows in Figure 5-12.

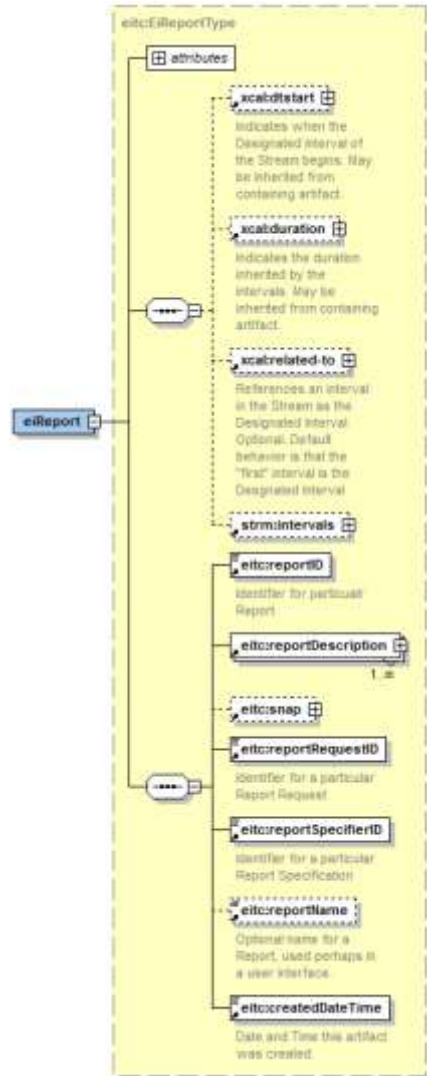

1219  
 1220 Figure 5-12: The Report


### 1221 5.5.1 Elements of the Report

1222 Table 5-14: Elements of Reports

Report Elements	Description
<b>Start Date and Time</b>	Indicates the beginning of the Report

Report Elements	Description
<b>Duration</b>	Indicates the Duration of each Interval in the Report
<b>Related To</b>	Inherited from Stream Base but not used in Reports. Must be Ignored.
<b>Report Name</b>	Optional human-friendly name for the report
<b>Report Description</b>	Type describing the make-up of the report which MAY not be entirely determinable from the Specifier. Also, explains the interpretation of each Value.
<b>Created Date and Time</b>	Indicates when the Report was prepared for delivery to the requestor.

1223 **5.5.2 Report Description**

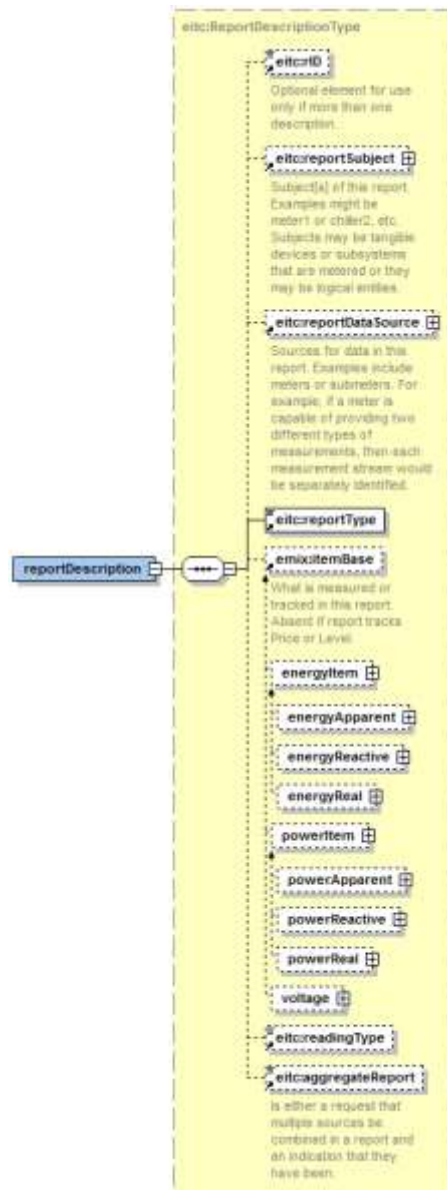

1224  
1225 *Figure 5-13: The Report Description*

1226 The Report Description indicates what is in the Report, which may be different from what was specified,  
 1227 particularly if multiple elements were in the Target. A Report may include multiple Report Descriptions if  
 1228 multiple payloads are delivered in each interval. Conversely, if the Recipient is able to rely completely on  
 1229 the Report Specifier, the Report Description MAY be omitted.

1230 The Elements of the Report Description are as follows:


1231 *Table 5-15: Elements of the Report Description*

Report Elements	Description
<b>rID</b>	Optional report identifier required only if multiple payloads are delivered in each Interval.
<b>Subject</b>	Identifies the specific thing or things being measured in this report. Subject is in the form of a Target, which means it can include one or more Parties, Resources, Assets, Groups, etc.
<b>Data Source</b>	Identifies the Source of the information or measurement provided. A common use is to identify the MRIDs of the meter[s] that apply to the Subject. Data Source is in the form of a Target.
<b>Report Type</b>	Identifies what is the meaning of each measurement, as defined in Section 5.4.1.2.
<b>Item Base</b>	Identifies the Units being measured, unless the Report Type indicates this element is meaningless.
<b>Reading Type</b>	If present, indicates metadata about the Readings, i.e., direct measurement or computation. Conforming profiles MAY ignore Reading Type.
<b>Aggregate Report</b>	Identifies whether each payload represents an individual subject, or the sum of multiple subjects.

### 1232 **5.5.3 Report Payloads**

1233 The details in each Interval in a Report bear a lot of similarity to those in the Signals. In many cases, a  
 1234 Signal requests that a system provide something similar to its Signal Value. Reporting back in the same  
 1235 format enables ready comparisons. These values are conveyed in the Payload.

1236 Signals, though, are ideal. Reports describe real world effects, and therefore messy. For this reason,  
 1237 Report Payloads include some additional information.

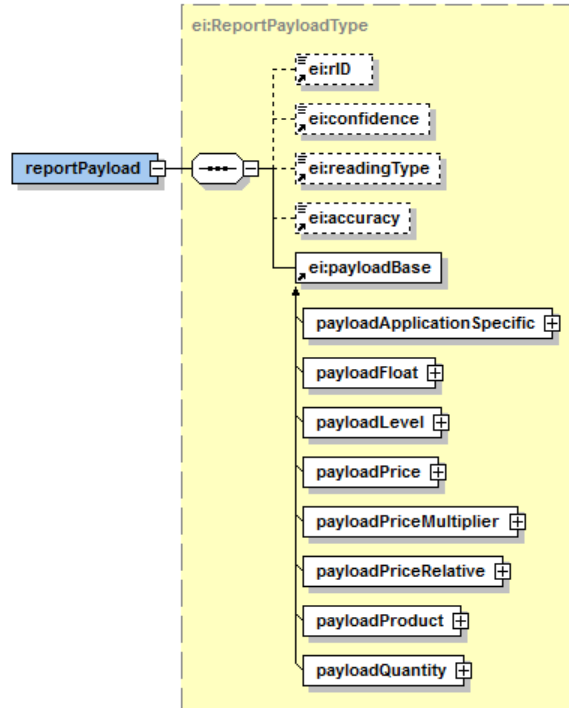

1238  
1239 *Figure 5-14: the Report Payload*

1240 Figure 5-14 shows the information qualifications alongside the Payload. If an Application within a VEN  
1241 has specific reporting requirements, a new Payload Type can be derived from the abstract Payload  
1242 Application Specific type; a type so derived can be delivered by a conforming report service.

1243 *Table 5-16: Report Payload Qualifiers*

Report Metadata	Description
<b>Confidence</b>	An optional information structure that indicates in each interval how likely the information is to be precise.
<b>Reading Type</b>	An enumerated indication of different ways to derive a reading
<b>Accuracy</b>	An indicator of Payload accuracy

1244 **5.5.3.1**

1245 The Reading Type describes the information returned in a report. Specifically, the Reading Type  
1246 describes how the number in the payload was arrived at. The Reading Type MAY be in the stream Gluon,  
1247 and be inherited by each Interval in the Sequence (or by the Snap, if present). The Reading Type MAY  
1248 also appear in any Interval where the reporting system is indicating that one payload differs from others in  
1249 the Sequence. Reading Types are described in Table 5-17.


1250 *Table 5-17: Reading Types*

Reading Type	Description
<b>Direct Read</b>	Reading is read from a device that increases monotonically, and usage must be computed from pairs of start and stop readings.
<b>Net</b>	Meter or [resource] prepares its own calculation of total use over time

Reading Type	Description
<b>Allocated</b>	Meter covers several [resources] and usage is inferred through some sort of pro rata computation.
<b>Estimated</b>	Used when a reading is absent in a series in which most readings are present.
<b>Summed</b>	Several meters together provide the reading for this [resource]. This is specifically a different than aggregated, which refers to multiple [resources] in the same payload. See also Hybrid.
<b>Derived</b>	Usage is inferred through knowledge of run-time, normal operation, etc.
<b>Mean</b>	Reading is the mean value over the period indicated in Granularity
<b>Peak</b>	Reading is Peak (highest) value over the period indicated in granularity. For some measurements, it may make more sense as the lowest value. May not be consistent with aggregate readings. Only valid for flow-rate Item Bases, i.e., Power not Energy.
<b>Hybrid</b>	If aggregated, refers to different reading types in the aggregate number.
<b>Contract</b>	Indicates reading is pro forma, i.e., is reported at agreed upon rates
<b>Projected</b>	Indicates reading is in the future, and has not yet been measured.

1251 **5.5.3.2 Contrasting semantics of Summary and Aggregate in Reports**

1252 Consider the following industrial facility with a single ESI acting as a VEN. This facility chose to offer four  
 1253 Resources to its VTN: one industrial Resource and three office Resources, one for each floor. Two of the  
 1254 office Resources, Floor 2 and Floor 3, have their own zones and meters. Floor 1 has two zones, 1A and  
 1255 1B, that are metered separately. The three office Resources are all in a single Group, Office. The single  
 1256 industrial Resource is in its own Group, Factory.

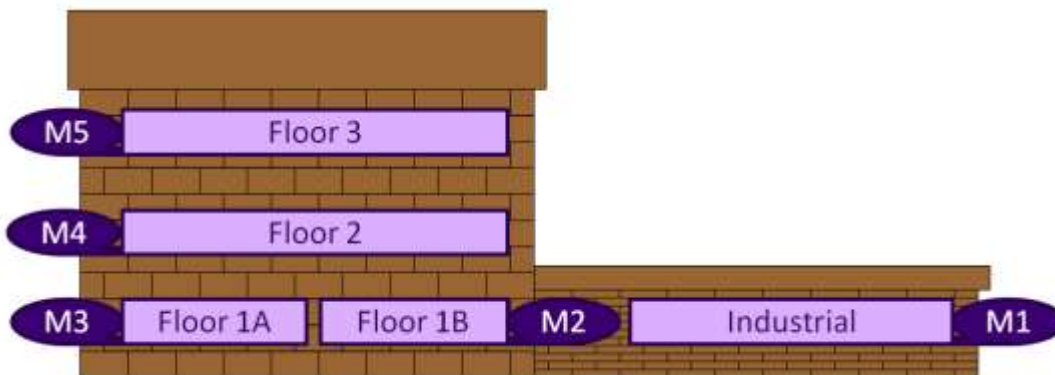

1257  
 1258 *Figure 5-15: Illustrating Aggregate vs. Summary*

1259 A Usage report with a Target of Office applies to three Resources, Floor 1, Floor 2, and Floor 3. If the  
 1260 Aggregate flag is True, the VEN prepares a single report that aggregates the information from all three  
 1261 Resources. If a report Target indicates Industrial or Factory, Group or Resource, there is no distinction  
 1262 between an Aggregate or non-Aggregate request.

1263 The Data Sources for the Usage Reports are the Meters, M1-M5. The Report for Floor 3 has a Data  
 1264 Source of M5. The Report for Floor 2 has a Data Source of M4. The Report for Floor 1 has two data  
 1265 sources, M2 and M3, and the single Reading for Floor 1 is of the Type "Summary"

1266 Aggregate refers to the combining of multiple Subjects (things named in Target) into a single report;  
 1267 Summary refers to the combination of multiple Data Sources [meters] into a single value.

1268 **5.5.4 UML Diagram of Report**



1269  
 1270 *Figure 5-16: UML Class Diagram of Reports*  
 1271

1272 **5.6 Reponses and Error Reporting**

1273 All Services share a common Response. The Response shares a common extensible code, a readable  
 1274 description, and a reference to the Message that this is in response to.

1275 *Table 5-18: Responses*

Response Elements	Description
<b>EI Response</b>	Response is the generic model for responding to any Servicer Request
<b>Response Code</b>	<p>Code consisting of 3 digits for automated processing. The simplest devices need understand only the first digit, others are for extension as needed within the higher order error indicated by the first digit.</p> <ul style="list-style-type: none"> <li>• 1xx: Informational - Request received, continuing process</li> <li>• 2xx: Success - The Request was successfully received, understood, and accepted</li> <li>• 3xx: Pending - Further action must be taken in order to complete the Request</li> <li>• 4xx: Requester Error - The request contains bad syntax or cannot be fulfilled</li> <li>• 5xx: Responder Error - The responder failed to fulfill an apparently valid request</li> </ul> <p>xx is used for defining more fine grained errors. Where possible, the HTTP errors should be used.</p>
<b>Response Description</b>	Optional String describing the response or the reason for the response
<b>Message UID</b>	Reference to the Message that elicited this response
<b>Response Terms Violated</b>	Optional Array of EMIX Terms and Response Descriptions to provide a machine interpretable Response. For example, if the Request fails because it violated the "Minimum Notification Duration" of one hour, the responder could send back the Term (with value) and an Response Description.

1276

## 1277 5.6.1 Event Responses

1278 Responses to events are not stateless, so they require further information. All Responses regarding  
1279 Events have the elements in Table 5-19 in addition to the elements listed in Table 5-18.

1280 *Table 5-19: Event Response*


Event Responses	Description
<b>Event ID</b>	ID of the Event which caused this Response
<b>Modification Number</b>	Modification Number of the Message about an Event that caused this Response
<b>Opt Type</b>	Indicates whether this Response results in a VEN Opting In or Opting Out of the Event.

1281 Some services communicate multiple messages, and the different messages may warrant different  
1282 responses. In these cases, there is a single EiResponse (or EiEventResponse) which **reports on the**  
1283 conveys an overall response. If this overall response is Success (2xx), then there is no need for the  
1284 recipient to examine the message further. If the overall Response is anything other than success, then  
1285 the response for each Element in the original Request can be found by examining the array of responses  
1286 (type responses) or the array of Event Responses (type eventResponses) for detailed information.



1287 **5.6.2 References in Responses**

1288 Response is a general Type that must reference any number of messages, reports, requests, etc. These  
 1289 critical cross interaction types are each identified by a Reference ID. The Reference ID for each is derived  
 1290 from a common refID type that enables type-safe substitution in Response and in other payloads.

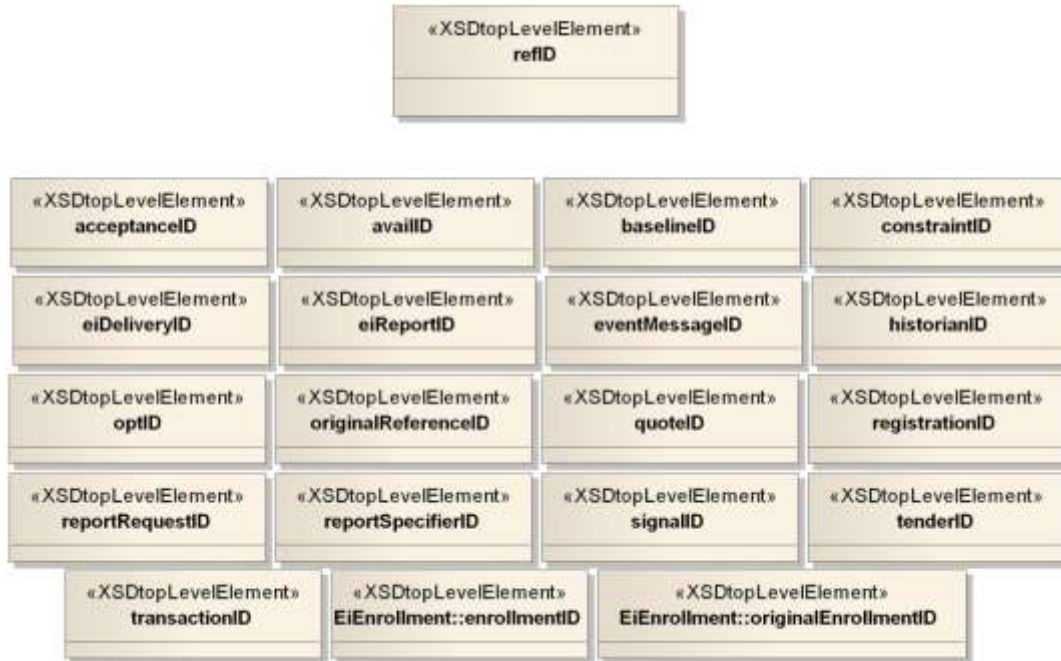

1291  
 1292 *Figure 5-17: UML Diagram showing refID and its derived types*

1293 **5.7 Availability Behavior**

1294 In different Market Contexts, Availability is interpreted differently by the VTN. This availability behavior is  
 1295 published as part of the EI Market Context as it is in effect a meta-term for the market.

1296 *Table 5-20: Availability Behavior*

Availability Behavior	Description
<b>Behavior</b>	When an Event is issued by the VTN, it is validated against the parameters and constraints that were established when the Market Context was set up, i.e., the market Rules support Events between 12:00 and 16:00. If the Event is not within 12:00 and 16:00 then VEN must take some action to resolve the conflict.
<b>Accept</b>	Simply accept the issued DR event regardless of any conflicts
<b>Reject</b>	Reject any DR events that conflict with configured Availability
<b>Restrict</b>	Modify the DR event parameters so that they legally fall within the bounds of the configured parameters.

1297

---

## 1298 6 Introduction to Services and Operations

1299 In the following sections services and operations consistent with **[SOA-RM]** are described. For each  
1300 service operation there is an actor that *invokes* the service operation and one that *provides* the service.  
1301 These roles are indicated by the table headings *Service Consumer* for the actor or role that consumes or  
1302 invokes the service operation named in the *Operation* column and *Service Provider* for the actor or role  
1303 that provides or implements the service operation as named in the *Operation* column.

1304 This terminology is used through all service definitions presented in this specification.

1305 The column labeled *Response Operation* lists the name of the service operation invoked as a response.  
1306 Most operations have a response, excepting primarily those operations that broadcast messages. The  
1307 roles of *Service Consumer* and *Service Provider* are reversed for the *Response Operation*.

1308 All communication between customer devices and energy service providers is through the ESI.

1309 For transactive services any party may receive tenders (priced offers) of service and possibly make  
1310 tenders (priced offers) of service.

1311 Any party using Transactive Energy services may own generation or distributed generation or reduce or  
1312 increase energy from previously transacted energy amounts. These activities are not identified in  
1313 transactive services. The dispatch of these resources and the use of energy by a party are influenced by  
1314 tenders between Parties that may result in new Transactions and changes in operations.

1315 The VEN/VTN services provide a characterization of the aggregate resources of a VEN that may be  
1316 communicated to the VTN; that relationship depends also on the EiMarketContext in which the  
1317 interactions take place.

1318 The next section describes the role of Resources, Curtailment and Generation. In a transactive approach  
1319 tendering and prices are used by parties to discover and negotiate transactions that respect the  
1320 preferences of each party and energy usage, generation, storage and controllability directly available to  
1321 each party. There is no formal communication of resource characteristics in the transactive approach.

### 1322 6.1 Resources, Curtailment, and Generation

1323 If the VEN participates in a demand response program or provides distributed energy resources, its ESI is  
1324 the interface to at least one dispatchable resource (Resource), that is, to a single logical entity. A  
1325 Resource may or may not expose any fine structure.<sup>6</sup> The Resource terminology and the duality of  
1326 generation and curtailment are from **[EMIX]**.

1327 Under a demand response program, a Resource is capable of shedding load in response to Demand  
1328 Response Events, Electricity Price Signals or other system events (e.g. detection of under-frequency).  
1329 The VTN can query the actual state of a Resource with the EiReport service and request ongoing  
1330 information. The VEN can query the status of the VTN-VEN relationship using the EiRequestEvent  
1331 operation.

1332 Alternatively, a Resource may provide generation in response to similar information. The net effect is the  
1333 same.

### 1334 6.2 Structure of Energy Interoperation Services and Operations

1335 Energy Interoperation defines a web services implementation to formally describe the services and  
1336 interactions although fully compliant services and operations may be implemented using other  
1337 technologies.

1338 The services presented in this specification are divided into five broad categories:

---

<sup>6</sup> A finer level of granularity is sometimes called an *asset*. Assets are not in scope for this specification.

- 1339 • Transactive Services—for implementing energy transactions, registration, and tenders
- 1340 • Event Services—for implementing events and linked Reports
- 1341 • Report Services—for exchanging remote sensing and feedback.
- 1342 • Enrollment Services—for identifying and qualifying service providers, resources, and more
- 1343 • Support Services—for additional capabilities

1344 The structure of each section is a table with the service name, operations, service provider and  
 1345 consumer, and notes in columns.

1346 The services are grouped so that profiles can be defined for purposes such as price distribution, and  
 1347 Demand Response (with the functionality of **[OpenADR]**). This specification defines three profiles, the  
 1348 OpenADR Profile, the TeMIX (Transactive EMIX) Profile, and the Price Distribution Profile.

1349 The normative XML schemas are in separate files, accessible through the **[namespace]** on the cover  
 1350 page.

### 1351 **6.3 Naming of Services and Operations**

1352 The naming of services and operations follows a pattern. Services are named starting with the letters *Ei*  
 1353 capitalization which follows the Upper Camel Case convention. Operations in each service use one or  
 1354 more of the following patterns. The first listed is a fragment of the name of the initial service operation; the  
 1355 second is a fragment of the name of the response message which acknowledges receipt, describes  
 1356 errors, and may pass information back to the invoker of the first operation.

1357 *Create—Created* An object is created and sent to the other Party

1358 *Cancel—Canceled* A previously created request is canceled

1359 *Request—Reply* A request is made for all objects of the specified type previously created and relevant  
 1360 to this VTN-VEN relationship

1361 *Distribute* An object (such as a price quote, a curtailment or generation request) is created and  
 1362 sent without expectation of response.

1363 For example, to construct an operation name for the *EiEvent* service, "Ei" is concatenated with the name  
 1364 fragment (verb) as listed. For example, an operation to cancel an outstanding operation or event is called  
 1365 *EiCancelEvent*.

1366 The pattern of naming is consistent with current work in the IEC Technical Committee 57 groups  
 1367 responsible for the **[TC57CIM]**.

### 1368 **6.4 Push and Pull Patterns**

1369 The Service Operation naming includes application-level acknowledgements, which in nearly every case  
 1370 carry application-level information, and allow for both push and pull of messages. This description applies  
 1371 to both transactive and VTN/VEN interactions as both are performed by Parties taking on various roles.

1372 | **Both** Push and Pull are with respect to the invoker of the operation. So if a Party produces information  
 1373 that describes a price quote, it can invoke (in the case of Push) an operation to send it to one or more  
 1374 other Parties. In the alternative, each Party (in the case of Pull) can invoke a request for information by  
 1375 | polling, or pulling it, from another Party ~~respect to a particular relationship or Market Context~~.

1376 The Pull operation is performed by the Party invoking the Request service operation pattern and fulfilled  
 1377 with a Reply service operation pattern invoked by the receiving Party.

1378 So a series of Push operations from one Party to a counter-Party is analogous to a series of Pull  
 1379 operations from the counter-Party to the Party.


1380 In the VTN-VEN context, a series of Push operations from a VTN to its VENs is analogous to a series of  
 1381 Pull operations from the VEN to its VTN; by examining (e.g.) the absence of an Event that was visible on  
 1382 a previous Pull the VEN can infer that that Event was canceled. The VEN could then send a Canceled  
 1383 service operation as if it had received a Cancel service operation.

1384 One special case is the *Distribute* pattern, which expects no response to the invoker.

1385 The service quality of the Pull operations (and in particular the load on the VTN from repeated polling) is  
1386 not in scope for this specification.

## 1387 6.5 WSDL Integration

1388 A WSDL represents a contract between two systems that are being integrated. As such additional  
1389 attributes may need to be passed in addition to the attributes that are specific to a message payload  
1390 (representing the core set off information being passed). At a high level, any given integration may need  
1391 to include a header, request, and/or reply in addition to the message payload as shown in the figure  
1392 below.

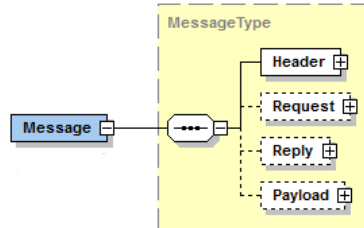

1393

1394 *Figure 6-1: Generalized view of the high-level message structure*

1395 For example, for WSDL-based integration **in which information regarding a demand response event,**  
1396 details regarding the specifics of **thea demand response** event are contained in the message payload.  
1397 However, additional details that work to ensure the successful integration may be included in the header,  
1398 request, or reply.

1399 A message header contains information about the sender and receiver of the message or other  
1400 information used to correlate the service request, to guarantee delivery, or to support non-repudiation as  
1401 seen in the [non-normative] figure below.

1402 Message headers are out of scope for this specification.

## 1403 6.6 Description of the Services and Operations


1404 Each service is described as follows. In the sections that follow, we will:

- 1405 • Describe the service
- 1406 • Show the table of operations
- 1407 • Show the interaction patterns for the service operations in graphic form
- 1408 • Describe the information model using **[UML]** for key artifacts used by the service
- 1409 • Describe the operation payloads using **[UML]** for each operation

## 1410 6.7 Responses

1411 In a service interaction, responses may need to be tracked to determine if the transaction is successful or  
1412 not. This may be complicated by the fact that any given transaction may involve the transmission of one  
1413 or more information objects.

1414 The class diagram below reflects the generic response.

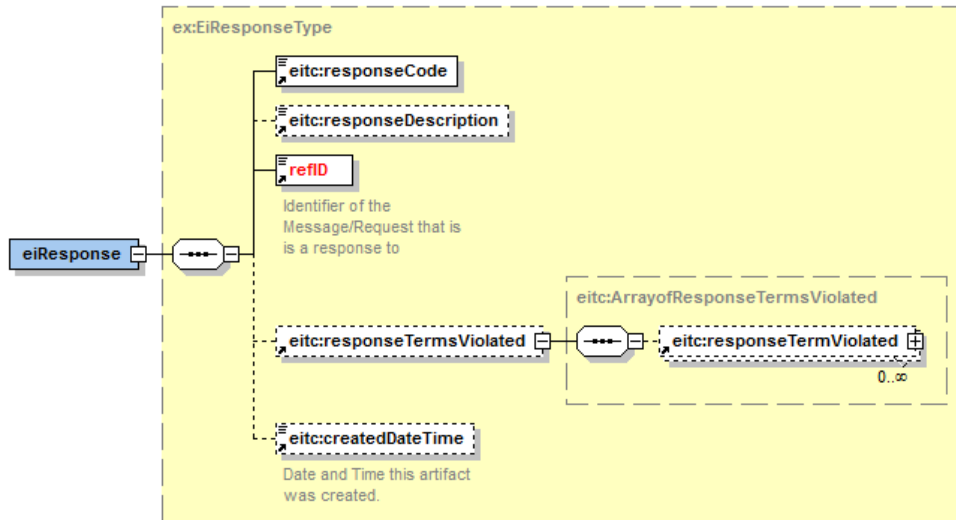

1415  
1416

1417 *Figure 6-2: Example of generic error response for a service operation*

1418 The Reference ID (refID) identifies the artifact or message element that this response is to. The response  
1419 code indicates success or failure of the operation requested. The Response Description is unconstrained  
1420 text, perhaps for use in a user interface.

1421 There is no exhaustive list of all possible Response Codes. The Response Codes are intended to enable  
1422 even the smallest device to interpret Response. This specification uses a pattern consisting of a 3 digit  
1423 code, with the most significant digit sufficient to interpret success or failure. This pattern is intended to  
1424 support that smallest device, while still supporting more nuanced messages that may be developed.

- 1425 • 1xx: Informational - Request received, continuing process
- 1426 • 2xx: Success - The action was successfully received, understood, and accepted
- 1427 • 3xx: Pending - Further action must be taken in order to complete the request
- 1428 • 4xx: Requester Error - The request contains bad syntax or cannot be fulfilled
- 1429 • 5xx: Responder Error - The responder failed to fulfill an apparently valid request

1430 While the only value of xx that is defined as of this version is 00, conforming specifications may extend  
1431 these errors to defining more fine grained errors. These errors should extend the pattern above, though.  
1432 A response code such as 403 should always be within the realm of Requester Error.

### 1433 **6.7.1 Terms Violated**

1434 Terms Violated is an optional element of a Response. Terms communicate business expectations. It may  
1435 be that a Service Request fails not because it is improperly formed, but because it violates one or more of  
1436 these business rules. For example, a Market Term may indicate a 20 minute notification duration. A  
1437 Service Request that asks for a performance with only a 5 minute notification violates that Term. By  
1438 passing that Term back in the Response, that service provider can make known what its requirements  
1439 are.

1440 It is outside the scope of this specification whether a provider MAY present terms while still accepting a  
1441 Service.

### 1442 **6.7.2 Response Derivations**

1443 Because some responses require additional context relative to the Service requested, the same types  
1444 derive from and extend the Response type.

### 1445 **6.7.2.1 Event Responses**

1446 Event Responses are derived from the Response Type and add elements useful for Event-based  
1447 interactions. Event Responses include Event ID and Modification Number to indicate exactly which Event  
1448 they are responding to. Event Responses also include the Opt Type (Opt In or Opt Out) to describe what  
1449 response is being made to an event.

### 1450 **6.7.2.2 Enrollment Responses**

1451 Enrollment Responses are derived from the Response Type and add elements useful for Event-based  
1452 interactions. The Enrollment response includes an Enrollment ID to indicate which Enrollment is being  
1453 referenced.

1454 Enrollment establishes a business relationship between a Party and a particular Market Context. A Party  
1455 may be enrolled in several Market Contexts. Enrollment Responses include the Market Context that is  
1456 affected by the Response.

1457 A single request to Enroll may create many Enrollment IDs. For example, a Party offering several  
1458 Resources may get an Enrollment ID for each. Similarly, a single Resource may become enrolled in both  
1459 a power and a regulation Market Context. An Enrollment Response includes a Market Context to indicate  
1460 which Market Context was affected.


1461 As stated above, a single request to Enroll may create many Enrollment IDs. It can be helpful to know the  
1462 original request's reference ID to understand the Response. An Enrollment Response MAY include an  
1463 Original Reference ID.

### 1464 **6.7.3 Compound Responses**

1465 Many service interactions may affect a number of messages. For examples, a single service interaction  
1466 may include multiple Tenders, or Events. A single Enrollment request may result in multiple Enrollments.  
1467 All such Responses have the pattern of a single Response (or Event Response, or Enrollment Response)  
1468 accompanied by a collection of Responses. This specification defines the collections of Responses,  
1469 Event Responses, and Enrollment Responses.

1470 The end-point receiving a compound Service Payload, including both single Responses and collections of  
1471 Responses ~~can follow the following~~ follows these rules-:

- 1472 - If the Response indicates success, there is no need to examine each element in the Responses.
- 1473 - If some elements fail and other succeed, the Response will indicate the error, and the recipient  
1474 should evaluate each element in the Responses to discover which components of the operation  
1475 failed.

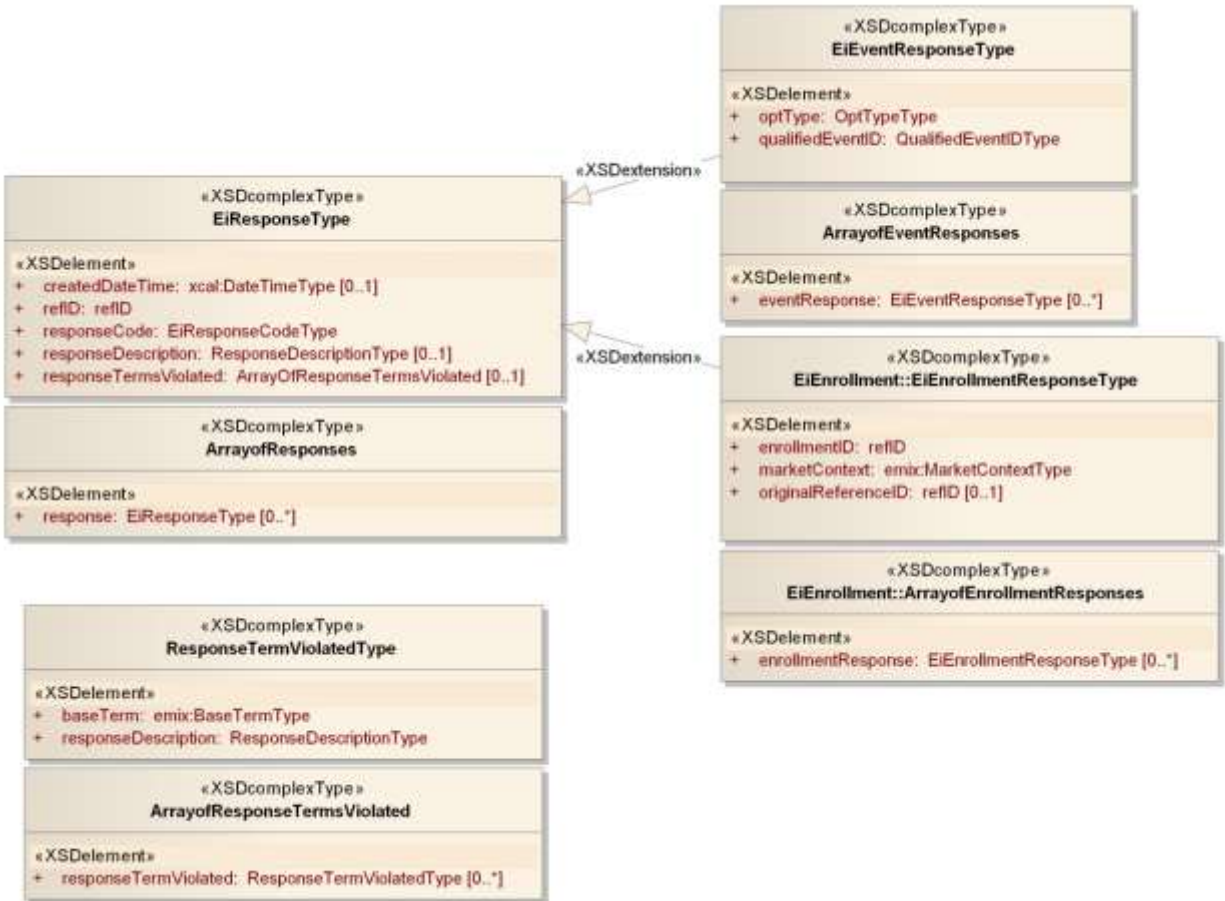

1476  
1477 *Figure 6-3: UML for Response*

1478 **6.7.3.1 Summary of Response and Responses**

1479 A Response returns the success or failure of the entire operation. The **rR**esponses returns an ID- and a  
1480 **rR**esponse for each.  
1481 It is MANDATORY to return errors in responses. It is OPTIONAL to return successes in responses. For  
1482 Cancel, in particular, it is not mandatory to return any responses if the entire operation was completed  
1483 successfully. The pattern is to return those that have failed (required) and those that succeeded  
1484 (optional).

1485 **6.7.4 Requests**

1486 Each of the Services includes a Request, which is essentially a status update. ~~For~~ **Consider the** Service  
1487 Foo-, **A Request means** “tell me all the Foos that we have outstanding-.” The meaning of **O**utstanding  
1488 varies from Service to Service. In general, either party may make invoke the Request **operationsService**  
1489 on the other. Tell me all the Quotes you have given me is the mirror of Tell me all the Quotes you have  
1490 received from ~~Me;~~ **both Requests share me. Each Request shares** the same semantics.

1491 Each optional element in a Request refines or narrows the scope of the Request by **requestingnarrowing**  
1492 **the request to** only those Foos for which the named elements match. If there are more than one instance  
1493 of the same named element, then this restriction element is treated as if a logical OR were applied, i.e.,  
1494 where element = A OR element = B. Where more than one type of element is named, then the restriction  
1495 is treated as an AND, i.e., element A = “foo” AND element B = “fie”.

1496 A special element that is included in most Requests is the Interval. The Interval is treated as a temporal  
1497 restriction. For example, an Interval that encompasses a business day can request all Foo for delivery on  
1498 that day. Intervals MAY be open-ended. An Interval conveying only a Start Date matches all Foo that

1499 | isare current from that date and time forward. An Interval conveying only an End Date matches all Foo  
1500 | that isare current at that date and time. If there is any ambiguity about what “matches” means, it is  
1501 | defined within the Service section below, c.f., the definition of pending Events in Section 9.2 “*Special*  
1502 | *Semantics of the Event Request Operations*”.



---

## 7 Transactive Services

1503

1504 Transactive Services define and support the lifecycle of transactions inside an overarching agreement,  
1505 from initial quotations and indications of interest to final settlement. The phases are

- 1506
- Registration—to enable further phases.
  - 1507 • Pre-Transaction —non-binding quotes and binding tenders for transactions.
  - 1508 • Transaction Services—execution and management of transactions including transaction with  
1509 optionality.
  - 1510 • Post-Transaction—settlement, energy used or demanded, payment, position.

1511 For transactive services, the roles are **Parties** and **Counterparties**. For event and resource services, the  
1512 Parties adopt a VTN or VEN role for interactions. The terminology of this section is that of business  
1513 agreements: tenders, quotes, and transaction execution and (possibly delayed) performance under an  
1514 option or DR transaction.

1515 The register services identify the parties for future interactions. This is not the same as (e.g.) a program  
1516 registration in a demand response context—here, registration can lead to exchange of tenders and  
1517 quotes, which in turn may lead to a transaction which will determine the VTN and VEN roles of the  
1518 respective parties.

### 7.1 EiRegisterParty Service

1519  
1520 The EiRegisterParty service operations create a registration for potential Parties in interactions. This is  
1521 necessary in advance of an actor interacting with other parties in various roles such as VEN, VTN,  
1522 tenderer, and so forth.

1523 *Table 7-1: Register Services*

<i>Service</i>	<i>Operation</i>	<i>Response</i>	<i>Service Consumer</i>	<i>Service Provider</i>	<i>Notes</i>
EiRegisterParty	EiCreateParty Registration	EiCreatedParty Registration	Party	Party	Create and send a Party Registration request
EiRegisterParty	EiRequestParty Registration	EiReplyParty Registration	Party	Party	Request semantics with optional Interval
EiRegisterParty	EiCancelParty Registration	EiCanceledPartyRegistration	Party	Party	Cancel one or more Party Registrations

1524

1525

1526

### 1527 7.1.1 Interaction Pattern for the EiRegisterParty Service

1528 This is the [UML] interaction diagram for the EiRegisterParty Service



1529

1530 *Figure 7-1: Interaction Diagram for EiRegisterParty Service*

### 1531 7.1.2 Information Model for the EiRegisterParty Service

1532 The details of a Party are outside the scope of this specification. The application implementation needs to  
1533 identify additional information beyond that in the class EiParty.



1534

1535 *Figure 7-2: EiParty UML Class Diagram*

1536 **7.1.3 Operation Payloads for the EiRegisterParty Service**

1537 The [UML] class diagram describes the payloads for the EiRegisterParty service operations.



1538

1539 *Figure 7-3: UML Class Diagram for EiRegisterParty Service Operation Payloads*

1540 **7.2 Pre-Transaction Services**

1541 Pre-transaction services are those between parties that may or may not prepare for a transaction. The  
 1542 services are EiTender and EiQuote. A quotation is not a tender, but rather a market price or possible  
 1543 price, which needs a tender and acceptance to reach a transaction.

1544 Price distribution, which is sometimes referred to as *price signals*, is accomplished using the EiQuote and  
 1545 EiTender services. Quotes are indications of a possible tender price; they are not actionable. A Tender  
 1546 offers prices at which Transactions may be made; they are actionable.

1547 As with other services, a Party MAY inquire from a counterparty what offers the counterparty  
 1548 acknowledges as open by invoking the EiSendTender service to receive the outstanding tenders.

1549 There is no operation to “delete” a quote; when a quote has been canceled the counterparty MAY delete  
 1550 it at any time. To protect against recycled or dangling references, the counterparty SHOULD invalidate  
 1551 any identifier it maintains for the cancelled quote.

1552 Tenders, quotes, and transactions are **[EMIX]** artifacts, which contain terms such as schedules and prices  
 1553 in varying degrees of specificity or concreteness.

1554 *Table 7-2: Pre-Transaction Tender Services*

Service	Operation	Response	Service Consumer	Service Provider	Notes
EiTender	EiCreateTender	EiCreatedTender	Party	Party	Create and send Tender
EiTender	EiRequestTender	EiReplyTender	Party	Party	Request outstanding Tenders; request semantics with optional time Interval
EiTender	EiCancelTender	EiCanceledTender	Party	Party	Cancel one or more Tenders
EiTender	EiDistributeTender	—	Party	Party	For broadcast or distribution of Tenders

1555


1556 *Table 7-3: Pre-Transaction Quote Services*

Service	Operation	Response	Service Consumer	Service Provider	Notes
EiQuote	EiCreateQuote	EiCreatedQuote	Party	Party	Create and send a quote
EiQuote	EiRequestQuote	EiReplyQuote	Party	Party	Request outstanding Tenders; request semantics with optional time Interval
EiQuote	EiCancelQuote	EiCanceledQuote	Party	Party	Cancel one or more quotes
EiQuote	EiDistributeQuote	--	Party	EiTarget	For broadcast or distribution of quotes

1557

## 1558 7.2.1 Interaction Pattern for the EiTender and EiQuote Services


1559 This is the [UML] interaction diagram for the EiTender Service.

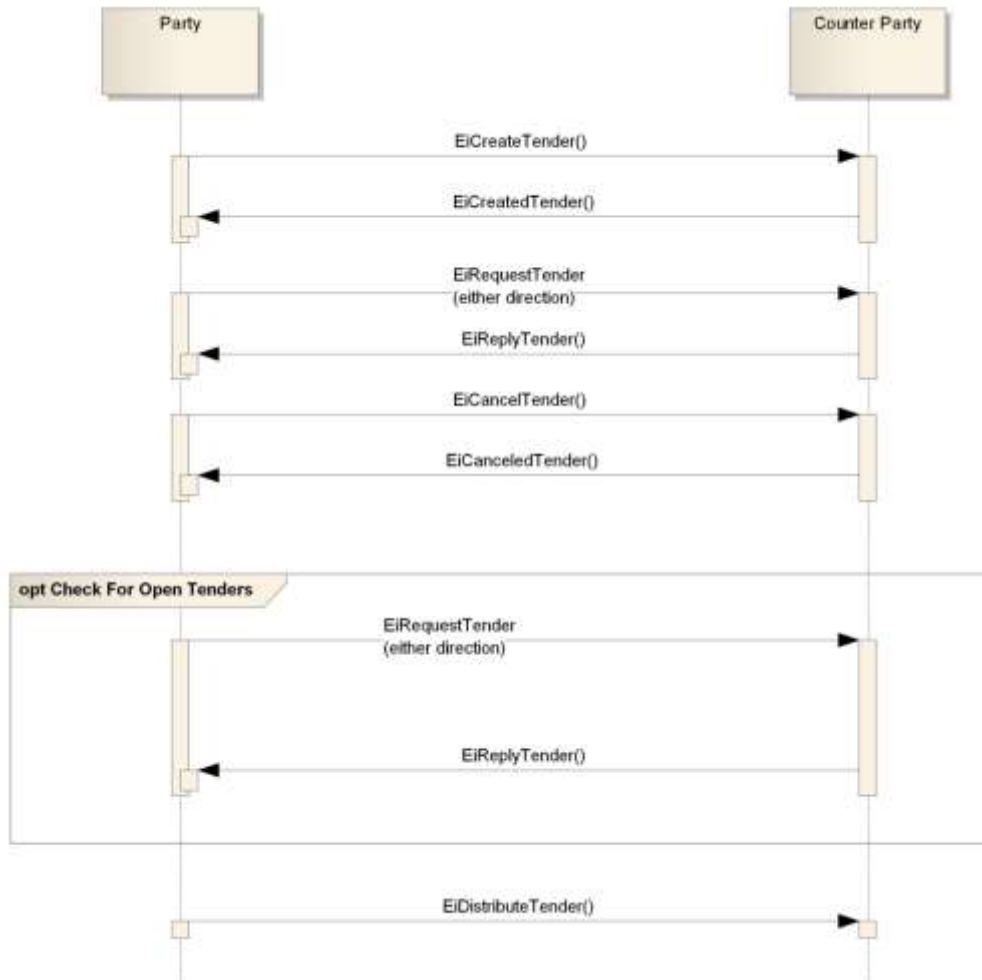

1560

1561 *Figure 7-4: Interaction Diagram for the EiTender Service*

1562 This is the [UML] interaction diagram for the EiQuote Service

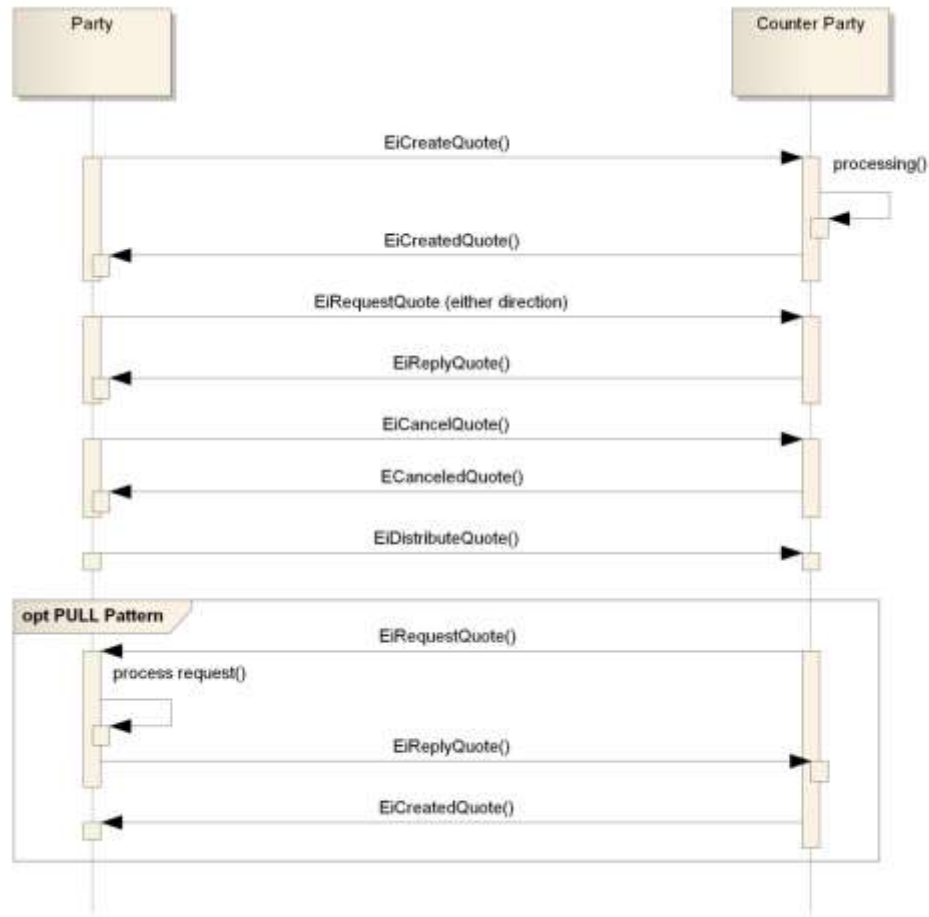

1563

1564 *Figure 7-5: Interaction Diagram for the EiQuote Service*

## 1565 7.2.2 Information Model for the EiTender and EiQuote Services

1566 The information model for the EiTender Service and the EiQuote Service artifacts is that of [EMIX]. EMIX  
1567 provides a product description as well as a schedule over time of prices and quantities.

1568 **7.2.3 Operation Payloads for the EiTender Service**

1569 The [UML] class diagram describes the payloads for the EiTender and EiQuote service operations.



1570  
 1571 *Figure 7-6: UML Class Diagram for the Operation Payloads for the EiTender Service*  
 1572

1573 **7.2.4 Operation Payloads for the EiQuote Service**



1574  
1575 *Figure 7-7: UML Class Diagram for the EiQuote Service Operation Payloads*

1576 **7.3 Transaction Management Services**

1577 The service operations in this section manage the exchange of transactions. For example, in demand  
 1578 | response, the `{overarching}` agreement is the context in which events and response take place—what is  
 1579 often called a *program*. This agreement is identified by the information element Market Context here and  
 1580 elsewhere.



1581 | There ~~are~~ no EiCancelTransaction or EiChangeTransaction operations. As in distributed agreement  
 1582 | protocols, a compensating transaction SHOULD be created to clarify the economic effect of the  
 1583 | reversals needed to compensate for any effects.<sup>7</sup>

1584 | Table 7-4: Transaction Management Service

Service	Operation	Response	Service Consumer	Service Provider	Notes
EiTransaction	EiCreateTransaction	EiCreatedTransaction	Party	Party	Create and send Transaction
EiTransaction	EiRequestTransaction	EiReplyTransaction	Party	Party	Request extant Transactions

1585 | **7.3.1 Interaction Patterns for the EiTransaction Service**

1586 | This is the [UML] interaction diagram for the EiTransaction Service:



1587 |  
 1588 | Figure 7-8: Interaction Diagram for the EiTransaction Service

1589 | **7.3.2 Information Model for the EiTransaction Service**


1590 | Transactions are [EMIX] artifacts with the identification of the Parties.

---

<sup>7</sup> This is consistent with the way that distributed agreement protocols such as [WS-BusinessActivity] manage compensation rather than cancellation.

1591 **7.3.3 Operation Payloads for the EiTransaction Service**


1592 The [UML] class diagram describes the payloads for the EiTransaction service operations.

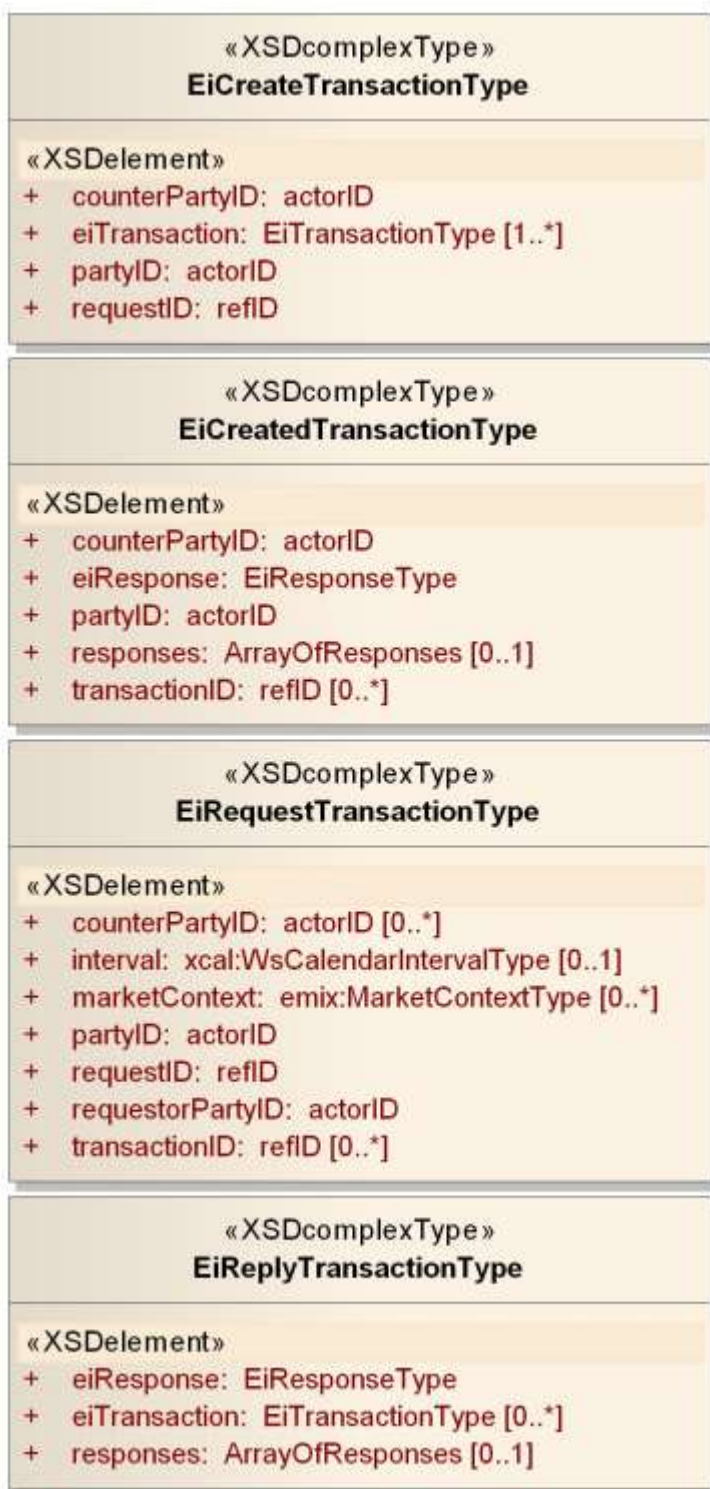

1593

1594 *Figure 7-9: UML Class Diagram of EiTransaction Service Operation Payloads*

## 7.41.1 Comparison of Transactive Payloads

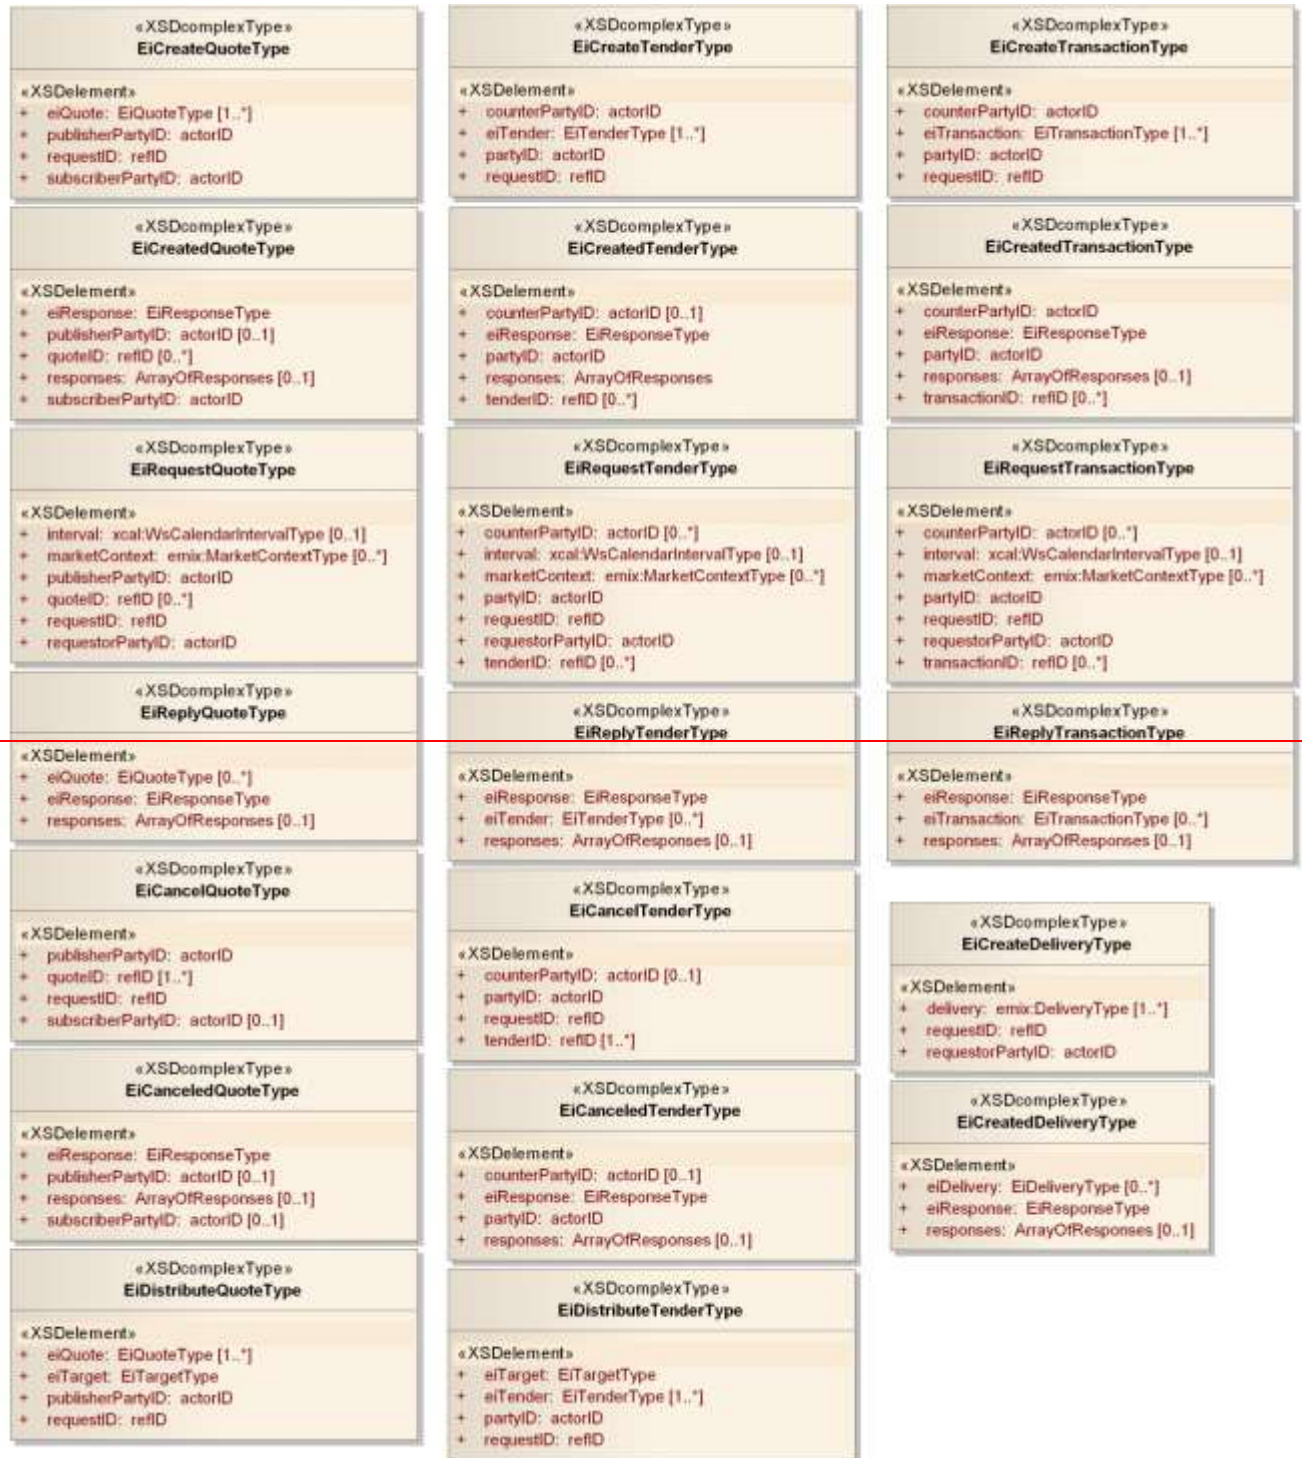

1596

1597 *Figure --: UML Diagram comparing all Transactive Payloads*

## 1598 7.57.4 Post-Transaction Services

1599 In a market of pure transactive energy, verification would be solely a function of meter readings. The seed  
 1600 standard for smart grid meter readings is the NAESB Energy Usage Information [NAESB EUI]  
 1601 specification.

1602 In today's markets, with most customers on Full Requirements tariffs, the situation is necessarily more  
 1603 complex. Full Requirements describes the situation where purchases are not committed in advance. The  
 1604 seller is generally obligated to provide all that the buyer requires. Full requirements tariffs create much of  
 1605 the variance in today's DR markets.

1606 These sections will apply a measurement model consistent with the [NAESB EUI] as in the EiReport  
 1607 Services.

1608 **7.5.17.4.1 Energy Delivery Information**

1609 These service operations respond with Energy Usage Information or any other single item of interest to  
 1610 the caller. This is very simple, requesting one thing measured for one interval, and waiting to return a  
 1611 value until the information is available. For anything more complex the Report Services should be used.

1612 *Table 7-5: Energy Delivery*

Service	Operation	Response	Service Consumer	Service Provider	Notes
EiDelivery	EiCreateDelivery	EiCreatedDelivery	Party	Party	Party-to-Party, specifying interval, what is to be measured, and the direction for the measurement

1613

1614 **7.5.1.17.4.1.1 Interaction Pattern for the EiDelivery Service**




1615

1616 *Figure 7-10: Interaction Diagram for Delivery Service*


1617 **7.5.1.27.4.1.2 Information Model for the EiDelivery Service**

1618 The EiDelivery Type is a simplified EiReport.

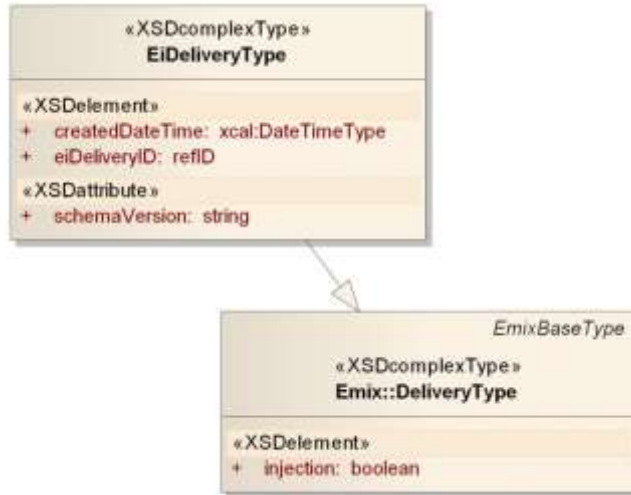

1619  
1620 *Figure 7-11: UML of EiDelivery Type*


1621 **7.5.1-37.4.1.3 UML of Operation Payloads for the EiDelivery Payloads Service**

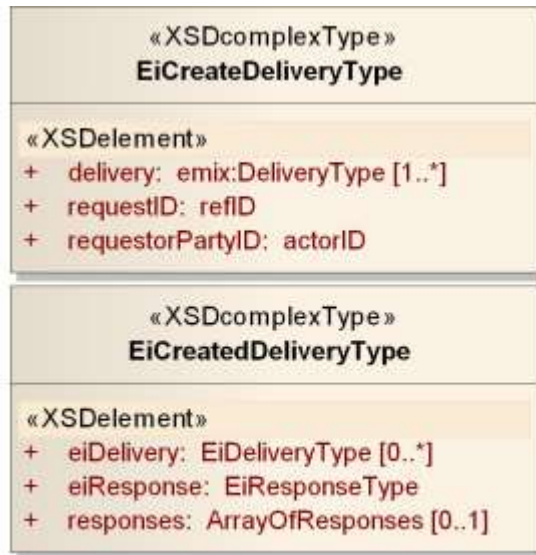

1622  
1623 *Figure 7-12: UML Class Diagram of Delivery and Delivery Payload*

1624

## 7.5 Comparison of Transactive Payloads

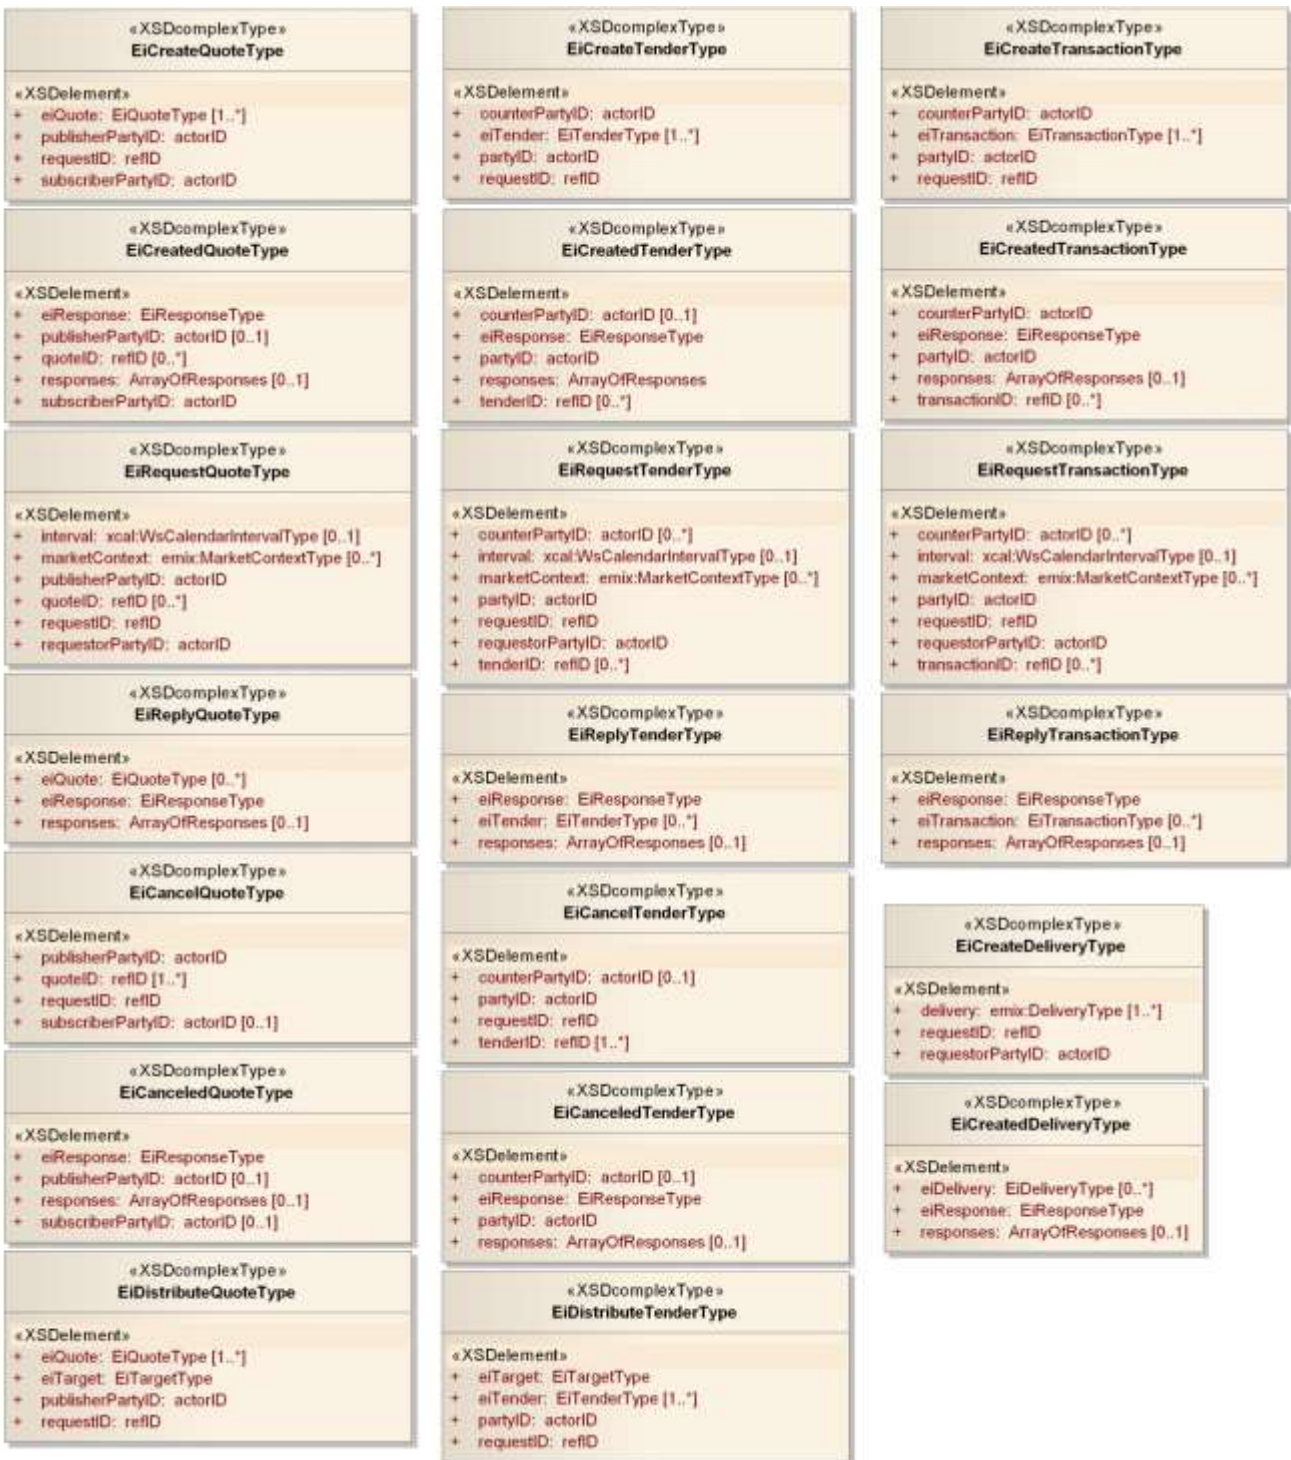

1626

1627

1628

Figure 7-13: UML Class Diagram of Delivery and Delivery Payload comparing all Transactive Payloads

## 1629 8 Enroll Service

1630 Enrollment is distinct from Registration in Energy Interoperation. Registration establishes an identity for  
 1631 an actor (a party or a device such as a generator or a meter on a premise). Enrollment establishes a  
 1632 relationship between two actors as a basis for further interactions. Energy Interoperation supports two  
 1633 classes of interactions; Transactive and VTN/VEN interactions.

1634 In the case of enrollment in Transactive Interactions, the Enrollment Service identifies the two parties and  
 1635 the Enabling Agreement, Market, Tariff, Purchasing, Selling, etc. that the parties agree to use for their  
 1636 interactions.

1637 In the case of enrollment in a VTN/VEN relationship the enrollment service identifies the two actors,  
 1638 generally a registered Resource and a Service Provider acting as a Designated Dispatch Entity (DDE).  
 1639 Registration of a Resource may sometimes be automatic with enrollment of the Resource.

1640 The entities described in the following table can be enrolled. These are described in the [UML] diagrams  
 1641 as concrete classes that inherit from the Enrollee type. The strings are used to describe the entity; the  
 1642 standard approach to extensibility where a prefix of "x-" indicates an extension SHALL be used.

1643 The types of entity used may depend on the implementation. All implementations SHALL support  
 1644 Resources.

1645 *Table 8-1 Enrollee Descriptions*

Entity	String	Description	Comment
Aggregator	aggregator	An entity that combines or aggregates generation or consumption	
Consumer	customer	An entity that is generally a net consumer of electricity	
Distribution	distribution	An entity that distributes electricity	E.g. a distribution utility
Enrolling Authority	enrollingAuthority	An entity that can perform enrolling services	
Generator	generator	An entity that is generally a net producer of electricity	
Load Serving Entity	lse	An entity which supports loads rather than generation	
Market	market	A Market that enrolls in another Market Context	
Meter Authority	meterAuthority	An entity that provides metering services	
Resource	resource	An EMIX Resource with additional information	A Resource including performance envelope and additional information including Resource Name

Entity	String	Description	Comment
Scheduling Entity	schedulingEntity	An entity that provides scheduling services	
Service Provider	serviceProvider	An entity that provides services	A potential provider of services to the VTN in support of VTN business processes
Supplier	supplier	An entity that is generally a net supplier of electricity	
System Operator	systemOperator	An entity that operates a grid	
TDSP	tdsp	An entity which supports transmission and distribution of electricity	
Transmission	transmission	An entity which supports transmission of electricity	

1646

1647 *Table 8-2: EiEnroll Service Operations*


<i>Service</i>	<i>Operation</i>	<i>Response</i>	<i>Service Consumer</i>	<i>Service Provider</i>	<i>Notes</i>
EiEnroll	EiCreateEnroll	EiCreatedEnroll	Party	Party	Create and send Enrollment
EiEnroll	EiRequestEnroll	EiReplyEnroll	Party	Party	Requests outstanding Enrollment information; request semantics with no time Interval.
EiEnroll	EiCancelEnroll	EiCanceledEnroll	Party	Party	Cancel one or more Enrollments

1648



1649 **8.1 Interaction Patterns for the EiEnroll Service**

1650 This is the [UML] interaction diagram for the EiEnroll Service.

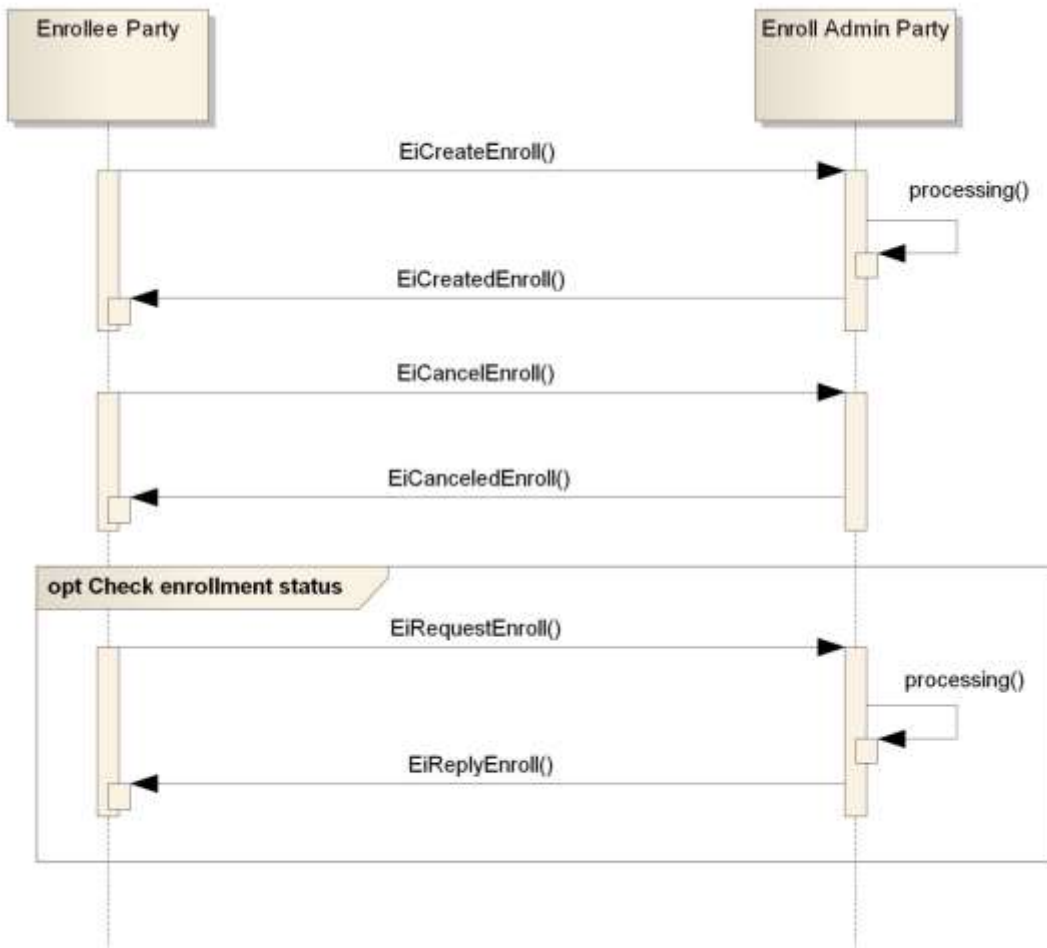


1651  
1652 *Figure 8-1: Interaction Diagram for the EiEnroll Service*

1653  
1654

1655 **8.2 Information Model for the EiEnroll Service**


1656 The EiEnroll service has an abstract class for the respective types. The abstract class also has the entity  
 1657 identifier, type (as a string), and name. The standard values for the type are listed in Table 8-1 Enrollee  
 1658 Descriptions. Other values MAY be used but MUST be prefixed by "x-" as described in Appendix C

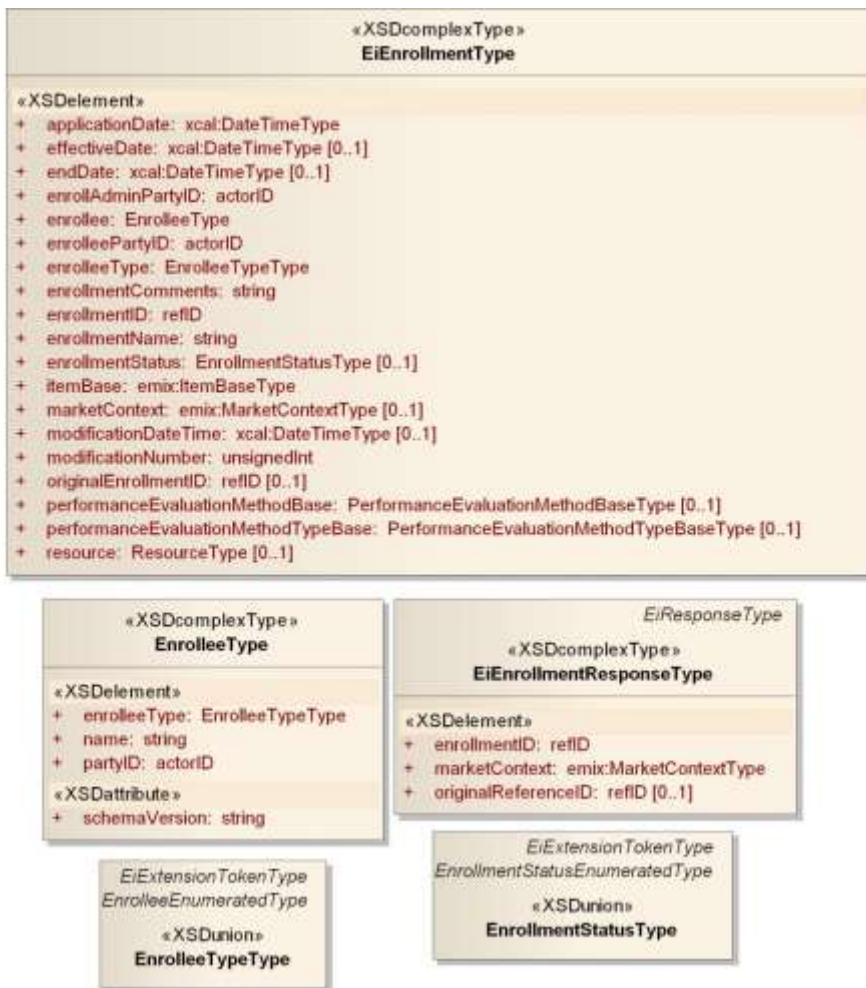

1659  
 1660 *Figure 8-2: UML Model for EiEnrollment Classes*  
 1661

1662 **8.3 Enrollee Types**

1663 The [UML] class diagram describes the Enrollee Types.

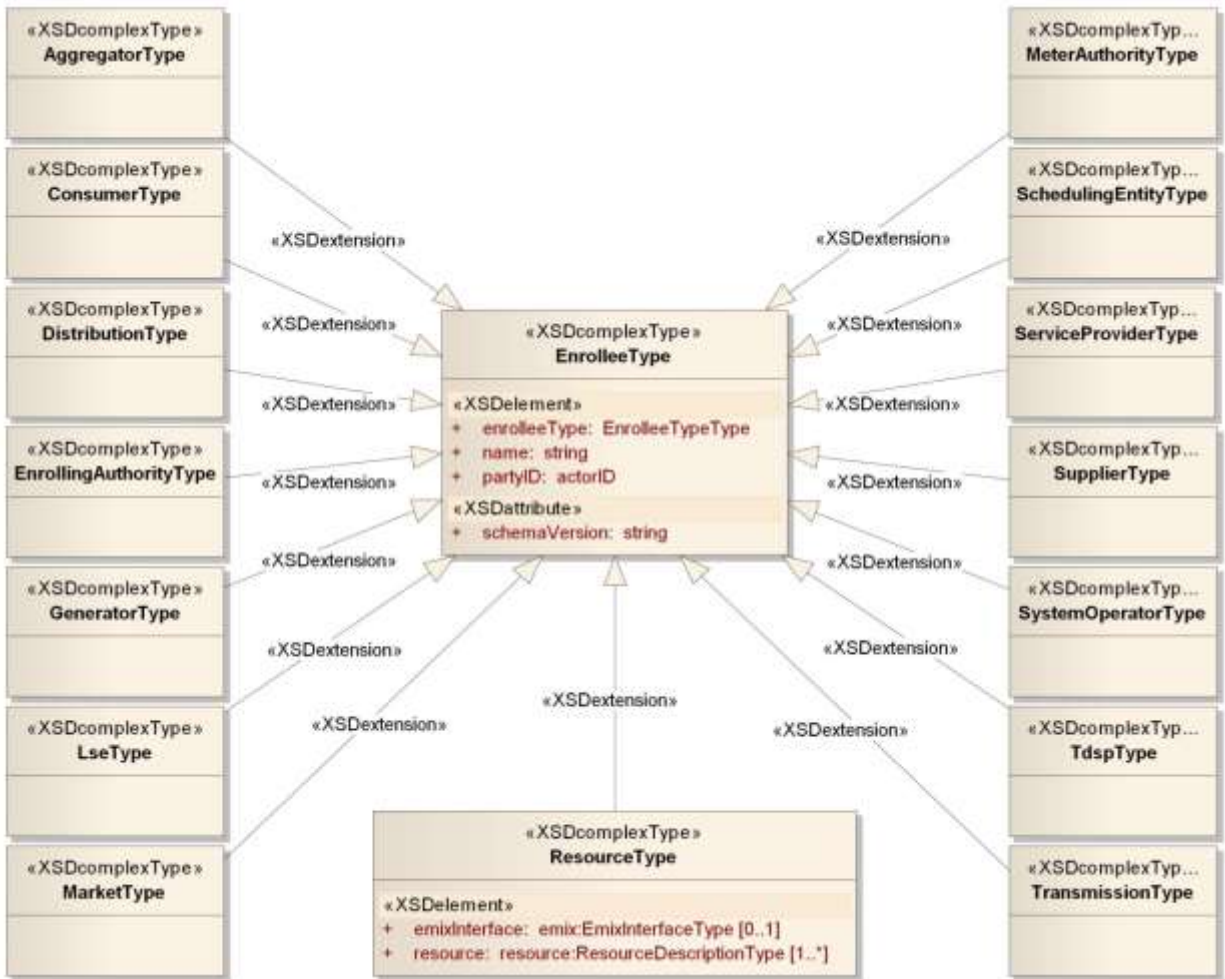

1664  
1665 *Figure 8-3: UML Class Diagram showing Enrollee Types*

1666 **8.4 Operation Payloads for the EiEnroll Service**

1667 The [UML] class diagram describes the payloads for the EiEnroll service operations.



1668

1669 *Figure 8-4: UML Class Diagram for Enrollment Payloads*

1670

## 9 Event Services

1671 The Event Service is used to call for performance under a transaction. The service parameters and event  
1672 information distinguish different types of events. Event types include reliability events, emergency events,  
1673 and more—and events MAY be defined for other actions under a transaction. For transactive services,  
1674 two parties may enter into a call option. Invocation of the call option by the Promisee on the Promisor  
1675 can be thought of as raising an event. But typically the Promisee may raise the event at its discretion as  
1676 long as the call is within the terms of the call option transaction.

1677 For example, an ISO that has awarded an ancillary services transaction to a Party may issue dispatch  
1678 orders, which can also be viewed as Events. In this specification, what is sometimes called a *price event*  
1679 would typically be communicated using the EiSendQuote operation (see 7.2 “Pre-Transaction Services”).

1680 Table 9-1: Event Services

Service	Operation	Response Operation	Service Consumer	Service Provider	Notes
EiEvent	EiCreateEvent	EiCreatedEvent	VTN	VEN	Create and send a new Event
EiEvent	EiChangeEvent	EiChangedEvent	VTN	VEN	Modify an existing Event
EiEvent	EiRequestEvent	EiReplyEvent	Either	Either	Request outstanding Events; request semantics with optional time Interval
EiEvent	EiRequestPending Event	EiReplyPending Event	Either	Either	Similar to Request Events except that Reply returns Event IDs and Modification Numbers only.
EiEvent	EiCancelEvent	EiCanceledEvent	VTN	VEN	Cancel one or more Events
EiEvent	EiDistributeEvent	—	VTN	VEN	Broadcast of Event.


### 1681 9.1 Information Model for the EiEvent Service

1682 The event is the core Demand Response information structure, and the most complex of the payloads.  
1683 Understanding the information model of the Event is critical to understanding the operations of the Event  
1684 Services. This section reviews the Event semantics as defined in Section 5.3 “Event-based Interactions”.

1685 The sub-sections below provide a reprise of the Event structure (9.1.1) and a UML description of the  
1686 event (9.1.2)

1687 **9.1.1 Structure of the Event**

1688 The semantics of the Event are defined Section 5.3 “Event-based Interactions”.

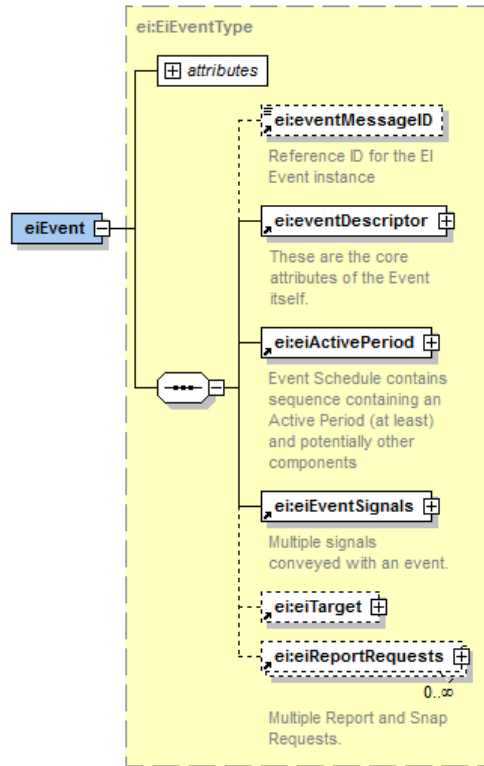


1689  
1690 *Figure 9-1: EiEvent summarized*

1691 The type `EiEvent` MAY be identified by an Event Message ID and which has associations with the classes  
1692 Active Period, Event Descriptor, and Event Signals, a collection of Signals and Baselines.

1693 As the event is the core Demand Response information structure, we begin with Unified Modeling  
1694 Language [UML] diagrams for the `EiEvent` class and for each of the operation payloads. Core semantics  
1695 for the Event are defined in Section 5.3 “Event-based Interactions”.

1696  
1697


1698 **9.1.2 UML Model of an Event and its Signals**

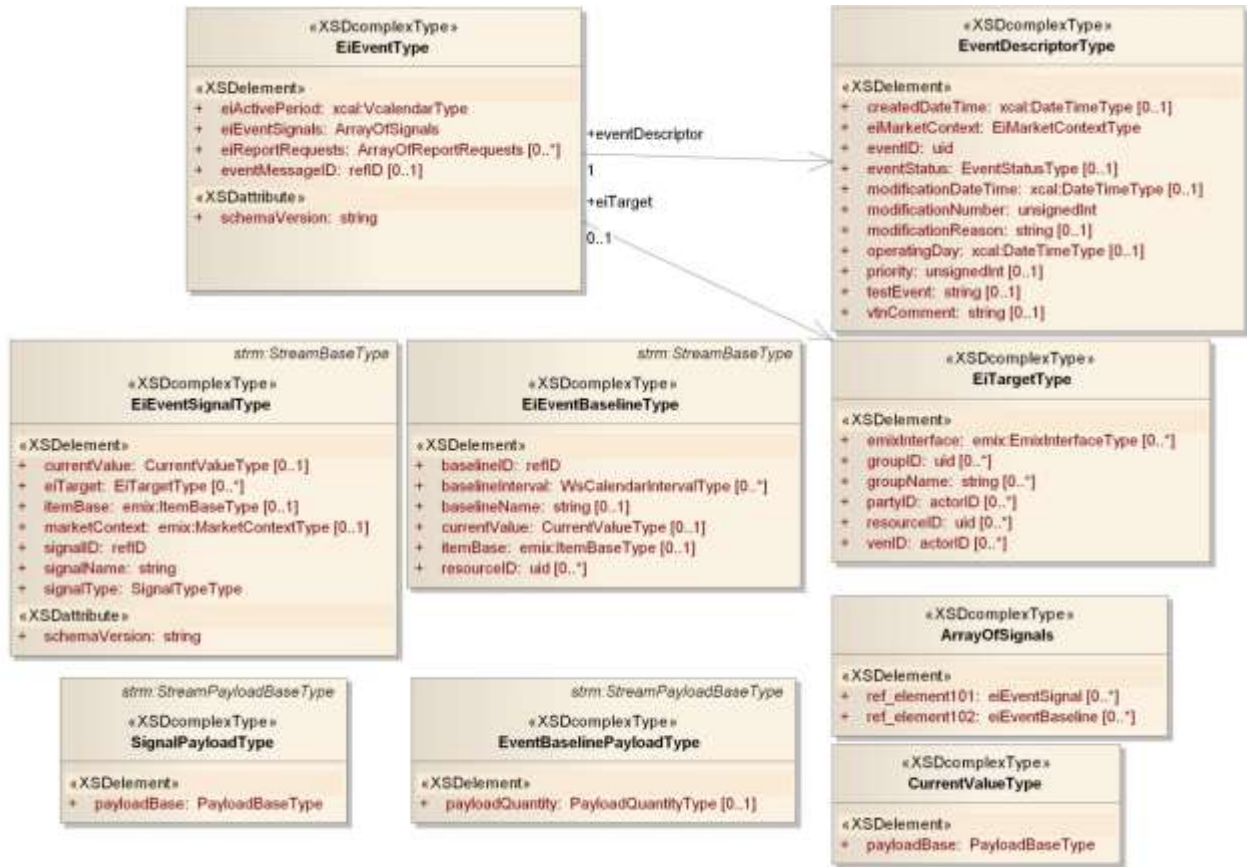

1699  
 1700 *Figure 9-2: UML Class Diagram for EiEventType and Related Classes (w/o Signals detail)*  
 1701

1702

1703 An Event may include a number of Schedules, which are expressed as Streams. These schedules are  
1704 the Signals, the Baselines, and they may return Baselines, Reports, and Delivery. The EI Event Signal  
1705 derives from the Streams element and conveys elements of the Type Signal Payload in its Schedule.

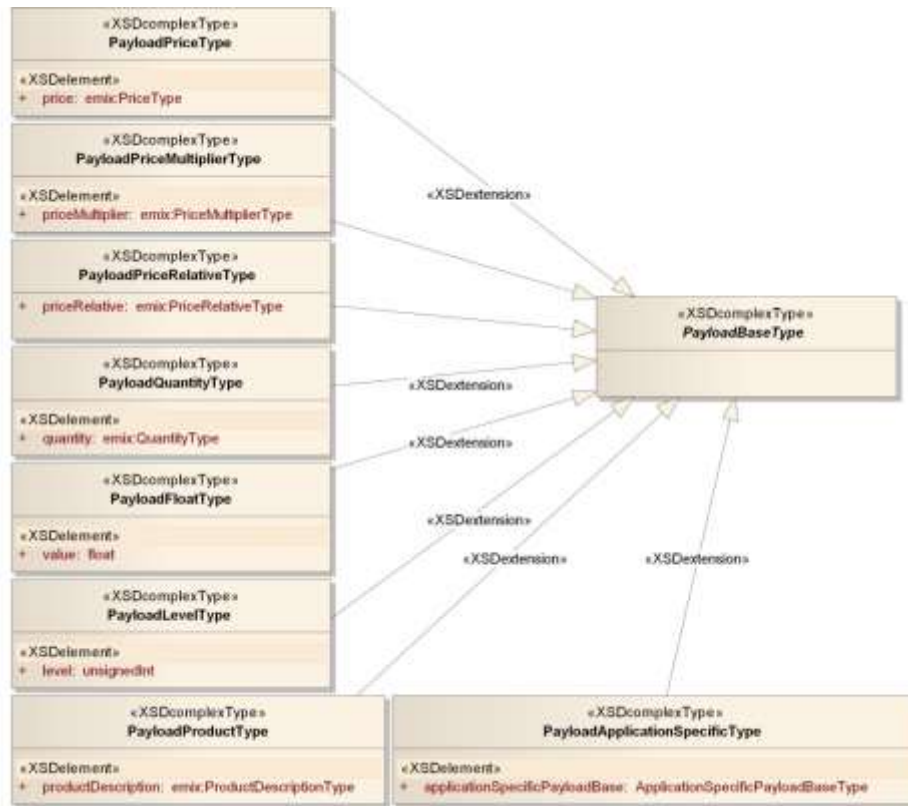

1706

1707 Figure 9-3 UML Class Diagram Showing Details of the Signal Payloads or EiEventSignals

## 1708 9.2 Special Semantics of the Event Request Operations

1709 The Events are the largest messages exchanged in Energy Interoperation. They exist in two forms, the  
1710 EiEventRequest, and EiEventRequestPending. EiEventReply returns entire Events in response to a  
1711 Request, following the general pattern of all Energy Interoperation Services. EiEventRequestPending  
1712 returns the Event IDs and Modification Numbers only. EiEventRequestPending is useful for black-start  
1713 and other situations in which the VEN and VTN need to assess the information shared with its partner.

1714 The Modification Number returned in the Replies is for assessment only. The recipient MAY use it to  
1715 determine that the sender is using out-of-date information, but any replacement or update SHALL convey  
1716 the current Modification.

### 1717 9.2.1 Event Ordering

1718 The Event Requests include an option to restrict the number of Events returned in ~~in~~Reply to any  
1719 Request. For consistency, this requires that a VTN or VEN be able to order Events. The rules for ordering  
1720 Events are applied sequentially as follows:

- 1721 1. Active events have priority over pending events
- 1722 2. Within Active Events, priority is determined by Priority in the Event Descriptor.
- 1723 3. Between active events with the same priority, the one with the earlier start time has the higher  
1724 priority.
- 1725 4. Between pending events the one with the earlier start time has the higher priority



1726 5. After processing rules 1-4, if Priority is still indeterminate within a set of Intervals, then the order is  
 1727 indeterminate within that set. A Reply containing Events with indeterminate Order MUST maintain  
 1728 that order in response to successive Requests while they remain indeterminate.

1729 The definitions of Active and Pending are consistent with those described for the Event Filter in Table 9-2.

### 1730 9.2.2 Event Filter described

1731 Both the Event Request operations MAY use of the Event Filter to restrict the Events exchanged during  
 1732 Request and Reply.

1733 Table 9-2: Event Filter described

Event Filter	Description
<b>Active</b>	An event qualifies if the Active Interval coincides with the <u>Interval in the Request</u> . <del>If specified with an accompanying Interval, an</del> An Event qualifies if any part of the Active Interval occurs within the specifying Interval; without accompanying Interval, "now" is treated as an infinitesimal Interval with a current starting date and time.
<b>Pending</b>	An event qualifies if the Active Interval starting date and time is in the future. If specified with an accompanying Interval, the Event qualifies if the Active Interval has not started (is not Active) at the Start of the Interval, and the Active Interval start is within the bounds of the specifying Interval.
<b>All</b>	An event qualifies if it would qualify as either Active or Pending.
<b>Completed</b>	An Event qualifies if the Active Interval is completed before the Request. If specified with an <del>accompanying Interval, and in the Request, an</del> Event qualifies if the end of the Active Interval <u>occurs</u> before the start of the Request <del>ing</del> Interval. Conforming profiles MAY return a NULL set in response to a Request for Completed Intervals, as there is no requirement to store or be able to retrieve Completed Events.
<b>Cancelled</b>	An Event qualifies if it has been Cancelled. If specified with an accompanying Interval, and Event qualifies if the Event would have qualified as Active during the Interval. Conforming profiles MAY return a NULL set in response to a request for Completed Intervals as there is no requirement to store or be able to retrieve Cancelled Events.

### 1734 9.2.3 Using EiRequestEvent EiRequestEventPending together

1735 ~~The two Request operations in the Event Service EiRequestEvent and EiRequestEventPending~~ are  
 1736 essentially the same. Each enables a VEN or VTN to query its partner about what Events it knows. The  
 1737 difference is in the Replies. EiReplyEvent returns a collection of Events, EiReplyEventPending returns a  
 1738 collection of Qualified Event IDs. i.e., an Event ID and the Modification Number.



1739  
 1740 Figure 9-4: Qualified Event ID

1741 With a list of Qualified Event IDs either one ~~knows about~~ can reconstruct what the other knows. Events  
 1742 that are missing can be requested or sent. A VEN can infer cancellation when its VTN removes an Event

1743 ID. Using the Modification Number, a VTN can know to re-send the latest version, or a VEN can know to  
1744 request an update.

1745 While the Event Requests follow the pattern common to all EI Requests, because of the extra options,  
1746 they are summarized in table [reference] below. All query elements are optional.

1747


1748 *Table 9-3: Event Requests summarized*

Request Element	Description
<b>VEN ID</b>	Names the VEN that is Requesting or currently knows of these Events
<b>Event ID</b>	A list of Event IDs to be returned. If present, all other filters are ignored.
<b>Market Context</b>	Request is to return Events that are in a Market Context. For example, in a given Program, a VEN could request all Electric Vehicle (EV) related Events.
<b>Filter</b>	As described above (Table 9-2). Can be combined with Interval
<b>Interval</b>	Requests Events “within” an Interval. Interval may contain only a Start Date to request all Events from that date forward, or may include only an End Date to include events before that Date. If no <del>Filter</del> Interval is present, this is interpreted as if the Filter were “all”.
<b>Reply Limit</b>	Return only the first N matching events, where N is the Reply Limit. “First is defined according to the Order as described above.


1749 A common pattern for either a VEN or a VTN is to request Event IDs with the EiRequestPending, and to  
1750 then request information about events that it isare missing or that need updates using EiRequestEvent. A  
1751 VTN after a similar query might use EiCreateEvent to pass the missing or updated Events to the VEN.

1752 **9.3 Interaction Patterns for the EiEvent Service**

1753 This is the [UML] interaction diagram for the EiEvent Service.

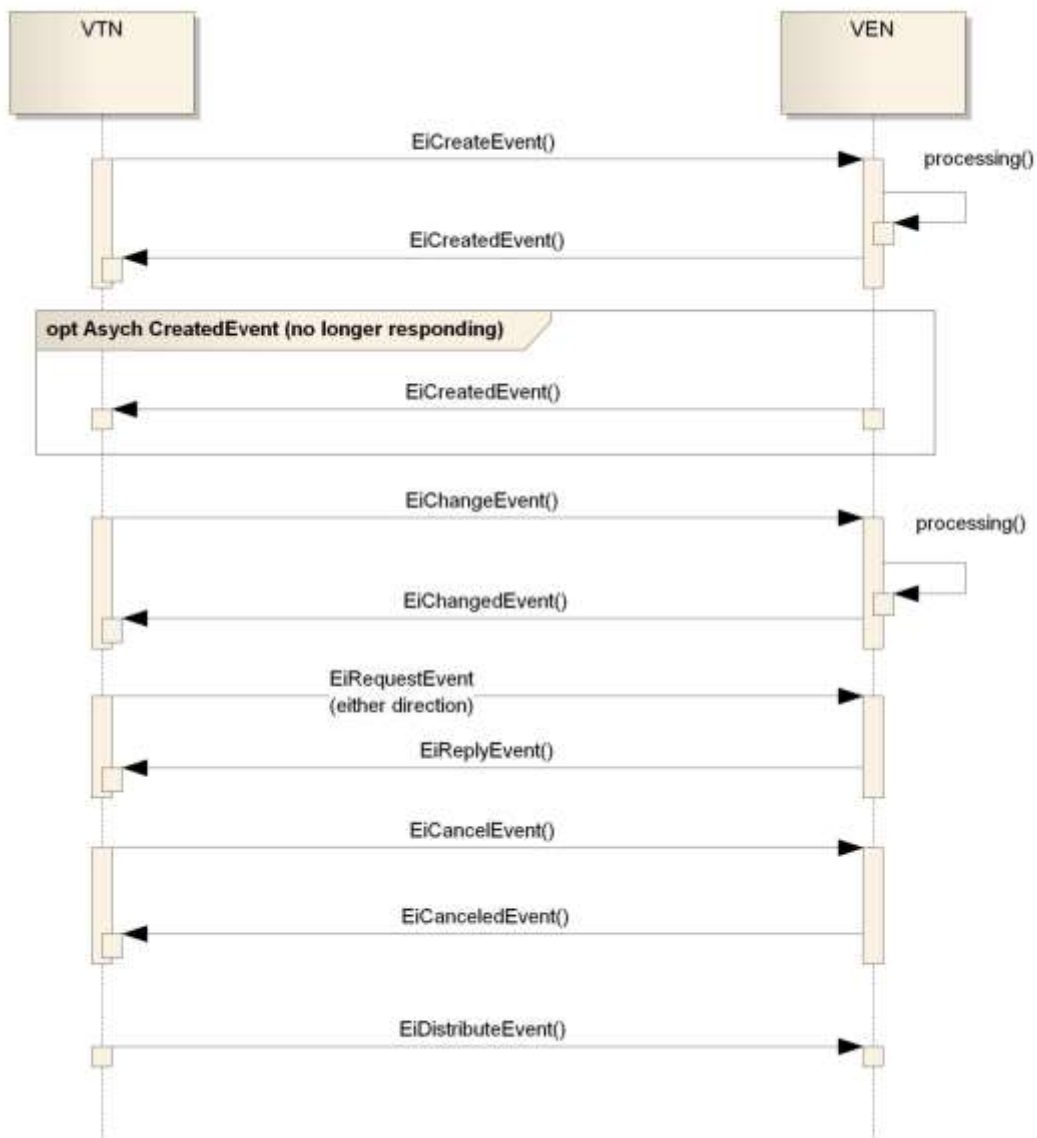

1754  
1755 *Figure 9-5: UML Interaction Diagram for the EiEvent Service Operations*  
1756

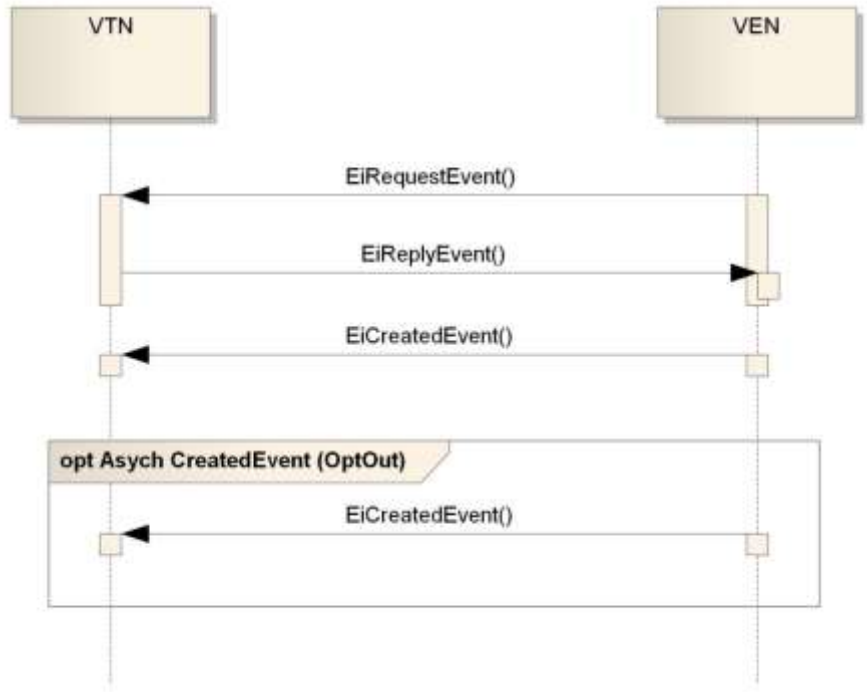

1757  
 1758 *Figure 9-6: UML for example PULL pattern for EiEvent*  
 1759  
 1760



1761



1762

1763 *Figure 9-7: Interaction Diagram for Pending Event operation*

1764 **9.4 Operation Payloads for the EiEvent Service**

1765 The [UML] class diagram describes the payloads for the EiEvent service operations.



1766  
1767 *Figure 9-8: UML Class Diagram for EiEvent Service Operation Payloads*

1768

## 10 Report Service

1769 Energy Interoperation Reports convey information from remote sensing or about remote state back to the  
1770 requester. The Historian operations support the collection of data for Reports. Reports can be associated  
1771 with an Event or can be requested through the Report Services described in this section.

1772 The general pattern of the Report service is to request that ~~the~~ Historian gather data, and for the Report  
1773 Service to ~~deliver~~return the Report when it is Ready. A ~~single-history~~Historian may generate only a final  
1774 Report, or it may report-back periodically. The report requester MAY ask the Historian for the report-to-  
1775 date, or for a time-constrained portion of the Report at any time while it is running.

1776 One interaction pattern for the Report service is what one may call “Set and Forget”. Under this pattern,  
1777 the Requester asks that information be logged, but specifies no Report delivery. Under this pattern, the  
1778 Requester can, at any time, request delivery of a Report for a specified Interval.

1779 Projections are a special class of Reports, i.e., Reports about the future. Projections follow the general  
1780 form of Reports and include additional metadata about the reliability of the future information in each  
1781 window.

1782 The semantics of Reports are described in sections 5.4 “Monitoring, Reporting” and 5.5 “Reports, Snaps,  
1783 and Projections”.

1784 The range of Payloads that can be delivered by means of a Report can be extended by deriving new  
1785 types from the Payload Base Type, and defining a new Report Type not in Enumerated Report Types,  
1786 and requesting such a Report.

### 10.1 Overview of Report Services

1788 Event-based reports are requested as part of the EiEvent service. Ei Report operations request Reports  
1789 independently of any Event. Whether created as part of an Event or independently, all Reports support  
1790 the same post-creation operations.

1791 EiReport operations are independent of EiEvent operations in that they can be requested at any time  
1792 independent of the status or history of EiEvents.

1793 *Table 10-1: Report Service*

Service	Operation	Response	Service Consumer	Service Provider	Notes
EiReport	eiCreateHistorian	eiCreatedHistorian	any	any	Create a new Historian and start it recording indicated information
EiReport	eiRequestHistorian	eiReplyHistorian	any	any	Reply with HistorianIDs that meet the criteria
EiReport	eiCancelHistorian	eiCanceledHistorian	any	any	Cancel Historian recording, optionally requesting a final report
EiReport	eiCreateProjection	eiCreatedProjection	any	any	Creates a projection, returned as a report stream

Service	Operation	Response	Service Consumer	Service Provider	Notes
EiReport	eiCreateReport	eiCreatedReport	any	any	One time and/or periodic response
EiReport	eiUpdateReport	eiUpdatedReport	any	any	Used to update the Report, e.g. periodic responses
EiReport	eiRequestReport	eiReplyReport	any	any	The carrier for periodic response
EiReport	eiCancelReport	eiCanceledReport	any	any	Cancel pending reports, optionally requesting a final report

1794



1795


## 10.2 EiHistorian Service

1796

### 10.1.110.2.1 Interaction Pattern for ~~Historian Operations~~ the EiHistorian

1797

#### Service

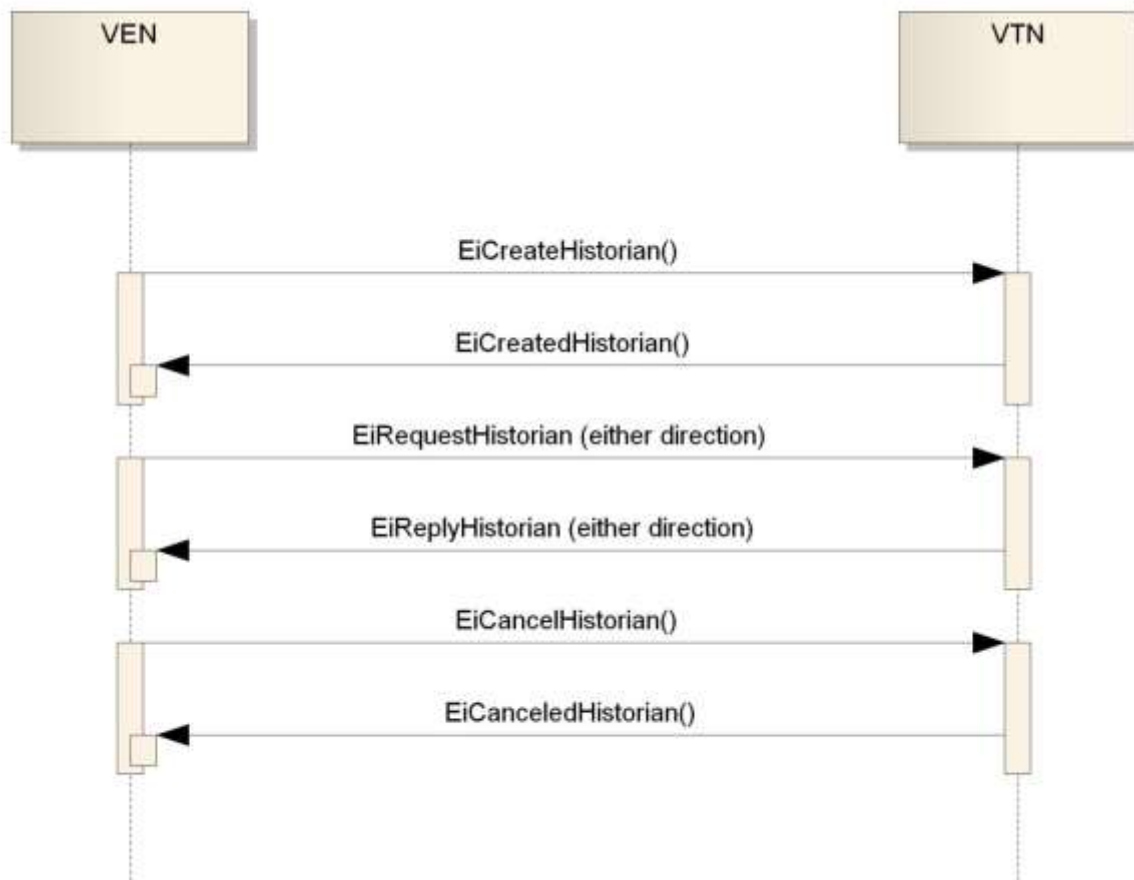

1798

1799 *Figure 10-1: Interaction Pattern for Historian Operations (Report Service)*

1800  
1801

## 10.1.2.10.2.2 UML Diagram of Historian Operations Payloads for the EiHistorian Service




1802  
1803  
1804

Figure 10-2: UML Diagram of Historian Payloads

1805 **10.1.3 Interaction Pattern for the Report Operations**

1806 This is the [UML] interaction diagram for the EiReport Service.

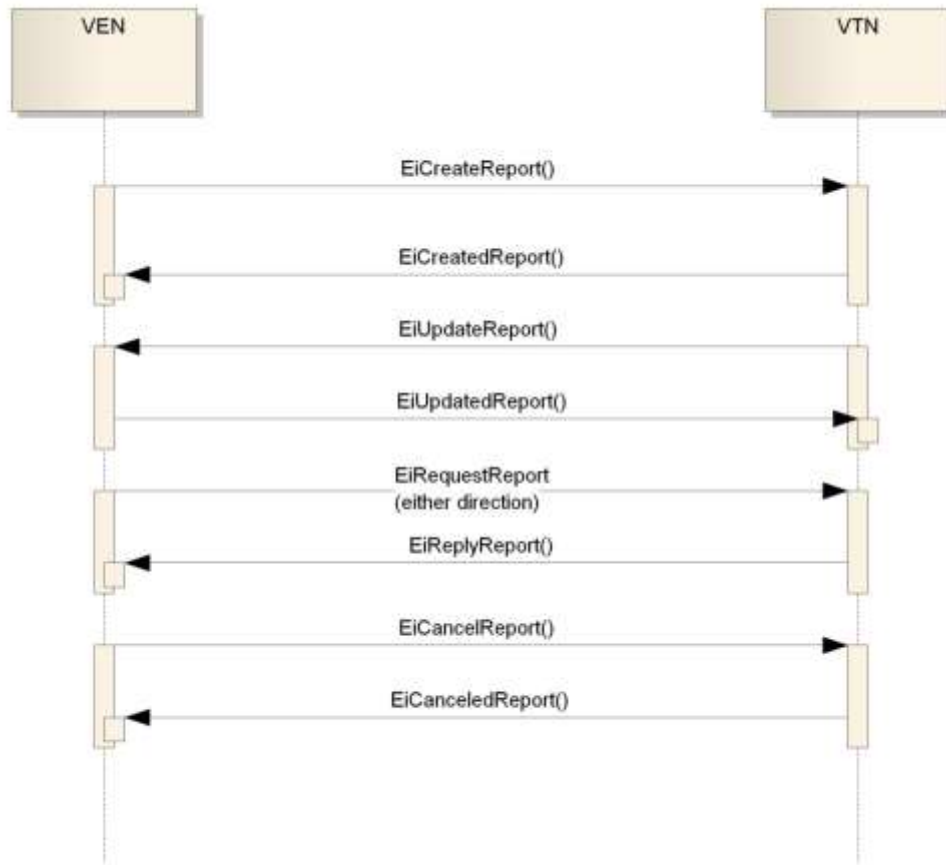


1807

1808 **10.210.3 Figure - : UML Interaction Diagram for the EiReport**  
1809 **Operations (Report Service)**

1810

## 10.2.1 UML Diagram of Report Operations

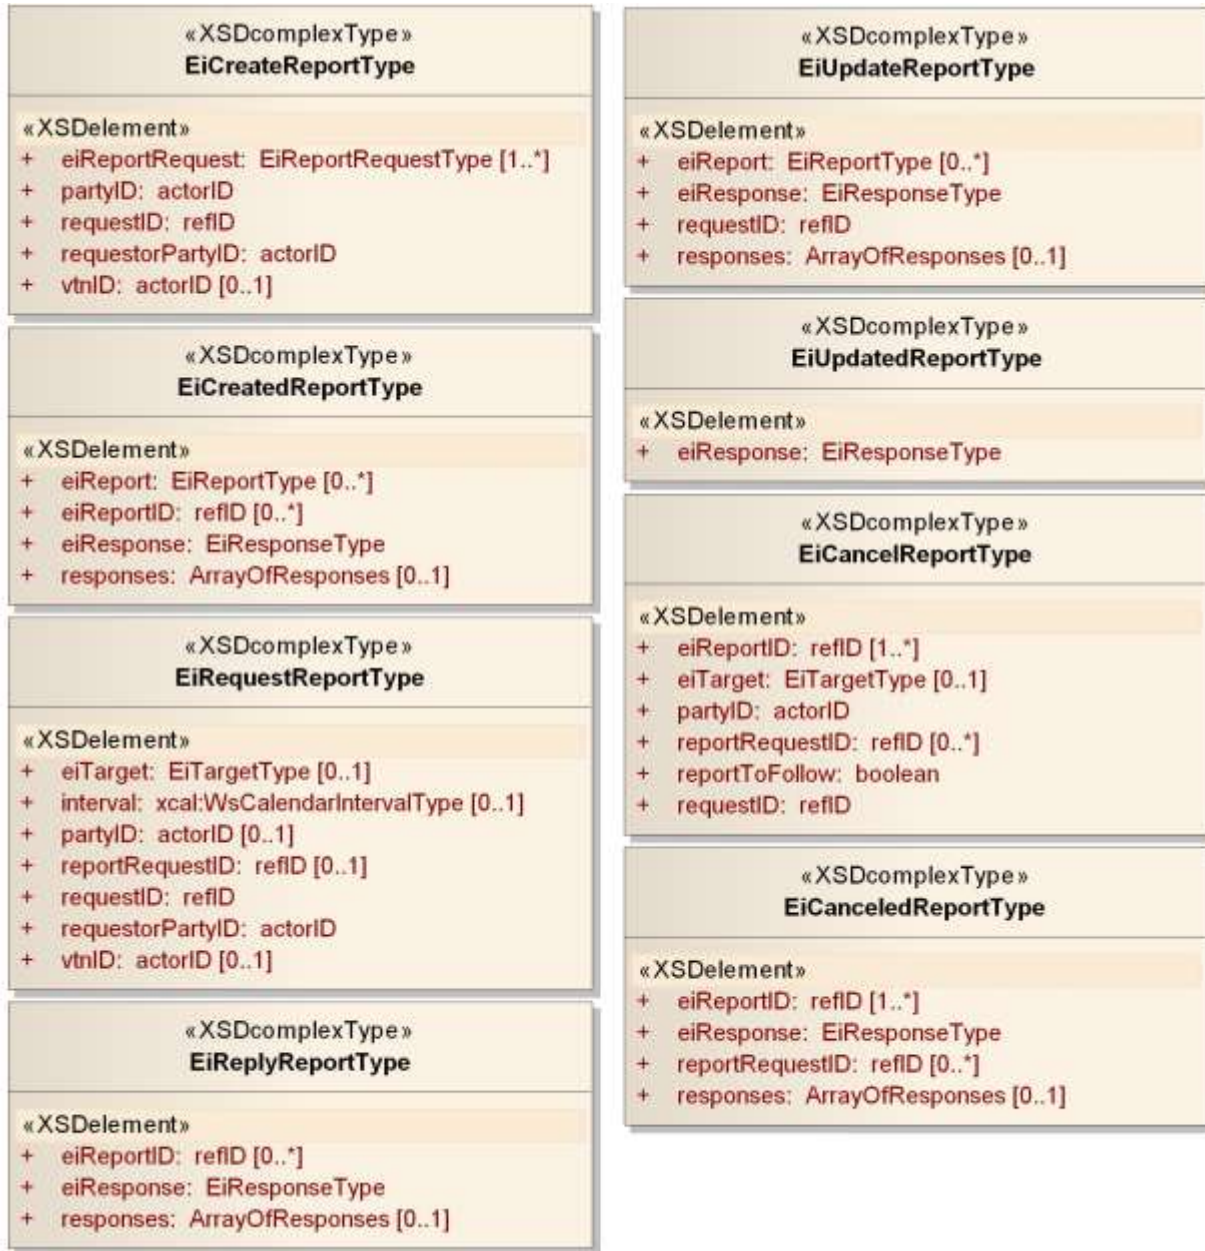


1812

1813 *Figure 10 :- UML Diagram of Report Payloads*

1814

1815

### 10.2.2 Interaction Pattern for Projection Operations

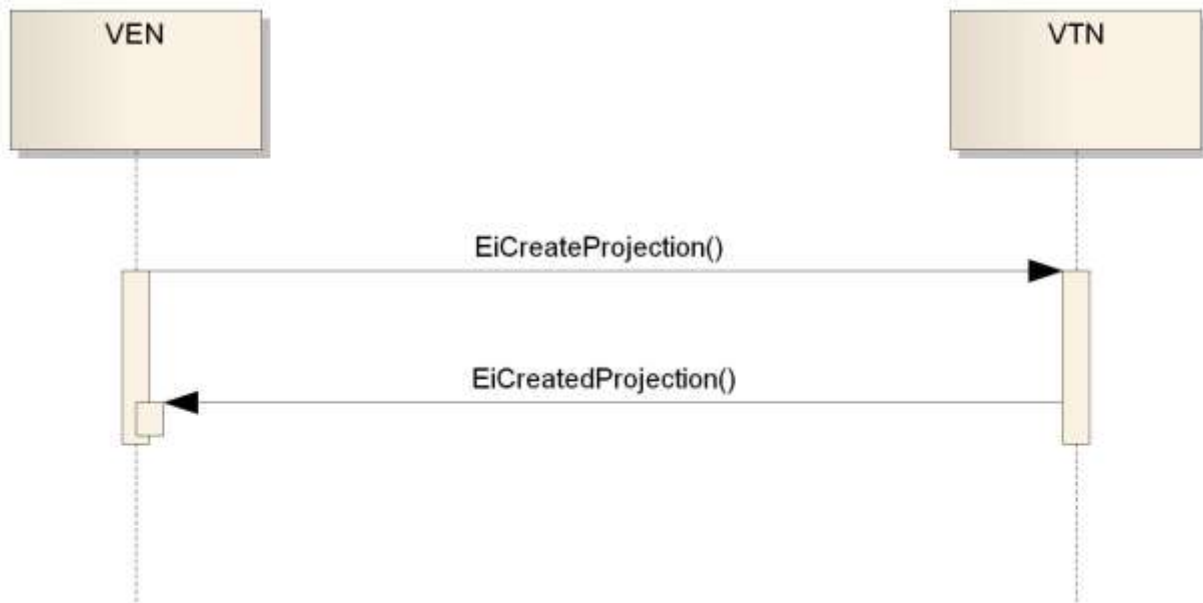

1816

1817 ~~Figure 10~~: Interaction Pattern for Projection Operations (Report Service)

1818

### 10.2.3 UML Diagram of Projection Operations



1820

1821 ~~Figure 10~~: UML Diagram of Projection Payloads

1822

### 10-2.410.3.1 Information Model for the EiReport Service

1823

An EiReport is prepared by a Party upon request and supplied to the requesting party. It may also be defined in the expectations of the Market Context.

1824



1825



1826

1827 Figure 10-3: UML Class Diagram for the EiReport Class


1828

1829

### 10.3.2 Interaction Pattern for the EiReport Service

1830

This is the [UML] interaction diagram for the EiReport Service.

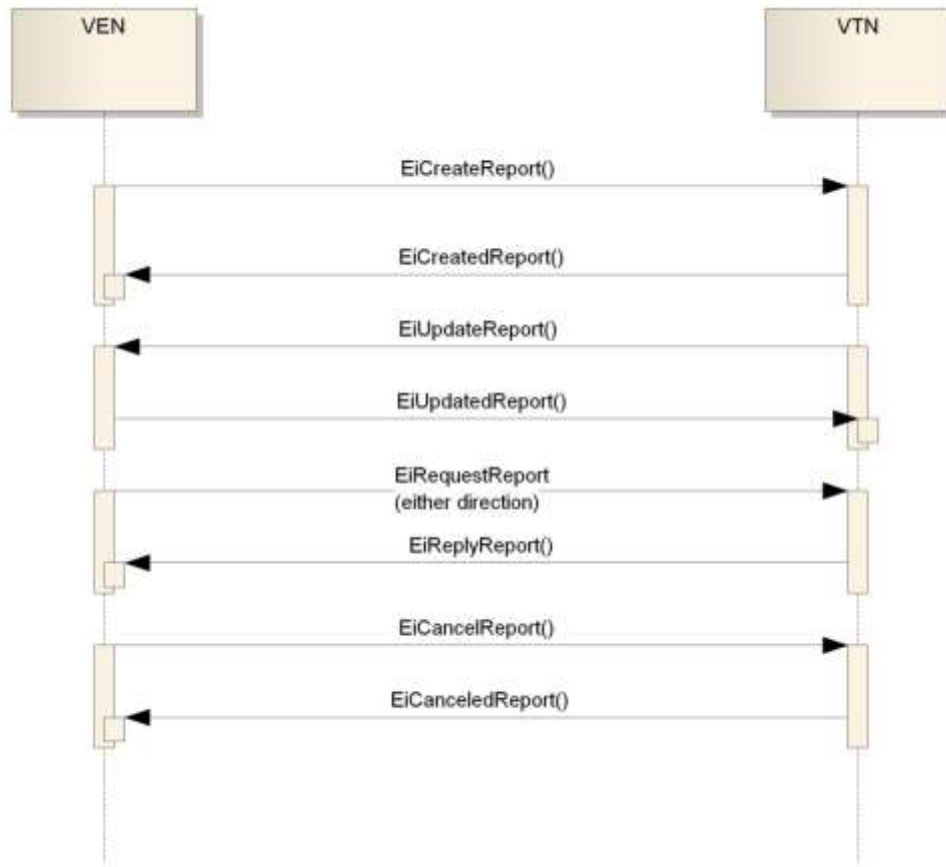

1831

1832


Figure 10-4



1833 *All: UML Interaction Diagram for the EiReport Service (Report Service)*

1834

1835 **10.2.510.3.3 Operation Payloads for the EiReport Service**

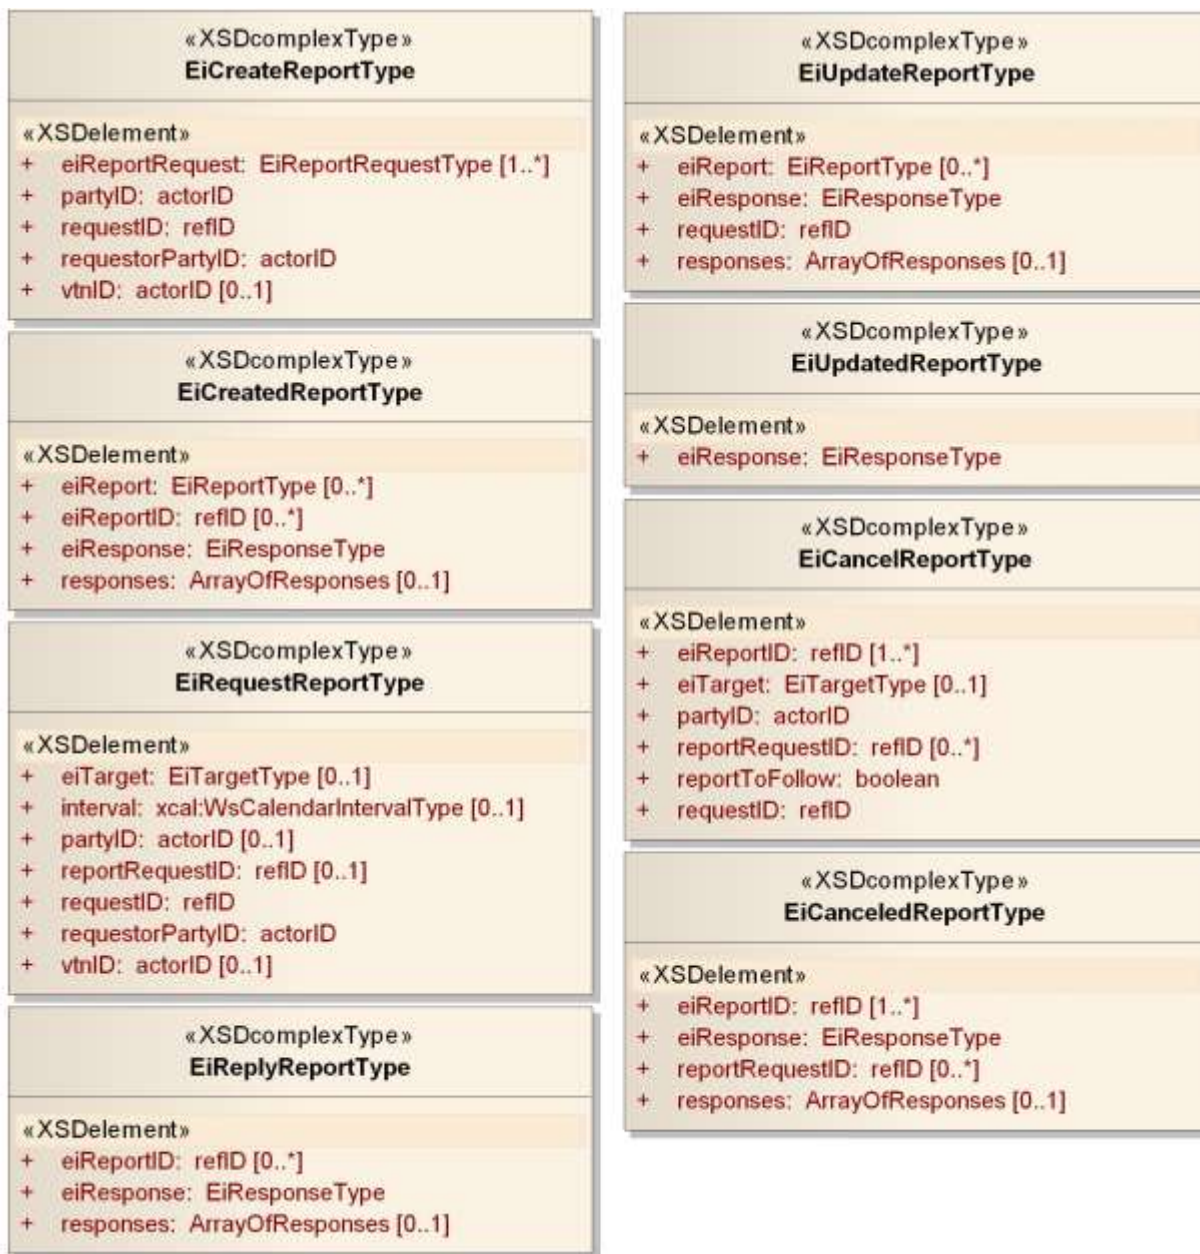

1836

1837 *Figure 10-5: UML Diagram of Report Payloads*


1838

1839

## 10.4 EiProjectionService

1840

### 10.4.1 Interaction Pattern for EiProjection Service

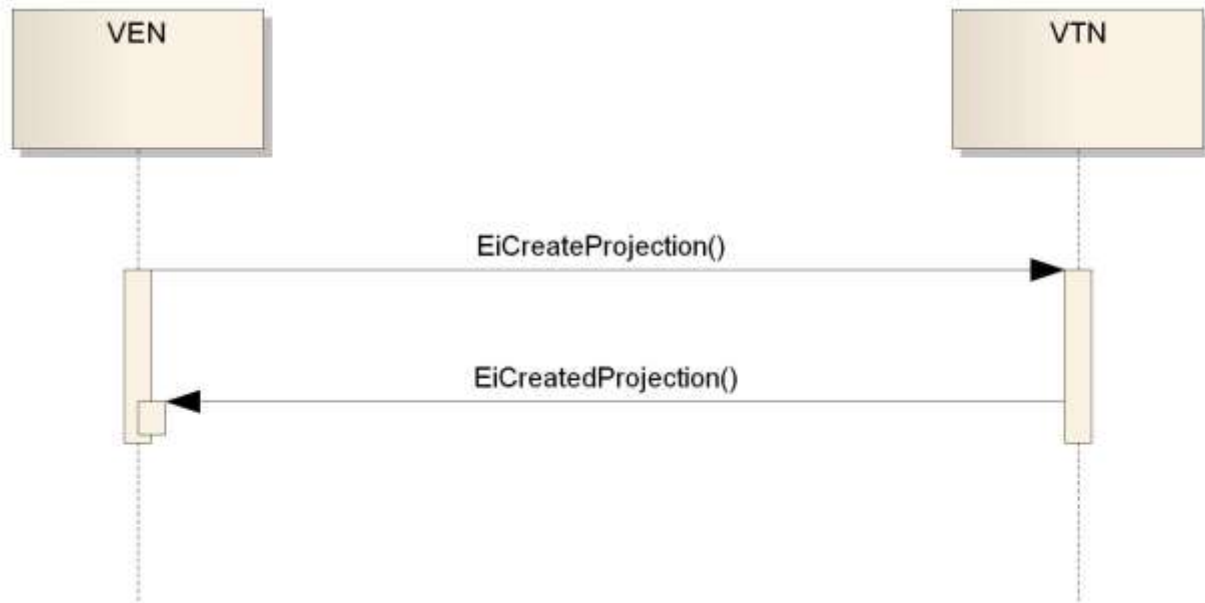

1841

Figure 10-6: Interaction Pattern for Projection Operations (Report Service)

1843

1844

### 10.4.2 Operation Payloads for the EiProjection Service



1845

Figure 10-7: UML Diagram of Projection Payloads


1847

1848

## 10.5 Summary of Report Payloads

1849

The [UML] class diagram below recaps the payloads for all operations of the EiReportService.

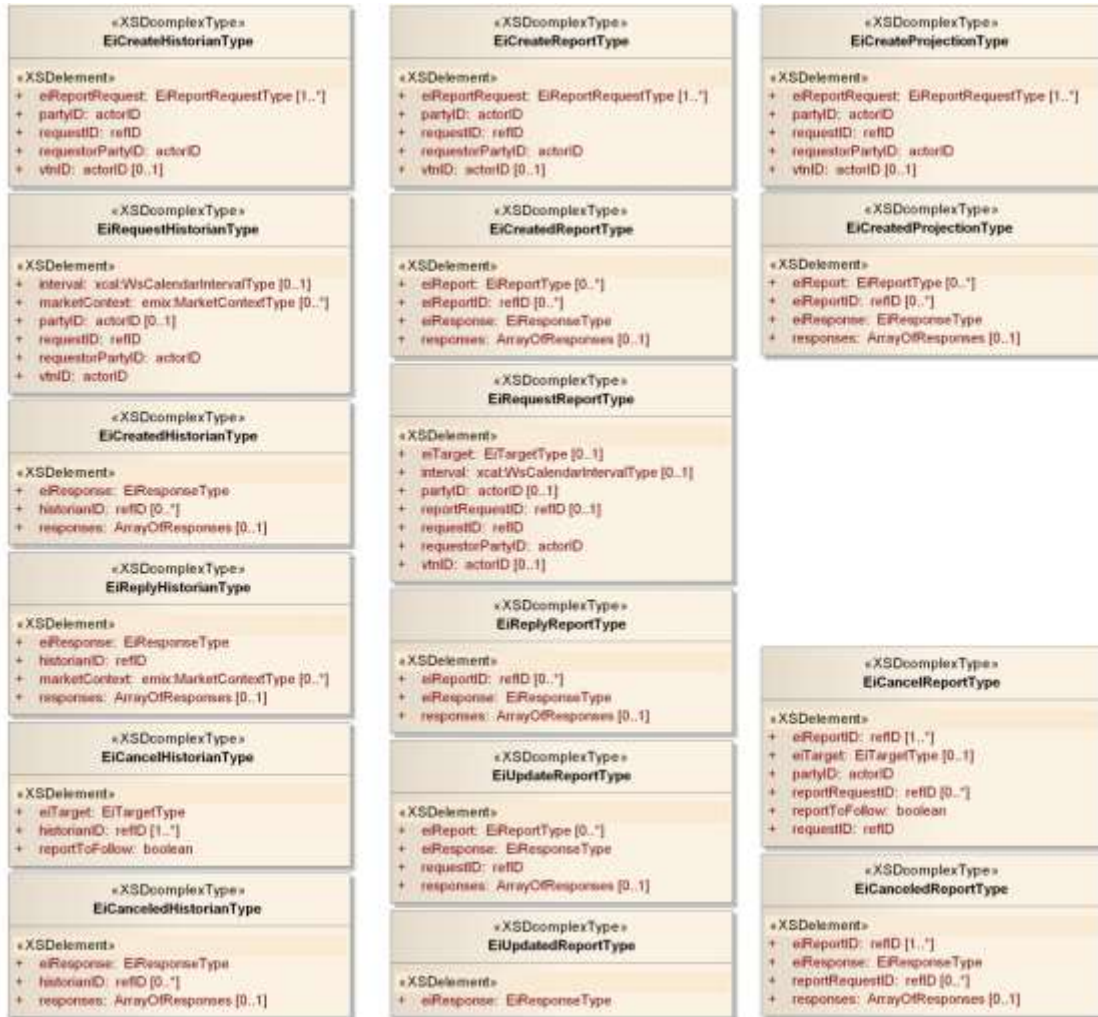

1850

1851

Figure 10-8: UML Class Diagram for all EiReportService Operation Payloads

---

## 1852 11 Event Support Services

1853 Users of **[OpenADR]** found that they needed to be able to constrain the application of remote DR  
1854 services. For The DR Operator, advanced knowledge of these constraints improved the ability to predict  
1855 results. The services in this section are based on the services used to tailor expectations in **[OpenADR]**.  
1856 Availability and Opt are similar in that they communicate when a Party is willing to receive an Event.  
1857 Availability is a long-term schedule for when a Party will consider a response. Availability could be set in  
1858 the Market Context or at program enrollment. Opt (as in *opt in* or *opt out*) encompasses short-term  
1859 additions to or replacement of the schedule in Availability.  
1860 The combination of Availability and Opt states together define the times during which a committed  
1861 response from the VEN is possible or likely.

### 1862 11.1 Relationship of Availability and Opt Information

1863 Availability and Opt apply to interactions where an action is requested (e.g. curtailment and DER actions),  
1864 and only indirectly to (e.g.) price distribution interactions.  
1865 Availability is a long-term description and may be complex. Opt is a short-term description that replaces or  
1866 is combined into the long-term availability description.  
1867 Availability and Opt-In and Opt-Out, as well as Market Rules, use the *VavailabilityType* defined in **[WS-**  
1868 **Calendar]** which in turn is an XML serialization of **[Vavailability]**. The semantics are defined in  
1869 **[Vavailability]**.  
1870 The behavior of the Availability schedule is defined as follows. We call the parameter passed for Opt-In  
1871 and Opt-Out the *Opt Vavailability*.  
1872

- 1873 • The *EiAvailability* class describes when the VEN expects/commits/plans to be available to
- 1874 respond to a request for performance, generally an *EiEvent*.
- 1875 • Exactly one *Vavailability* is included in the *EiAvailability* and the *EiOpt* objects.
- 1876 • An *EiOpt* that is used in a message MUST have a bounded interval (the *Opt Interval*) in the *Opt*  
1877 *Vavailability*<sup>8</sup>
- 1878 • An **Opt-In** while in effect adds the available times of the *Opt Vavailability* to the available times in
- 1879 the bounded interval for the VEN with respect to a *MarketContext*, effectively performing a logical
- 1880 OR operation on the available times but only within the *opt Interval*
- 1881 • An **Opt-Out** while in affect replaces the entire portion of the *EiAvailability* within the *opt interval*
- 1882 • Exactly zero or one *Opt* functions MAY be in effect at any time

1882 In short, Opt-In adds the *Opt Vavailability* available times to the overall VEN *vavailability*; Opt-Out  
1883 replaces the entirety of its *opt Intervals* with the contents of the Opt-Out *Vavailability*.

### 1884 11.2 EiAvail Service

1885 The *Availability*<sup>9</sup> is set by the VEN and indicates when an event may or may not be accepted and  
1886 executed by the VEN with respect to a *Market Context*. Knowing the *Availability* and *Opt* information for  
1887 its VENs improves the ability of the VTN to estimate response to an event or request.  
1888 When *Availability* is set, *opt-in* or *opt-out* does not affect the *Availability* except for the specific interval(s)  
1889 described by the *Opt*—*opting out* is temporary unavailability, which may have transaction and business  
1890 consequences if an event is created during the *opt-out* period.

---

<sup>8</sup> By defining an end time for the *Vavailability*

<sup>9</sup> Called *Constraints* in **[OpenADR1]**

1891 The modeling for Availability includes behavior indications for the situation where an EiEvent overlaps a  
 1892 constrained time interval.

1893 EiAvailability describes only the available times, using the patterns defined in **[WS-Calendar]** and  
 1894 **[Vavailability]**.

1895 *Table 11-1: Avail Service*


Service	Operation	Response	Service Consumer	Service Provider	Notes
EiAvail	EiCreateAvail	EiCreatedAvail	VEN	VTN	Create an Avail for this VEN; return the AvailID
EiAvail	EiRequestAvail	EiReplyAvail	VEN	VTN	Request Avail information for this VEN; request semantics with no time Interval
EiAvail	EiCancelAvail	EiCanceledAvail	VEN	VTN	Cancel the Avail referenced by the AvailID

1896 The element EiAvailBehavior defines how an issued EiEvent that conflicts with the current EiAvail is  
 1897 performed:

- 1898 • ACCEPT – accept the issued EiEvent regardless of conflicts with the EiAvail
- 1899 • REJECT – reject any EiEvent whose schedule conflicts with the EiAvail
- 1900 • RESTRICT – modify the EiEvent parameters so that they fall within the bounds of the EiAvail

### 11.2.1 Interaction Patterns for the EiAvailability Service

1901 This is the **[UML]** interaction diagram for the EiAvail Service.  
 1902

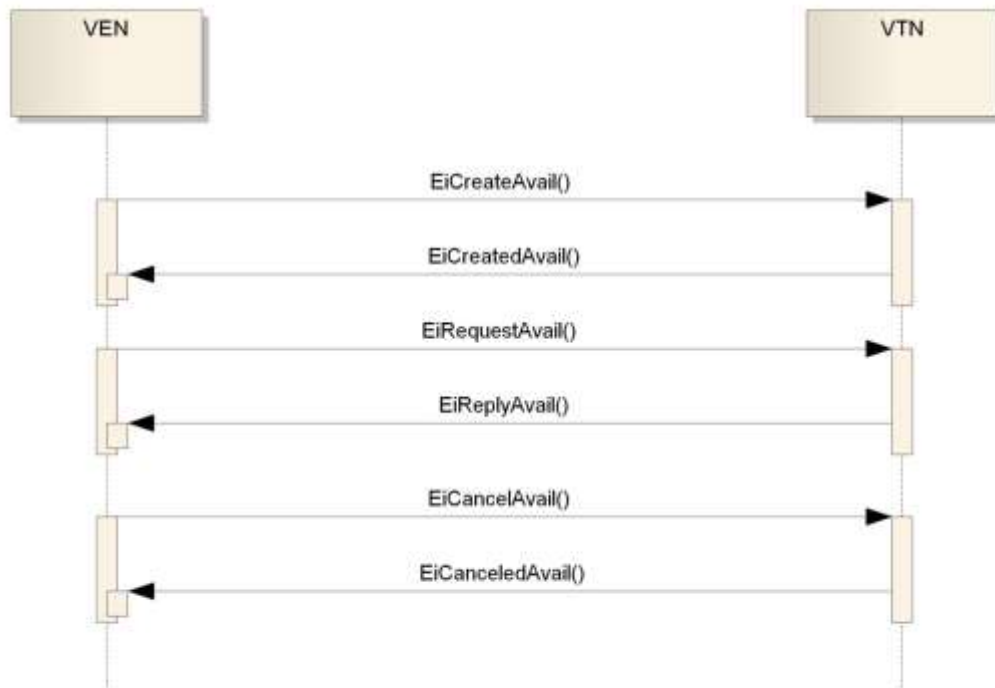

1903  
 1904 *Figure 11-1: Interaction Pattern for the EiAvailability Service.*

1905

1906

## 11.2.2 Information Model for the EiAvail TypeService



1907

1908 *Figure 11-2: UML Class Diagram for the EiAvail Type*

1909

1910 **11.2.3 Operation Payloads for the EiAvail Service**

1911 The [UML] class diagram describes the payloads for the EiAvail service operations.



1912

1913 *Figure 11-3: UML Class Diagram for EiAvail Service Operation Payloads*

1914 **11.3 EiOpt Service**

1915 The Opt service creates and communicates Opt-In and Opt-Out schedules from the VEN to the VTN.  
 1916 Schedules are combined with EiAvailability and the Market Context requirements to give a complete  
 1917 picture of the willingness of the VEN to respond to EiEvents received by the VEN.

- 1918 • Exactly one Vavailability MUST be provided in EiCreateOptIn and EiCreateOptOut.
- 1919 • Opt schedules SHALL override any Availability in place while there is an Opt in effect. See  
 1920 Section 11.1


1921 Applying EiCreateOptIn or EiCreateOptOut if an Opt is currently in effect replaces the current Opt in effect  
 1922 with that in the Opt Vavailability, which effectively cancels the current Opt state and Creates a new one.

1923 *Table 11-2: Opt Service*

Service	Operation	Response	Service Consumer	Service Provider	Notes
EiOpt	EiCreateOpt	EiCreatedOpt	VEN	VTN	Create and send an Opt, receiving an Opt ID
EiOpt	EiRequestOpt	EiReplyOpt	VEN	VTN	Request the Opts from the VTN that are currently in effect, at most one per Market Context.
EiOpt	EiCancelOpt	EiCanceledOpt	VEN	VTN	Cancel the identified Opt

1924 **11.3.1 Interaction Patterns for the EiOpt Service**

1925 This is the [UML] interaction diagram for the EiOpt Service.

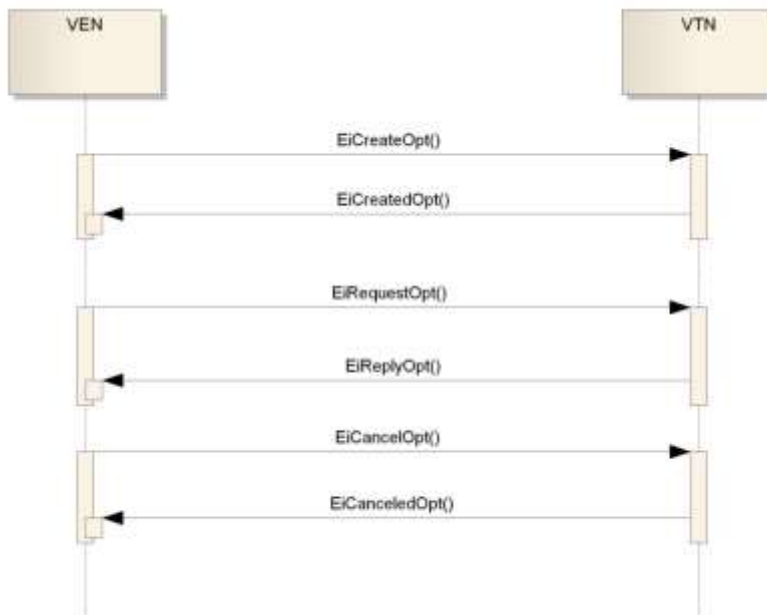


1926  
 1927 *Figure 11-4: Interaction Diagram for the EiOpt Service-NEEDS UPDATE*

1928 **11.3.2 Information Model for the EiOpt ClassService**

1929 Opting in or out is a temporary situation indicating that the VEN will or will not respond to a particular an  
 1930 event or in a specific time period, without changing the potentially complex Availability. The *EiOpt*  
 1931 schedule is a [WS-Calendar] VavailabilityType.



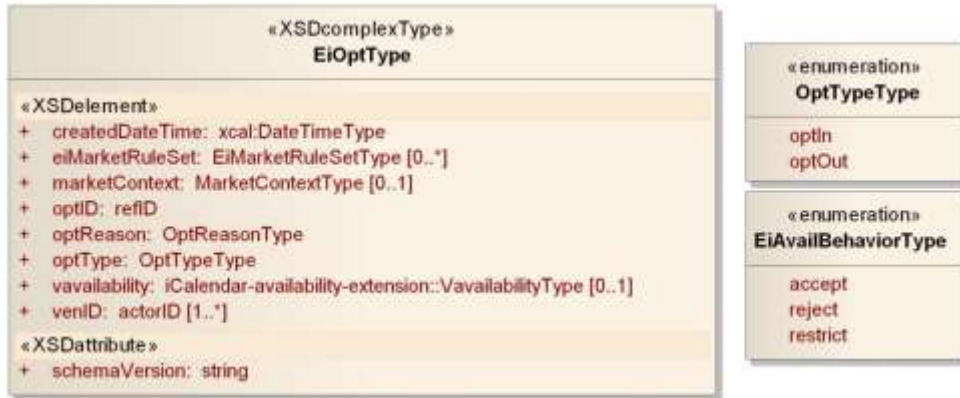

1932

1933 *Figure 11-5: UML Class Diagram for EIOpt Type*

1934 **11.3.3 Operation Payloads for the EiOpt Service**

1935 The [UML] class diagram describes the payloads for the EiOpt service operations.



1936

1937 *Figure 11-6: UML Class Diagram for EiOpt Service Operation Payloads*

1938 **12 Market Information**

1939 Each Event and Service in Energy Interoperation takes place within a Market Context. This Context  
 1940 defines the behaviors that that each Party can expect from the other.

1941 **12.1 The Market Context**

1942 | Market Contexts are used to express market information that rarely changes ~~once~~, and thereafter not  
 1943 need to communicate it with each message.

1944 In any market context, there are standing terms and expectations about product offerings. If these  
 1945 standing terms and expectations are not known, many exchanges may need to occur ~~that offer~~ before  
 1946 finding products that ~~do not~~ meet those expectations. If ~~the~~ ese expectations are only known through local  
 1947 knowledge, then then national and international products need to be re-configured for each local market  
 1948 that they enter. If all market information were to be transmitted in every information exchange, messages  
 1949 based on EMIX would be overly repetitious.

1950 As described in Section 5.2 "Market Context", The EI Market Contexts is a super-set of the [EMIX]  
 1951 Standard Terms, and they can be referenced using the EMIX Market Context as an identifier. The EMIX  
 1952 Market Context is expressed as an URI.

1953 **12.2 Market Context Service**

1954 The Market Context Service enables a Party to request the details of a Market Context. These MAY be  
 1955 mandatory in many of today's interactions. Parties MAY be able to request and compare Market Contexts  
 1956 to select which markets to participate in. Such Interactions are out of scope for this specification.



1957  
 1958 *Figure 12-1: Sequence diagram for Market Context service*

1959 The Market Context service can retrieve the full information in an EiMarketContext given the identifier, an  
 1960 EMIX Market Context. There is one operation and a responding operation.

1961 *Table 12-1: Market Context Service*

Service	Operation	Response	Service	Service	Notes
---------	-----------	----------	---------	---------	-------

			Consumer	Provider	
EiMarketContext	EiRequest MarketContext	EiReply MarketContext	Party	Party	Respond with the full EiMarketContext for each EMIX Market Context sent; <del>request semantics with no time interval.</del>

1962

1963 ~~12.3 UML Overview of Market Context~~

1964 12.3 Information Model for the EiMarketContext Service




1965

1966 *Figure 12-2: UML Class Diagram for Market Context*

1967

## 12.4 Operation Payloads for ~~Market~~the EiMarket Context Service

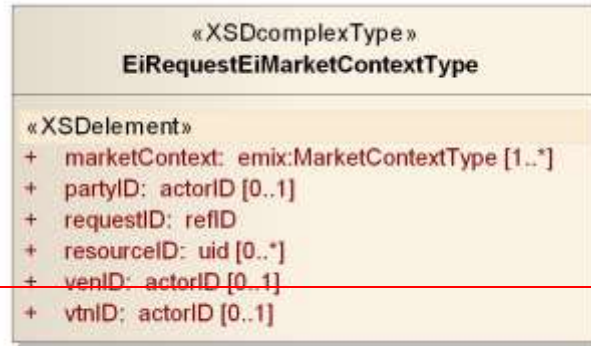

1968



1969

1970

Figure 12-3: UML of Market Context Service payloads

1971

## 13 Security and Composition [Non-Normative]


1972 This section describes the enterprise software approach to security and composition as applied to this  
1973 Energy Interoperation specification.

1974 Service orientation has driven a great simplification of interoperation, wherein software is no longer based  
1975 on Application Programming Interfaces (APIs) but is based on exchange of information in a defined  
1976 pattern of services and service operations [SOA-RM].

1977 The approach for enterprise software has evolved to defining key services and information to be  
1978 exchanged, without definitively specifying how to communicate with services and how to exchange  
1979 information—there are many requirements for distributed applications in many environments that cannot  
1980 be taken into account in a service and information standard. To make such choices is the realm of other  
1981 standards for specific areas of practice, and even there due care must be taken to avoid creating a  
1982 monoculture of security.<sup>10</sup>

### 13.1 Security and Reliability Example

1984 Different interactions require different choices for security, privacy, and reliability. Consider the following  
1985 set of specifics. (This figure is here repeated and re-labeled.)

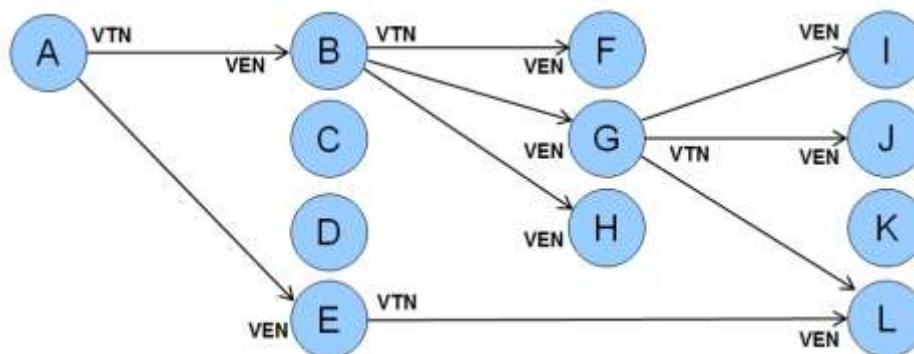

1986

1987 *Figure 13-1: Web of Example DR Interactions*

1988 We specifically model a Reliability DR Event initiated by the Independent System Operator<sup>11</sup> A, who  
1989 sends a reliability event to its first-level aggregators B through E. Aggregator B, in turn invokes the same  
1990 service on its customers (say real estate landlords) F, G, and H.

1991 Those customers might be industrial parks with multiple facilities, real estate developments with multiple  
1992 tenants, or a company headquarters with facilities in many different geographical areas, which would  
1993 invoke the same operation on their VENs.

1994 For our example, say that G is a big-box store regional headquarters and I, J, and L are their stores in the  
1995 affected area.

1996 Each interaction will have its own security and reliability composed as needed—the requirements vary for  
1997 specific interactions. For example

- 1998 • For service operations between A to B, typical implementations include secure private frame-  
1999 relay networks with guaranteed high reliability and known latency. In addition, rather than relying

<sup>10</sup> See e.g. the STUXNET worm effects on a monoculture of software SCADA systems, 2010. See <http://en.wikipedia.org/wiki/Stuxnet>

<sup>11</sup> Using North American Terminology.

2000 on the highly reliable network, in this case A requires an acknowledgment message from B back  
 2001 to A proving that the message was received.  
 2002 • From the perspective of the ISO, the communication security and reliability between B and its  
 2003 customers F, G, and H may be purely the responsibility of B, who in order to carry out B’s  
 2004 transaction commitments to A will arrange its business and interactions to meet B’s business  
 2005 needs.  
 2006 • G receives the signal from aggregator B. In the transaction between G and B, there are service,  
 2007 response, and likely security and other requirements. To meet its transactional requirements, the  
 2008 service operations between B and G will be implemented to satisfy the business needs of both B  
 2009 and G. For our example, they will use the public Internet with VPN technology and explicit  
 2010 acknowledgement, with a backup of pagers and phone calls in the unlikely event that the primary  
 2011 communication fails. And each message gets an explicit application level acknowledgement.  
 2012 • Security between B and G depends on the respective security models and infrastructure  
 2013 supported by B and G—no one size will fit all. So that security will be used for that interaction  
 2014 • The big box store chain has its own corporate security architecture and implementation, as well  
 2015 as reliability that meets its business needs—again, no one size will fit all, and there is tremendous  
 2016 variation; there is no monoculture of corporate security infrastructures.  
 2017 • Store L has security, reliability, and other system design and deployment needs and  
 2018 implementations within the store. These may or may not be the same as the WAN connection  
 2019 from regional headquarters G, and in fact are typically not the same (although some security  
 2020 aspects such as federated identity management and key distribution might be the same).  
 2021 • Store L also has a relationship with aggregator E, which for this example is Store L’s local utility;  
 2022 the Public Utility Commission for the state in which L is located has mandated (in this example)  
 2023 that all commercial customers will use Energy Interoperation to receive certain mandated signals  
 2024 and price communications from the local utility. The PUC, the utility, and the owner of the store L  
 2025 have determined the security and reliability constraints. Once again, one size cannot fit all—and if  
 2026 there were one “normal” way to accommodate security and reliability, there will be a different  
 2027 “normal” way in different jurisdictions.  
 2028 So for a simple Demand Response event distribution, we have potentially four different security profiles  
 2029 The following table has sample functional names for selected nodes.  
 2030 *Table 13-1: Interactions and Actors for Security and Reliability Example*

Label	Structure Role	Possible Actor Names
<b>A</b>	VTN	<b>System Operator</b>
<b>B</b>	VEN (wrt A), VTN (wrt F, G, H)	<b>Aggregator</b>
<b>G</b>	VEN (wrt B), VTN (wrt I, J, L)	<b>Regional Office</b>
<b>L</b>	VEN (wrt G and wrt E)	<b>Store</b>
<b>E</b>	VEN (wrt A, VTN wrt L)	<b>Local Utility</b>

2031 (Note: wrt means “with respect to”)

2032 **13.2 Composition**

2033 In state-of-the art software architecture, we have moved away from monolithic implementations and  
 2034 standards to ones that are composed of smaller parts. This allows the substitution of a functionally similar  
 2035 technology where needed, innovation in place, and innovation across possible solutions.  
 2036 In the rich ecosystem of service and applications in use today, we *compose* or (loosely) *assemble*  
 2037 applications rather than craft them as one large thing. See for example OASIS Service Component

2038 Architecture [**OASIS SCA**], which addresses the assembly, substitution, and independent evolution of  
2039 components.

2040 A typical web browser or email system uses many standards from many sources, and has evolved rapidly  
2041 to accommodate new requirements by being structured to allow substitution. The set of standards  
2042 (information, service, or messaging) is said to be *composed* to perform the task of delivery of email.  
2043 Rather than creating a single application that does everything, perhaps in its own specific way, we can  
2044 use components of code, of standards, and of protocols to achieve our goal. This is much more efficient  
2045 to produce and evolve than large integrated applications such as older customized email systems.

2046 In a similar manner, we say we *compose* the required security into the applications—say an aspect of  
2047 OASIS [**WS-Security**] and OASIS Security Access Markup Language [**SAML**]  
2048 and further *compose* the required reliability, say by using OASIS [**WS-ReliableMessaging**] or perhaps the reliable messaging  
2049 supported in an Enterprise Service Bus that we have deployed.

2050 A service specification, with specific information to be exchanged, can take advantage of and be used in  
2051 many different business environments without locking some in and locking some out, a great benefit to  
2052 flexibility, adoption, and re-use.

### 2053 **13.3 Energy Interoperation and Security**

2054 In this section we describe some specific technologies and standards in our palette for building a secure  
2055 and reliable implementation of Energy Interoperation. Since Energy Interoperation defines only the core  
2056 information exchanges and services, and other technologies are composed in, there is no optionality  
2057 related to security or reliability required or present in Energy Interoperation.

2058 The information model in Energy Interoperation 1.0 is just that—an information model without security  
2059 requirements. Each implementation must determine the security needs (outside the scope of this  
2060 standard) broadly defined, including privacy (see e.g. OASIS Privacy Management Reference Model  
2061 [\[ref\]\[PMRM\]](#)), identity (see e.g. OASIS Identity in the Cloud, OASIS Key Management Inteoperability,  
2062 OASIS Enterprise Key Management Infrastructure, OASIS Provisioning Services, OASIS Web Services  
2063 Federation TC, OASIS Web Services Secure Exchange and more)

2064 Energy Interoperation defines services together with service operations, as is now best practice in  
2065 enterprise software. The message payloads are defined as information models, and include such artifacts  
2066 as Energy Market Information Exchange [**EMIX**] price and product definition, tenders, and transactions,  
2067 the EiEvent artifacts defined in this specification, and all information required to be exchanged for price  
2068 distribution, program event distribution, demand response, and distributed energy resources.

2069 This allows the composition and use of required interoperation standards without restriction, drawing from  
2070 a palette of available standards, best practices, and technologies. The requirements to be addressed for  
2071 a deployment are system issues and out of scope for this specification.

2072 As in other software areas, if a particular approach is commonly used, [then](#) a separate standard (or  
2073 standardized profile) may be created. In this way, WS-SecureConversation composes WS-Reliability and  
2074 WS-Security.

2075 So Energy Interoperation defines the exchanged information, the services and operations, and as a  
2076 matter of scope and broad use does not address any specific application as the security, privacy,  
2077 performance, and reliability needs cannot be encompassed in one specification. Many of the TCs named  
2078 above have produced OASIS Standards,

2079 (SEE [http://www.oasis-open.org/committees/tc\\_cat.php?cat=security](http://www.oasis-open.org/committees/tc_cat.php?cat=security))



## 2080 14 Profiles [Normative]

2081 These sections define the three normative profiles that are part of Energy Interoperation 1.0.  
2082 A profile includes a selection of interfaces, services, and options for a particular purpose.

### 2083 14.1 OpenADR [Normative]

2084 The OpenADR Profile defines the services required to implement functionality similar to that in  
2085 **[OpenADR]**. The inclusion of the Energy Interoperation structure of VTNs and VENs, as well as use of  
2086 the Energy Market Information Exchange **[EMIX]** cross-cutting price and product definition standard and  
2087 WS-Calendar **[WS-Calendar]** based on the IETF **[iCalendar]** RFC updates and gives a broader range of  
2088 applicability in what has been described as the *OpenADR 2 Profile*.

2089 We present in simplified tabular form the Energy Interoperation services required as part of the OpenADR  
2090 Profile. When a service is included, all of the listed operations are included, so we list only the service  
2091 name and the section of this document.

2092 *Table 14-1: Services used in OpenADR Profile*

Service	Section	Notes
<b>EiRegisterParty</b>	7.1	Register to identify and receive information
<b>EiQuote</b>	7.2	EiDistributeQuote for distributing dynamic prices (push), other operations for pull including block and tier tariff communication
<b>EiEvent</b>	9	The core event functions and information models
<b>EiReport</b>	10	The ability to set periodic or one-time information on the state of a Resource
<b>EiAvail</b>	11.2	Constraints on the possible time a Resources is available or not
<b>EiOpt</b>	11.3	Overrides the EiAvail; addresses short-term changes in availability
<b>EiEnroll</b>	8	Used to enroll a Resource for participation in Events.
<b>EiMarketContext</b>	12.2	Used to discover program rules, standard reports, etc.

2093

### 2094 14.2 T~~E~~eMIX [Normative]

2095 The Transactive EMIX (T~~E~~eMIX) Profile defines the services required to implement functionality for  
2096 energy market interactions.

2097 We present in simplified tabular form the Energy Interoperation services required as part of the T~~E~~eMIX  
2098 Profile. When a service is included, all of the listed operations are required, so we list only the service  
2099 name and the section of this document.

2100 *Table 14-2: Services used in T~~E~~eMIX Profile*

Service	Section	Notes
<b>EiRegisterParty</b>	7.1	Register to identify and receive information
<b>EiQuote</b>	7.2	EiDistributeQuote for distributing dynamic prices (push), other

<i>Service</i>	<i>Section</i>	<i>Notes</i>
		components for pull
<b>EiTender</b>	7.2	The basic offer of agreement is called a tender
<b>EiTransaction</b>	7.3	The core services to reach agreement
<b>EiEnroll</b>	8	Used to enroll a Resource for participation in Events.
<b>EiMarketContext</b>	12.2	Used to discover program rules, standard reports, etc.
<b>EiDelivery</b>	7.4.1	Post-Transaction delivery information

2101

### 2102 **14.3 Price Distribution [Normative]**

2103 Many current initiatives envision Price Distribution as a separate Profile requiring neither transactive  
 2104 energy nor event-based interactions. The Price Distribution profile defines the minimal set of services  
 2105 required to interact with a pure Price Distribution context.

2106 We present in simplified tabular form the Energy Interoperation services required as part of the Price  
 2107 Distribution Profile. When a service is included, all of the listed operations are required, so we list only the  
 2108 service name and the section of this document.

2109 *Table 14-3: Services used in Price Distribution Profile*

<i>Service</i>	<i>Section</i>	<i>Notes</i>
<b>EiRegisterParty</b>	7.1	Register to interact with other Parties
<b>EiQuote</b>	7.2	EiDistributeQuote for distributing dynamic prices (push), other components for pull
<b>EiEnroll</b>	8	Used to enroll in a Market to receive Price Distribution.
<b>EiMarketContext</b>	12.2	Used to discover program rules, standard terms, etc.

2110

---

## 2111 15 Conformance and Processing Rules for Energy 2112 Interoperation

### 2113 15.1 Conformance for Energy Interoperation

2114 We define four conformance points for Energy Interoperation 1.0, modified by the networking technology  
2115 used

- 2116 • Full Conformance
- 2117 • Conformance

2118 And further define

- 2119 • Conformance to a Named Profile
- 2120 • Conformance with Alternate Interoperation

2121 In this section Named Profile is one of the profiles defined in Section 14 “**Profiles [Normative]**”.

#### 2122 15.1.1 General Conformance Requirements

2123 The version of Energy Interoperation to which conformance is claimed MUST be specified in the  
2124 implementation’s conformance statement.

2125 Any extension(s) used by the implementation, whether of information structures, services, service  
2126 operations, or payloads MUST be described in the Implementation’s conformance statement including the  
2127 service operations, payloads, and information artifacts.

2128 The phrase “support all XML artifacts” includes the support of XML artifacts as extended; similarly,  
2129 message headers (SOAP Headers for Web services) MAY be extended as needed to compose other  
2130 technologies including but not limited to reliability and security. The payloads defined in this specification  
2131 are for required information exchanges, and a Conforming implementation MAY extend ~~either~~ the data  
2132 types, payloads, or message headers appropriate to their transport/networking as necessary. It is  
2133 required that those extensions, restrictions, and so forth be documented in the conformance statement.

#### 2134 15.1.2 Full Conformance to Energy Interoperation

2135 An implementation claiming **Full Conformance to Energy Interoperation 1.0** MUST do all of the  
2136 following as defined in this Work Product including specification, schemas, and WSDL files:

- 2137 • Implement all services and service operations (“Services and Operations”)
- 2138 • Support all XML artifacts as defined in the schemas (“XML”)
- 2139 • Interoperate using Web services and the **[WSDL]** files (“Web Services Interoperation”)
- 2140 • Conform to all of Sections 13.2 through the end of Section 13 (“Additional Conformance”)
- 2141 • Describe how any relevant XML artifacts are derived from the Work Product

2142 It is RECOMMENDED that interoperation be achieved using the WSI Basic Profile **[WSI-Basic]**

#### 2143 15.1.3 Conformance to Energy Interoperation

2144 An implementation claiming **Conformance to Energy Interoperation 1.0** MUST do all of the following as  
2145 defined in this Work Product including specification, schemas, and WSDL files:

- 2146 • Interoperate using Web services and the **[WSDL]** files (“Web Services Interoperation”)
- 2147 • Conform to all of Sections 13.2 through the end of Section 13 (“Additional Conformance”)
- 2148 • Describe how any relevant XML artifacts are derived from the Work Product

2149 In addition, if the application claiming conformance does not support one or more Services or Operations  
2150 as defined in this specification, then the conformance statement for the implementation must:

- 2151 • List all Services and Operations that are supported in the implementation.

- 2152       • List all Services and Operations that are not supported in the implementation.  
2153       • For each Operation that is not supported, define the error response that will be returned if  
2154       invoked.

2155 For those operations that are supported by an implementation, but whose use or semantics are restricted,  
2156 a conforming implementation SHALL

- 2157       • List the subset of XML artifacts as defined by the schemas used in the implementation  
2158       • List the subset of XML artifacts as defined by the schemas that are not used in the specification  
2159       • State any restrictions, i.e., in cardinality or optionality, that is applied to artifacts defined herein

#### 2160 **15.1.4 Full Conformance with Alternate Interoperation to Energy** 2161 **Interoperation**

2162 An implementation claiming **Full Conformance with Alternate Interoperation to Energy Interoperation**  
2163 **1.0** MUST be able to claim **Full Conformance to Energy Interoperation**, except that networking  
2164 technologies other than Web services MAY be used by the implementation. A description of networking  
2165 technologies used MUST be included in the implementation's conformance statement.

2166 An implementation MAY claim Full Conformance as well as Full Conformance with Alternate  
2167 Interoperation. The Conformance statement MUST describe the extensions or departures from Full  
2168 Conformance.

#### 2169 **15.1.5 Conformance with Alternate Interoperation to Energy Interoperation**

2170 An implementation claiming **Conformance with Alternate Interoperation to Energy Interoperation 1.0**  
2171 MUST be able to claim **Conformance to Energy Interoperation**, except that networking technologies  
2172 other than Web services MAY be used by the implementation. A description of networking technologies  
2173 used MUST be included in the implementation's conformance statement.

2174 An implementation MAY claim Conformance as well as Conformance with Alternate Interoperation. The  
2175 Conformance statement MUST describe the extensions or departures from Full Conformance.

#### 2176 **15.1.6 Conformance to Named Profiles of Energy Interoperation**

2177 In this section Named Profile refers to one of the profiles defined in Section 14 "**Profiles [Normative]**".

##### 2178 **15.1.6.1 Full Conformance to a Named Profile of Energy interoperation**

2179 An implementation claiming **Full Conformance to a Named Profile of Energy Interoperation** MUST be  
2180 able to claim **Full Conformance to Energy Interoperation** excepting only the following:

- 2181       • Services and Operations in sections not included in the named Profile as defined in Section 14  
2182       [wd35 – should be link]

2183 It is RECOMMENDED that Web services interoperation be achieved using the WSI Basic Profile [**WSI-**  
2184 **Basic**]

##### 2185 **15.1.6.2 Conformance to a Named Profile of Energy interoperation**

2186 An implementation claiming **Conformance to a Named Profile of Energy Interoperation** MUST be able  
2187 to claim **Conformance to Energy Interoperation** excepting only the following:

- 2188       • Services and Operations in sections not included in the named Profile

2189 It is RECOMMENDED that Web services interoperation be achieved using the WSI Basic Profile [**WSI-**  
2190 **Basic**]

2191 **15.1.6.3 Full Conformance or Conformance with Alternate Interoperation to a**  
2192 **Named Profile**

2193 An implementation claiming **Conformance with Alternate Interoperation** or **Full Conformance with**  
2194 **Alternate Interoperation to a Named Profile of Energy Interoperation** MUST be able to claim the  
2195 respective **Full Conformance with Alternate Interoperation** or **Conformance with Alternate**  
2196 **Interoperation to Energy Interoperation** excepting only the following:

- 2197 • Services and Operations in sections not included in the Named Profile

2198 In addition, interoperation payloads MUST be used as defined or extended; in the event that payloads are  
2199 extended a description of the extension(s) SHALL be included in the Implementation's conformance  
2200 statement.

2201 **15.2 Conformance with the Semantic Models of EMIX and WS-**  
2202 **Calendar**

2203 This section specifies conformance with the semantic models of **[EMIX]** and **[WS-Calendar]**. Energy  
2204 Interoperation is strongly dependent on each of these information models.

2205 **[WS-Calendar]** is a general specification and makes no assumptions about how its information model is  
2206 used. **[WS-Calendar]** has specific rules which define Inheritance as a means to reduce the conveyance  
2207 of repetitive information. As this specification constrains schedule communications to specific business  
2208 interactions, these inheritance rules are extended to embrace rules of interaction and rules of process  
2209 that further reduce the information that must be expressed in each interval.

2210 Implementations of Energy Interoperation SHALL conform to the rules of **[WS-Calendar]** and **[EMIX]**.  
2211 These rules include the following conformance types:

- 2212 • Conformance to the **inheritance rules** in **[WS-Calendar]**, including the direction of inheritance
- 2213 • **Specific attributes** for each type that MUST or MUST NOT be inherited.
- 2214 • **Conformance rules** that Referencing Specifications MUST follow
- 2215 • Description of **Covarying attributes** with respect to the Reference Specification
- 2216 • **Semantic Conformance** for the information within the Artifacts exchanged.
- 2217 • Conformance to the **inheritance rules** in **[EMIX]**, including inheritance of Product Definitions and  
2218 Standard Terms.

2219 Energy Interoperation implementations also use the EMIX Products and Resources also extend the  
2220 Inheritance patterns of **[WS-Calendar]** as specified in the EMIX information model. We address each of  
2221 these in the following sections.

2222 **15.2.1 Recapitulation of Requirements from WS-Calendar and EMIX**

2223 **[WS-Calendar]** uses the term Sequence to refer to one or more Intervals with Temporal Relations  
2224 defined between them that may inherit from zero or more Gluons. **[EMIX]** introduced the term Schedule to  
2225 refer to Product Descriptions applied to a Sequence. Streams recapitulate these rules with specific  
2226 addenda as they include both Gluon and Sequence.

2227 **15.2.1.1 Specific Attribute Inheritance within Schedules**

2228 The rules that define inheritance, including direction in **[WS-Calendar]**, are recapitulated.

2229 **I1: Proximity Rule** Within a given lineage, inheritance is evaluated though each Parent to the Child  
2230 before what the Child bequeaths is evaluated.

2231 **I2: Direction Rule** Intervals MAY inherit attributes from the nearest Gluon subject to the Proximity Rule  
2232 and Override Rule, provided those attributes are defined as Inheritable.

2233 **I3: Override Rule** If and only if there is no value for a given attribute of a Gluon or Interval, that Gluon or  
2234 Interval SHALL inherit the value for that attribute from its nearest Ancestor in conformance to the  
2235 Proximity Rule.

2236 **I4: Comparison Rule** Two Sequences are equivalent if a comparison of the respective Intervals  
2237 succeeds as if each Sequence were fully Bound and redundant Gluons are removed.

2238 **I5: Designated Interval Inheritance** [To facilitate composition of Sequences] the Designated Interval in  
2239 the ultimate Ancestor of a Gluon is the Designated Interval of the composed Sequence. Special  
2240 conformance rules for Designated Intervals apply only to the Interval linked from the Designator Gluon.

2241 **I6: Start Time Inheritance** When a start time is specified through inheritance, that start time is inherited  
2242 | only by the Designated Interval; the start times of all other Intervals are computed through the durations  
2243 | and temporal; relationships within the Sequence. The Designated Interval is the Interval whose parent is  
2244 | at the end of the lineage. In Events, the Active Interval is the Designated Interval.

### 2245 **15.2.1.2 Time Zone Specification**

2246 The time zone MUST be explicitly known in any conforming Energy Interoperation artifact.

2247 This may be accomplished in two ways:

- 2248 • The time, date, or date and time MUST be specified using **[ISO8601]** utc-time (also called  
2249 *zulu time*)
- 2250 • The **[WS-Calendar]** Time Zone Identifier, TZID, MUST be in the Lineage of the artifact, as  
2251 extended by the Market Context. Generally, the Market Context acts as a Gluon  
2252 bequeathing the TZID. See Section 15.3 below.

2253 If neither expression is included, the Artifact does not conform to this specification and its attempted use  
2254 in information exchanges MUST result in an error condition.

### 2255 **15.2.1.3 Specific Rules for Optimizing Inheritance**

2256 If the Designated Interval in a Series has a Price only, all Intervals in the Sequence have a Price only and  
2257 there is no Price in the Product.

- 2258 • If the Designated Interval in a Series has a Quantity only, all Intervals in the Sequence have a  
2259 Quantity only and there is no quantity in the Product.
- 2260 • If the Designated Interval in a Series has a Price & Quantity, all Intervals in the Sequence MUST  
2261 have a Price and Quantity and there is neither Price not Quantity in the Product.

## 2262 **15.3 TeMIX Conformance**

2263 The TeMIX Profile MUST apply the conformance rules for TeMIX described in **[EMIX]**.

## 2264 **15.4 Inheritance within Events**

2265 For purposes of processing, inheritance, and conformance, Signal Information is treated as an **[EMIX]**  
2266 | Product Description, applied to a Sequence, and the Active Period is considered as **ana** **[WS-Calendar]**  
2267 | Schedule. The Streams in Signals and Event-linked Reports inherit from the Active Interval as if it were a  
2268 | Gluon.

2269 Signals within an Event arrive in a setting established by a Market Context. Within an event, there may be  
2270 multiple Signal types. For purposes of inheritance, An Event may include multiple Stream-derived  
2271 information elements each with an associated Sequence. For purposes of processing, the body of the  
2272 Stream is treated as a **[WS-Calendar]** Gluon, and the Signal Information in each Interval in the Sequence  
2273 inherits from that Gluon.

2274 Each Specifies a Market Context. If that Market Context is associated with Standard Terms, then those  
2275 Terms enter the Lineage of the Schedule and are inherited by each Interval. Standard Terms associated  
2276 with a Market Context enter the Lineage of the Schedule as if the Market Context were a Gluon. Product  
2277 Description, TZID, Level Definition, Terms, et al. can be inherited in this way.

2278 **15.4.1 Sequence Optimization within Events**

2279 As described in 4.3.2 “Conformance of Streams to WS-Calendar”, Signals, Reports, and Baselines MUST  
2280 conform to WS-Calendar.

2281 **15.5 Version Conformance**

2282 Implementations that use the Schema Version attribute, and that claim full conformance to this  
2283 specification, MAY use the use the value “1.0.2011.11” for that attribute.

## Appendix A. Background and Development history

2285 There is a significant disconnect between customer load and the value of energy. The demand is not  
 2286 sensitive to supply constraints; the load is not elastic; and the market fails to govern consumer behavior.  
 2287 In particular, poor communications concerning high costs at times of peak use cause economic loss to  
 2288 energy suppliers and consumers. There are today a limited number of high demand periods (roughly ten  
 2289 days a year, and only a portion of those days) when the failure to manage peak demand causes immense  
 2290 costs to the provider of energy; and, if the demand cannot be met, expensive degradations of service to  
 2291 the consumer of energy.

2292 As the proportion of alternative energies on the grid rises, and more energy comes from intermittent  
 2293 sources, the frequency and scale of these problems will increase and there will be an increasing need for  
 2294 24/7 coordination of supply and demand. In addition, new electric loads such as electric vehicles will  
 2295 increase the need for electricity and with new load characteristics and timing.

2296 Energy consumers can use a variety of technologies and strategies to shift energy use to times of lower  
 2297 demand as well as to reduce use during peak periods. This shifting and reduction can reduce the need for  
 2298 new power plants, and transmission and distribution systems. These changes will reduce the overall  
 2299 costs of energy through greater economic efficiency. This process is known by various names, including  
 2300 load shaping, demand shaping, and demand response (DR). Consistent interfaces and messages for DR  
 2301 is a high priority cross-cutting issue identified in the NIST Smart Grid Interoperability Roadmap.

2302 Distributed energy resources, including generation and storage, now challenge the traditional hierarchical  
 2303 relationship of supplier and consumer. Alternative and renewable energy sources may be located closer  
 2304 to the end nodes of the grid than traditional bulk generation, or even within the end nodes. Wind and solar  
 2305 generation, as well as industrial co-generation, allow end nodes to sometimes supply. Energy storage,  
 2306 including mobile storage in plug-in hybrid vehicles, means that even a device may be sometimes a  
 2307 supplier, sometime a customer. As these sources are all intermittent, they increase the challenge of  
 2308 coordinating supply and demand to maintain the reliability of the electric grid. These resource, with their  
 2309 associated issues, are generally named distributed energy resources (DER). The NIST Smart Grid  
 2310 Interoperability Roadmap, this specification, and **[EMIX]** see a continuum between DR and DER.

2311 Better communication of energy prices addresses growing needs for lower-carbon, lower-energy  
 2312 buildings, net zero-energy systems, and supply-demand integration that take advantage of dynamic  
 2313 pricing. Local generation and local storage require that the consumer (in today's situation) make  
 2314 investments in technology and infrastructure including electric charging and thermal storage systems.  
 2315 People, buildings, businesses and the power grid will benefit from automated and timely communication  
 2316 of energy prices, capacity information, and other grid information.

2317 Consistency of interface for interoperation and standardization of data communication will allow  
 2318 essentially the same model to work for homes, small businesses, commercial buildings, office parks,  
 2319 neighborhood grids, and industrial facilities, simplifying interoperation across the broad range of energy  
 2320 providers, distributors, and consumers, and reducing costs for implementation.

2321 These communications will involve energy consumers, producers, transmission systems, and distribution  
 2322 systems. They must enable aggregation of production, consumption, and curtailment resources. These  
 2323 communications must support market makers, such as Independent System Operators (ISOs), utilities,  
 2324 and other evolving mechanisms while maintaining interoperation as the Smart Grid evolves. On the  
 2325 consumer side of these interfaces, building and facility agents will be able to make decisions on energy  
 2326 sale, purchase, and use that fit the goals and requirements of their home, business, or industrial facility.

2327 The new symmetry of energy interactions demands symmetry of interaction. A net consumer of energy  
 2328 may be a producer when the sun is shining, the wind is blowing, or an industrial facility is cogenerating<sup>12</sup>.

<sup>12</sup> Cogeneration refers the combined generation of multiple energy resources, i.e., a boiler that both spins a turbine to generate electricity and produces steam to run an industrial process. Cogeneration can include any number of energy distributions, including heat, cold, pressure, et al.



2329 Each interface must support symmetry as well, with energy and economic transactions able to flow each  
2330 way.

2331 Energy Interoperation defines the market interactions between smart grids and their end nodes  
2332 (Customers), including Smart Buildings and Facilities, Enterprises, Industry, Homes, and Vehicles. Market  
2333 interactions are defined here to include all informational communications and to exclude direct process  
2334 control communications. This document defines signals to communicate interoperable dynamic price,  
2335 reliability, and emergency signals to meet business and energy needs, and scale, using a variety of  
2336 communication technologies.

2337

## Appendix B. Glossary

- 2338 No definition in this glossary supplants normative definitions in this or other specifications. They are here  
2339 merely to provide a guidepost for readers at to terms and their special uses. Implementers will want to be  
2340 familiar with all referenced standards.
- 2341 Agreement is broad context that incorporates market context and programs. Agreement definitions are  
2342 out of scope in Energy Interoperation.
- 2343 DR Resource: see Resource.
- 2344 EMIX: As used in this document, EMIX objects are descriptions applied to a WS-Calendar Sequence.  
2345 EMIX defines Resource capabilities, used in tenders to match capabilities to need, and in  
2346 Products, used in tenders and in specific performance and execution calls.
- 2347 Feedback: Information about the state of a Resource; typically in relation to planning or executing a  
2348 response to an Event
- 2349 Resource (as used in Energy Interoperation): a Resource is a logical entity that is dispatchable. The  
2350 Resource is solely responsible for its own response. A resource description specifies the  
2351 performance envelope for a Resource. If a Resource can participate in multiple markets, it may  
2352 have ~~multiple descriptions~~multiple descriptions.
- 2353 Resource (as defined in EMIX): A Resource is something that can describe its capabilities in a Tender  
2354 into a market. How those Capabilities vary over time is defined by application of the Capability  
2355 Description to a WS-Calendar Sequence. See [EMIX].
- 2356 Status: Information about an Event, perhaps in relation to a specific Resource.
- 2357 Sequence: A set of temporally related intervals with a common relation to some informational artifact as  
2358 defined in WS-Calendar. Time invariant elements are in the artifact (known as a gluon) and time-  
2359 varying elements are in each interval.
- 2360 Tender: A tender is an offering for a Transaction. See Transaction.
- 2361 Transaction: A binding commitment between parties entered into under an agreement.
- 2362 VEN – see Virtual End Node
- 2363 Virtual End Node (VEN): The VEN has operational control of a set of resources and/or processes and is  
2364 able to control the output or demand of these resources in affect their generation or utilization of  
2365 electrical energy intelligently in response to an understood set of smart grid messages. The VEN  
2366 may be either a producer or consumer of energy. The VEN is able to communicate (2-way) with a  
2367 VTN receiving and transmitting smart grid messages that relay grid situations, conditions, or  
2368 events. A VEN may take the role of a VTN in other interactions.
- 2369 Virtual Top Node (VTN): a Party that is in the role of aggregating information and capabilities of  
2370 distributed energy resources. The VTN is able to communicate with both the Grid and the VEN  
2371 devices or systems in its domain. A VTN may take the role of a VEN interacting with another  
2372 VTN.
- 2373 VTN – see Virtual Top Node

2374

## Appendix C. Extensibility in Energy Interoperation

2375 Extensibility was a critical design constraint for Energy Interoperation. Extensibility allows the Energy  
2376 Interoperation specification to be used in markets and in interactions that were not represented on the  
2377 Technical Committee. Formal extensibility rules also create a set of complaint extensions for incorporation  
2378 into later versions that are already compliant.

### 2379 C.1 Extensibility in Enumerated values

2380 EI defines a number of enumerations. Some of these, such as measurements of power, are predictably  
2381 stable. Others, such as market contracts or energy sources, may well have new elements added. In  
2382 general, these accept any string beginning with “x-“ as a legal extension. In particular, these are defined  
2383 using the following mechanism in the formal schemas (XSD’s).

2384 In ei.xsd, the extensibility pattern is defined. This pattern look like:

```
2385 <xs:simpleType name="EiExtensionType">  
2386 <xs:annotation>  
2387 <xs:documentation>Pattern used for extending string  
2388 enumeration, where allowed</xs:documentation>  
2389 </xs:annotation>  
2390 <xs:restriction base="xs:string">  
2391 <xs:pattern value="x-\.S.*"/>  
2392 </xs:restriction>  
2393 </xs:simpleType>
```

2394 Non-extensible enumerated types look like this:

```
2395 <xs:simpleType name="VoltageUnitsType">  
2396 <xs:restriction base="xs:string">  
2397 <xs:enumeration value="MV"/>  
2398 <xs:enumeration value="KV"/>  
2399 <xs:enumeration value="V"/>  
2400 </xs:restriction>  
2401 </xs:simpleType>
```

2402 In this case, we use the suffix “EnumeratedType” to allow for the possibility of other Measurement  
2403 Protocols that are not enumerated. Actual compliance, though, is based upon the type:

```
2404 <xs:simpleType name="MeasurementProtocolType">  
2405 <xs:union memberTypes="power:MeasurementProtocolEnumeratedType  
2406 emix:EmixExtensionType"/>  
2407 </xs:simpleType>
```

2408 That is, valid values for the measurement protocol are the enumerated values, and any that match the  
2409 extension pattern “x-”

### 2410 C.2 Extension of Structured Information Collective Items

2411 EI anticipates adding some information structures that are more complex than simple strings can be  
2412 extended as well. A challenge for these items is that they are more complicated and so require formal  
2413 definition. Formal definitions, expressed as additions to schema, could require changes to the  
2414 specification. Without formal definition, it is difficult for trading partners to agree on valid messages.

2415 EI uses abstract classes for many information exchanges. For example, trading partners could agree on  
2416 the exchange of additional Payloads. The existing list of Payloads are derived from the empty, abstract  
2417 Payload Base Type. Parties that wish to exchange other Payloads can derive new Types from Payload  
2418 Base and use them in Signals, Baselines, Reports, and Delivery.

2419 The resulting schema, which references the approved EI schemas, but does not change them, can then  
2420 be distributed to business partners to validate the resulting message exchanges.

## Appendix D. Mapping NAESB Definitions to Terminology of Energy Interoperation

2421 Energy Interoperation can be used in today's markets and business interactions. Generally accepted  
 2422 business terms for these markets were defined for both the retail and wholesale electrical quadrants in  
 2423 the **NAESB PAP09 Requirements Phase 2 [NAESB PAP09]**.

2426 Because Energy Interoperation describes a general-purpose mechanism that can be used by parties for  
 2427 today's market interactions at several levels of today's markets as well as for new and extended future  
 2428 interactions, the terms do not determinatively map to the NAESB semantics. Symmetric use of the  
 2429 interfaces in this specification can make some mappings ambiguous.

2430 There are several kinds of definitions used in Energy Interoperation and in EMIX.

2431 Abstraction over a class of similar information (for example, the EMIX Interface, the *EmixInterfaceType*  
 2432 abstract type, addresses all locational information including geospatial, P-Node, AP-Node, and more.)

2433 Simplification (for example, Party addresses all Business Entities as the focus is on the service  
 2434 interaction; a Business Entity presents and assumes various roles and interfaces)

2435 Algebraic combination (for example, a Resource summarizes characteristics from both curtailment and  
 2436 generation/battery draw-down as equivalent, though the market values and markets may vary)

2437 Some terms are outside the scope of Energy Interoperation, hence neither used nor defined (for example,  
 2438 Asset, Resource Object, Regulator).

2439 With these caveats, most of the terms defined by NAESB can be mapped to those in this specification.

2440 *NOTE: Market Participant is not defined explicitly; in the NAESB document. Party is the generalization of*  
 2441 *business entities. A Party enrolls and some of the "thingsParties enrolled and is qualified in", (possibly*  
 2442 *with a separate qualification step) are roles such as LSE, MA, etc...so. We use the answer for these*  
 2443 *isphrase "Party enrolled as ..." in the table below to describe that situation.*

2444

2445

NAESB Term	Definition from NAESB	Energy Interoperation Term
Asset	A logical entity with measurable and reportable consumption, e.g. an Asset may be a physical device with its own meter, or the main meter at the Service Delivery Point of a Service Location.	Not used in 1.0
Asset Group	A logical entity that has a reportable interval level consumption, e.g. an Asset Group may be a physical entity with its own meter, a neighborhood of homes that has a net meter, or an estimate of consumption of an aggregation of retail customers.	Not used in 1.0
Business Entity	The wholesale or retail entity that interacts with other entities in its market.	<b>Party</b>

NAESB Term	Definition from NAESB	Energy Interoperation Term
Communication Method	The method by which an object communicates with another object to instruct, measure, report or control.	Out of scope. Energy Interoperation defines SOA Web Services
Control	The role associated with the control of an end device.	Out of scope
Designated Dispatch Entity (DDE)	A role which carries the responsibility of receiving and processing demand resource dispatch instructions or market information and (optionally) providing response information.	Party enrolled as DDE
Distributed Energy Resources (DER)	DERs are small, modular, energy generation and storage technologies that provide electric capacity or energy where it is needed. Definition of DER provided by the Department of Energy, <a href="http://www1.eere.energy.gov/femp/pdfs/31570.pdf">http://www1.eere.energy.gov/femp/pdfs/31570.pdf</a>	<b>Resource</b>
Environmental Authority (EA)	A regulatory authority responsible for the development, reporting and enforcement of environmental activities.	Out of scope
Federal Regulator (FR)	A federal regulatory authority.	Out of scope
Load-Serving Entity (LSE)	The responsible entity that secures energy and Transmission Service (and related Interconnected Operations Services) to serve the electrical demand and energy requirements of its end-use customers.	<b>Party</b> enrolled as LSE
Local Authority (LA)	A regulatory authority responsible for the oversight and administration of utility service-related functions within its jurisdiction.	Out of scope
Market Enrollment	The collection of enrollment or tariff data for a Resource Object to provide a specific market product or service.	Enrollment of a <b>Resource</b> combined with <b>Market Standard Terms</b>

NAESB Term	Definition from NAESB	Energy Interoperation Term
Market Participant (MP)	An organization registered with the System Operator that may take on roles such as SP, LSE, TDSP, DDE, SE, and/or MA in accordance with the SO's market rules.	<b>Party</b> enrolled as an MP
Measurement	The role associated with the device or algorithm that measures the consumption or supply of an end device.	<b>Measurement</b>
Meter Authority (MA)	A role which carries the responsibility of providing data necessary to determine the performance of a Resource.	<b>Party</b> enrolled as an MA
P-Node	The price location of the Premise in the transmission and/or distribution network.	<b>EMIX Interface</b> is superclass
Participant	The entity that represents resources to a market or distribution operator.	Party
Regulator	A rule-making and enforcement entity.	Out of scope
Resource	A market-dependent group of Response Method Aggregations that represents a dispatchable entity. <sup>13</sup>	<b>EMIX Resource</b>
Resource Object	Physical and logical types of demand response resource objects.	Out of scope
Scheduling Entity(SE)	A role which carries the responsibility of submitting bids/offers and receives schedules and awards.	<b>Party</b> enrolled as an SE
Service Delivery Point	The identifier of the location where electric service is delivered to the Service Location.	<b>EMIX Interface</b> is superclass
Service Location	The physical location at which connection to the transmission or distribution system is made.	<b>EMIX Interface</b> is superclass
Service Provider (SP)	A role which carries the responsibility of coordinating resources to deliver electricity products and services to a market or distribution operator.	<b>Party</b> enrolled as an SP. All roles offer services.
State Regulator (SR)	A regulatory authority responsible for the oversight and administration of electric utilities.	Out of scope
Supporting Objects	Objects that support the interaction of Business Entities and Resource Objects.	Out of scope

<sup>13</sup> This presumably is a DDE earlier in the table, as Dispatch Entity is not defined here.

NAESB Term	Definition from NAESB	Energy Interoperation Term
Transmission/Distribution Service Provider (TDSP)	A role which carries the responsibility of operating a local electricity transmission and/or distribution system.	<b>Party</b> enrolled as a TDSP
Utility Customer (UC)	An end-use customer of the Utility Distribution Operator that takes on roles such as Premise or Resource.	Not defined explicitly. <b>Party</b> may take role
Utility Distribution Operator (UDO)	An entity which carries the responsibility of operating an electricity distribution system.	Not defined explicitly. <b>Party</b> that provides transport products
Zone	A physical or electrical region.	<b>EMIX Interface</b> is the superclass

2446

2447

---

## Appendix E. Acknowledgements

2448 The following individuals have participated in the creation of this specification and are gratefully  
2449 acknowledged:

2450 | **Participants:**

- 2451 Hans Aanesen, Individual
- 2452 Bruce Bartell, Southern California Edison
- 2453 Timothy Bennett, Drummond Group Inc.
- 2454 Carl Besaw, Southern California Edison
- 2455 Anto Budiardjo, Clasma Events, Inc.
- 2456 Edward Cazalet, Individual
- 2457 Joon-Young Choi, Jeonju University
- 2458 Kevin Colmer, California Independent System Operator
- 2459 Toby Considine, University of North Carolina
- 2460 William Cox, Individual
- 2461 Sean Crimmins, California Independent System Operator
- 2462 Phil Davis, Schneider Electric
- 2463 Sharon Dinges, Trane
- 2464 Robert Dolin, Echelon Corporation
- 2465 Rik Drummond, Drummond Group Inc.
- 2466 Ernst Eder, LonMark International
- 2467 Thomas Ferrentino, Individual
- 2468 Craig Gemmill, Tridium, Inc.
- 2469 Girish Ghatikar, Lawrence Berkeley National Laboratory
- 2470 Gerald Gray, Southern California Edison / Electric Power Research Institute (EPRI)
- 2471 Anne Hendry, Individual
- 2472 Thomas Herbst, Cisco Systems, Inc.
- 2473 David Holmberg, NIST
- 2474 Gale Horst, Electric Power Research Institute (EPRI)
- 2475 Ali Ipakchi, Open Access Technology International Inc. (OATi)
- 2476 Oliver Johnson, Tendril Networks, Inc.
- 2477 Sila Kiliccote, Lawrence Berkeley National Laboratory
- 2478 Ed Koch, Akuacom Inc
- 2479 Michel Kohanim, Universal Devices, Inc.
- 2480 Larry Lackey, TIBCO Software Inc.
- 2481 Derek Lasalle, JPMorganChase
- 2482 Jeremy Laundergan, Southern California Edison
- 2483 Benoit Lepeuple, LonMark International
- 2484 Edgardo Luzcando, Midwest ISO and ISO/RTO Council (IRC)
- 2485 Carl Mattocks, Individual
- 2486 Dirk Mahling, CPower
- 2487 Kyle Meadors, Drummond Group Inc.
- 2488 Scott Neumann, Utility Integration Solutions Inc.
- 2489 Robert Old, Siemens AG
- 2490 Mary Ann Piette, Lawrence Berkeley National Laboratory
- 2491 Joshua Phillips, Southwest Power Pool and ISO/RTO Council (IRC)
- 2492 Donna Pratt, New York ISO and ISO/RTO Council (IRC)
- 2493 Ruchi Rajasekhar, Midwest Independent System Operator
- 2494 Jeremy Roberts, LonMark International
- 2495 Anno Scholten, Individual
- 2496 Pornsak Songkakul, Siemens AG
- 2497 Jane Snowdon, IBM
- 2498 Aaron Snyder, NIST
- 2499 William Stocker, New York ISO and ISO/RTO Council (IRC)



2500 Pornsak Songkakul, Siemens AG  
2501 Robert Stayton, Individual  
2502 Jake Thompson, EnerNOC  
2503 Matt Wakefield, Electric Power Research Institute (EPRI)  
2504 Douglas Walker, California Independent System Operator  
2505 Evan Wallace, NIST  
2506 Dave Watson, Lawrence Berkeley National Laboratory  
2507 David Wilson, Trane  
2508 Leighton Wolfe, Individual  
2509 Brian Zink, New York Independent System Operator  
2510 The Technical Committee also acknowledges the work of the contributing groups who did so much to  
2511 bring requirements and use cases to the attention of the Committee. In particular, the ISO/RTO Council  
2512 task force on Demand Response, the UCAlug OpenSG Task Force on OpenADR, and the NAESB Smart  
2513 Grid Task Force provided invaluable guidance and frequent feedback.  
2514 The following individuals have participated in the creation of this specification and are gratefully  
2515 acknowledged:  
2516 **UCAlug OpenSG OpenADR Task Force:**  
2517 Albert Chiu, Pacific Gas & Electric  
2518 Bruce Bartell, Southern California Edison  
2519 Gerald Gray, Southern California Edison  
2520  
2521 **The ISO / RTO Council Smart Grid Standards Project:**  
2522 We want to thank the IRC team, in particular those who directly participated in this Technical Committee:  
2523 Edgardo Luzcando, Midwest ISO and ISO/RTO Council (IRC)  
2524 Donna Pratt, New York ISO and ISO/RTO Council (IRC)  
2525 William Stocker, New York ISO and ISO/RTO Council (IRC)  
2526 The IRC team consisted of a large group of participants from ISOs and RTOs. See the IRC Smart Grid  
2527 Standards web site for additional details about the project and team members -  
2528 [http://www.isorto.org/site/c.jhKQIZPBlmE/b.6368657/k.CCDF/Smart\\_Grid\\_Project\\_Standards.htm](http://www.isorto.org/site/c.jhKQIZPBlmE/b.6368657/k.CCDF/Smart_Grid_Project_Standards.htm)  
2529  
2530 | **NAESB Smart Grid Standards Development Subcommittee Co-chairs:**  
2531 Brent Hodges, Reliant  
2532 Robert Burke, ISO New England  
2533 Wayne Longcore, Consumers Energy  
2534 Joe Zhou, Xtensible Solutions

## Appendix F. Revision History

Revision	Date	Editor	Changes Made
1.0 WD 01		Toby Considine	Initial document, largely derived from OpenADR
1.0 WD 02		Toby Considine	
1.0 WD 03		Toby Considine	
1.0 WD 04		Toby Considine	
1.0 WD 05		Toby Considine	
1.0 WD 06		Toby Considine	
1.0 WD 07		Toby Considine	
1.0 WD 08	2010-03-09	Toby Considine	Reduced core functions to two service groups, transactive energy and eliminated references to managed energy
1.0 WD 09	2010-03-23	Toby Considine	
1.0 WD 10	2010-05-11	William Cox	Updated interaction model per analysis and drawings in TC meetings in April and early May
1.0 WD 11	2010-05-18	William Cox and David Holmberg	Improved model; editorial and clarity changes. Addressed comments on interaction and service model from TC meetings in May 2010.
1.0 WD 12	2010-05-21	William Cox	Editorial and content corrections and updates. Consistency of tone; flagged portions that are more closely related to EMIX.
1.0 WD 13	2010-08-31	Toby Considine Ed Cazalet	Recast to meet new outline, Removed much of the "marketing" content or moved, for now, to appendices. Re-wrote Sections 2, 3. Created placeholders in 4, 5,6 for services definitions.
1.0 WD 14	2010-10-31	William Cox	Completed service descriptions and restructured the middle of the document. Completed the EiEvent service and included UML diagrams. Deleted no longer relevant sections.
1.0 WD 15	2010-11-15	William Cox Toby Considine	Re-wrote sections 5, 7. Re-cast and combined to divergent sections 3. Misc Jira responses
1.0 WD 16	2010-11-18	William Cox	Added missing Section 6

1.0 WD 17	2010-11-22	Toby Considine, William Cox	Responded to many comments, added Program Services, added description of Resources and EMIX and WS-Calendar (4). Added Glossary
1.0 WD 18	2010-11-24	Toby Considine	Responded to formal comments Added additional language on WS-Calendar Incorporated missing Program Call Added Simple Market Model to Interactions
1.0 WD 19	2011-02-06	Toby Considine	"Clearing the Underbrush" – numerous trivial edits from PR process
1.0 WD20	2011-03-03	Ed Cazalet, Toby Considine	Reorganization of material into new document structure
1.0 WD21	2011-03-06	Ed Cazalet, Toby Considine	Completion of reorganization (transitional material) and repair of all (I hope) links and cross-references
1.0 WD22	2011-03-07	William Cox Toby Considine	Update of UML and Services Repaired documents (links & numbering broken again)
1.0 WD23	2011-05-10	David Holmberg William Cox Toby Considine	Update to add interaction diagrams, improve text, and add sections on service operation naming, push, and pull.
1.0 WD24	2011-06-28	William Cox Toby Considine	Updates to EiEvent, EiOpt, EiAvail, EiFeedbak, EiStatus. Deleted EiProgram. Updated model, schemas, and diagrams.
1.0 WD25	2011-07-04	Toby Considine William Cox	Numerous Jira issues, new schemas, new UML,
1.0 WD26	2011-07-08	Toby Considine	No changes to Spec, updated schemas to refer to EMIX PR03
1.0 WD27	2011-08-21	Gerald Gray Ed Cazalet David Holmberg	Updated to include Interaction work by Gerald Gray, Ed Cazalet, Appendix mapping to NAESB terms by Holmberg, Cazalet, Cox. Note that the Cazalet and Gray interaction models for Enrollment are different in approach. I have included them both for Committee discussion (Tables 7.1, 7.2).
1.0 WD28	2011-08025	Gerald Gray	Service Interactions re-written, re-titled to meet CIM expectations. All new interaction diagrams from Gray.
WD29	2011-10-10	Toby Considine	Expanded section on Composition, WS-Calendar, EMIX (4) Added section on Semantics of EI (5)

			Fixed broken references
WD30	2011-10-15	Toby Considine	Edits of first 5 sections for clarity, update of pictures
WD31	2011-10-17	Toby Considine William T Cox	New Section 10 Revised Reports discussion
WD32	2011-10-22	Toby Considine William T Cox Ed Koch Ed Cazalet	Re-wrote Streams and Reports for more clarity, to eliminate snaps, and to allow multiplicity. Refined Event description Defined Report Types New introduction to section 3
WD33	2011-10-28	Toby Considine William T. Cox Gerry Gray	Many niggling edits. Jira Issues as per log New Service Operation tables Updated namespaces Clean up of References Added general discussion of Requests and Responses to the intro to Services Split Reports into their own section (10) New UML, Interaction diagrams
WD34	2011-11-04	Toby Considine	Reordered section on Event Services, incorporating event Filter and Order New Figures throughout Section 3.3 added to discuss Roles and Resources Numerous small edits in response to Jira
WD35	2011-11-08	Toby Considine	Misc, Small Edits Added conformance section 1
WD36	2011-11-08	Toby Considine	Changes to Conformance Section 1 Misc formatting errors Figures 7-8, 7-10, 8-3 updated
WD37	2011-12- <a href="#">4211</a>	Toby Considine	Errata
<a href="#">WD38</a>	<a href="#">2011-12-11</a>	<a href="#">Toby Considine</a>	<a href="#">Additional Errata</a>
<a href="#">WD39</a>	<a href="#">201301107</a>	<a href="#">Toby Considine</a>	<a href="#">non-substantive changes, primarily editorial</a>

2537